



Regional Office (North)  
**Rajasthan State Pollution Control Board**  
Opposite Road No. 5, VKIA, Sikar Road, Jaipur.  
E-mail: [rorpcb.jaipur@gmail.com](mailto:rorpcb.jaipur@gmail.com)  
Phone no. 0141-2850100

**Registered/E-mail**

RSPCB/ROJPN/Legal-144/154

Date: 09/06/2021

The Registrar,  
Hon'ble National Green Tribunal,  
Central Zone,  
Bhopal.

**Subject: Compliance report of the Hon'ble NGT, Principal Bench, New Delhi order dated 23/12/2020 in Original Application No. 108/2020 (CZ) Rangoli Gardens Owners Welfare Society & Anr. V/s Ashiana Maintenance Services LLP & Ors.**

**Reference: 1. Hon'ble NGT order dated 23/12/2020.  
2. Joint survey report dated 23/03/2021.**

Sir,

With reference to above subject matter, it is submitted that the Hon'ble Tribunal has passed order dated 23/12/2020 inter-alia as follows:-

**“5. In light of the serious note of charges, we deem it just and proper to constitute a Committee consisting (i) the Collector, Jaipur and (ii) representative of the Rajasthan Pollution Control Board and to direct them to submit a factual and action taken report within four weeks. Rajasthan PCB will be the nodal agency for compliance.”**

In compliance of the directions passed by the Hon'ble Tribunal, the committee has conducted its survey on dated 23/03/2021. The copy of the joint survey is enclosed with this letter for ready reference of this Hon'ble Tribunal.

Encl: As above.


Yours Sincerely,

(Vijay Sharma)  
Regional Officer

## Factual and Action Taken Report

In reference to the Hon'ble National Green Tribunal, Principal Bench, New Delhi order dated 23/12/2020, in the matter of Rangoli Gardens Owners Welfare Society & Anr. V/s Ashiana Maintenance Services LLP. & Ors. Original Application No. 108/2020, the Joint Committee comprising Sh. Yugantar Sharma (SDM, Jaipur) and Sh. Vijay Sharma (Regional Officer, Jaipur RSPCB), as constituted in reference to aforesaid Hon'ble NGT order, visited the site M/s Megha Colonizers (Site Address - "Rangoli Garden" Group Housing Project) located at Maharana Pratap Marg, Panchyawala, Vaishali Nagar, Jaipur on dated 23/03/2021. Detailed factual status is as follows:

1. The visit was conducted in the presence of Sh. Gajendra Jangid (President - Rangoli Gardens Owner Welfare Society) and Sh. Manoj Shrivastav (DGM – Ashiana Maintenance Services LLP.)
2. In the beginning, on inquiring about the discharge of wastewater from Sewage Treatment Plant (STP) into the rainwater harvesting drain by Ashiana Maintenance Services LLP., as observed earlier during inspection of RSPCB Officials dated 23/06/2020, the representative of Rangoli Gardens Owner Welfare Society informed that activity of such kind not observed by them after that.
3. During visit, the STP (capacity 1050 KLD) installed was found operative and no discharge of STP wastewater into the rainwater harvesting drain was observed.
4. The joint committee, alongwith the other representatives, visited the STP and the premise of Rangoli Garden and also collected water/wastewater samples from following locations:
  - a) Raw water supply tank,
  - b) Treated wastewater tank of STP,
  - c) From fire hydrant at entry gate,
  - d) Bore-well in front of Block-15,
  - e) Inlet of STP,
  - f) Bore-well in front of Block-27,
  - g) Bore-well in front of Block-12,
  - h) Bore-well near Block-37 and
  - i) Bore-well near main gate.
5. Water/wastewater samples were also collected earlier by the officials of RSPCB on dated 23/06/2020 and 02/07/2020 from aforesaid locations.

  
क्षेत्रीय अधिकारी  
राजस्थान राज्य प्रदूषण नियंत्रण मण्डल  
जयपुर (उत्तर)

  
उप खण्ड अधिकारी  
जयपुर (प्रथम), जयपुर

## Factual and Action Taken Report

6. As per the submission/request of representative of Rangoli Gardens Owner Welfare Society, water/wastewater samples from following 02 locations were also collected:
- From flushing tank of Flat No. T12147A and
  - From fresh water supply of Flat No. T12147A.
7. Aforesaid water/wastewater samples were sent to Central Laboratory of Rajasthan State Pollution Control Board for analysis. Analysis results of the samples are awaited.

### Photographs of the Sewage Treatment Plant (STP) taken during visit

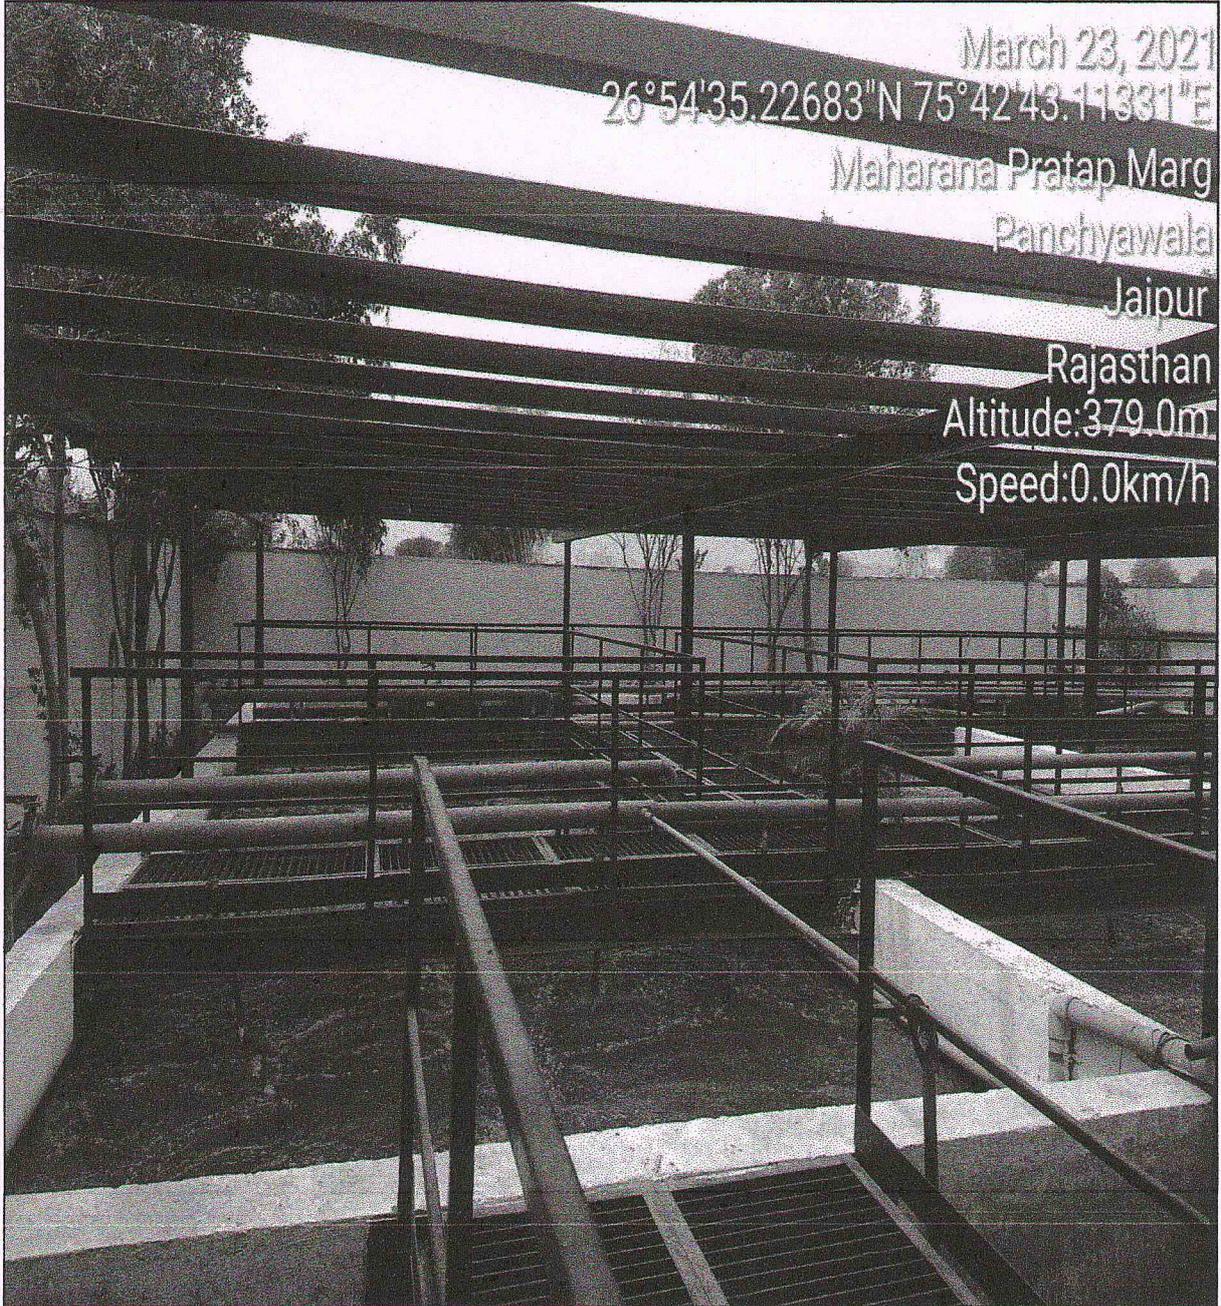


Fig 01: Aeration tank of the STP, diffusers were found in working condition.

क्षेत्रीय अधिकारी  
राजस्थान राज्य प्रदूषण नियंत्रण मण्डल  
जयपुर (उत्तर)

सुप खण्ड अधिकारी  
जयपुर (प्रथम), जयपुर

Factual and Action Taken Report

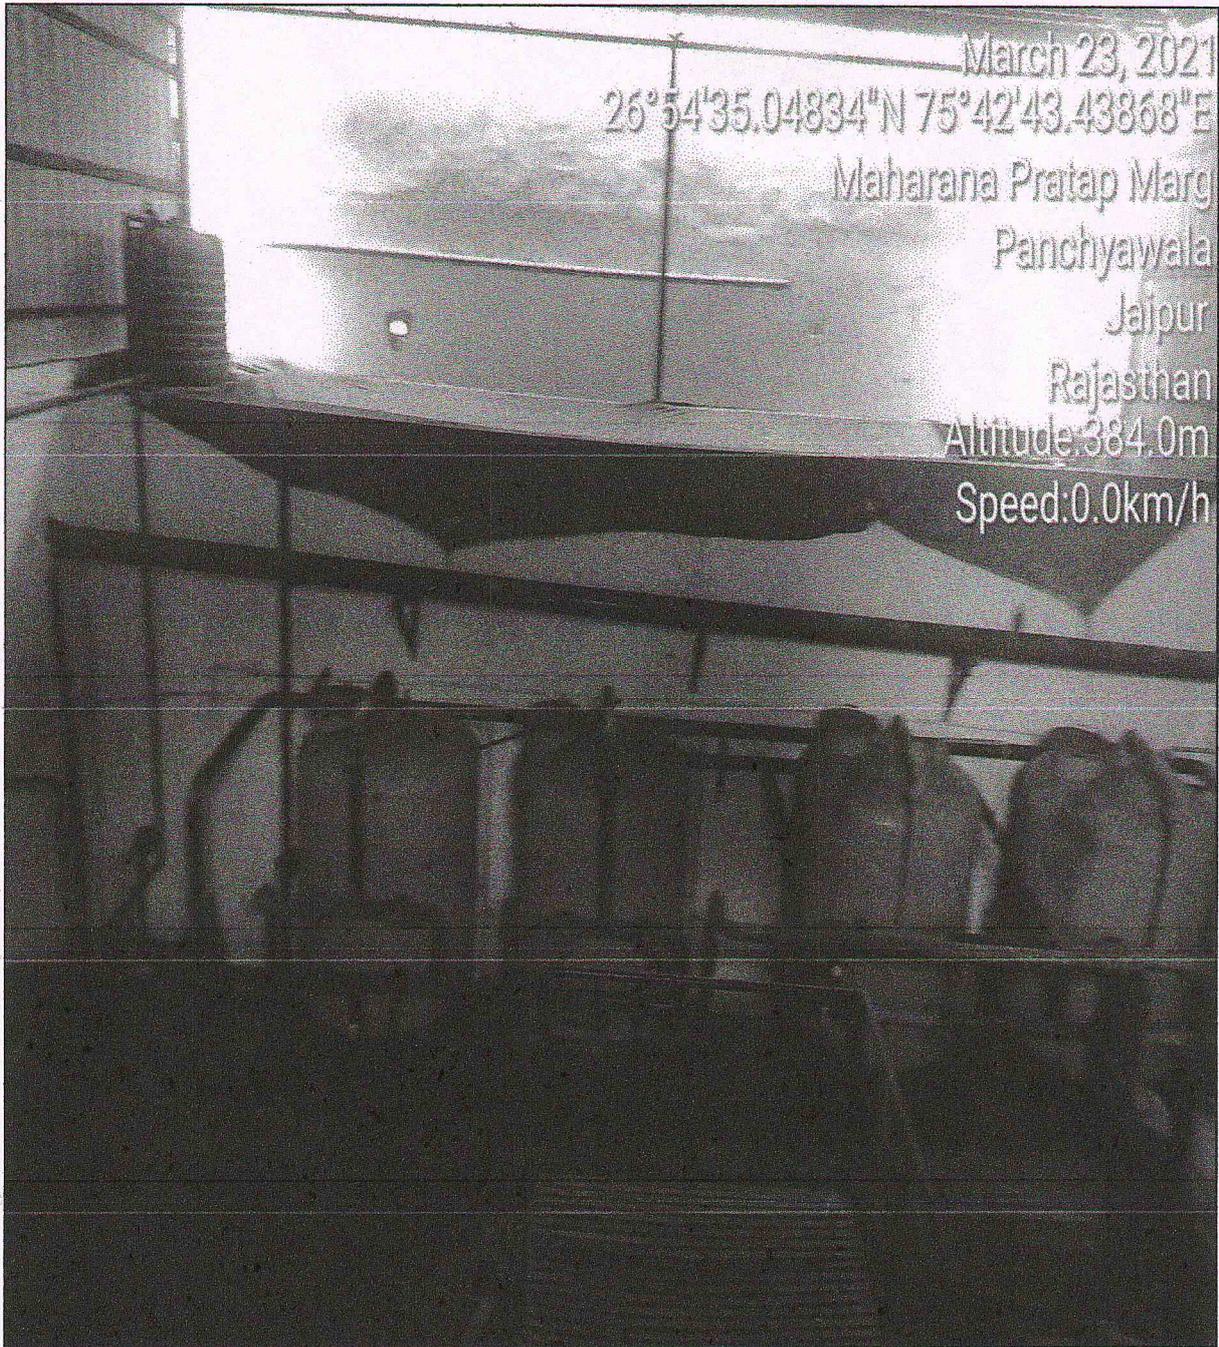



Fig 02: Multi Grade Filter (MGF) and Activated Carbon Filter (ACF) of the STP.

  
(Vijay Sharma) अधिकारी  
Regional Officer  
Jaipur (North) नियंत्रण मण्डल  
RSPCB (उत्तर)  
राजस्थान राज्य प्रदूषण नियंत्रण मण्डल  
जयपुर

  
(Yugantar Sharma)  
SDM, Jaipur  
जयपुर (मिशन)  
जयपुर