

**BEFORE THE NATIONAL GREEN TRIBUNAL
PRINCIPAL BENCH, NEW DELHI**

O. A. No. 164 of 2024

In the matter of:

Varun Gulati

... Applicant

versus

State of Haryana & Ors.

... Respondents

INDEX

S. No.	Particulars	Pages
1.	Objections to the Report of the Joint Committee (filed in compliance of order dated 21.02.2024 passed by this Hon'ble Tribunal) being filed on behalf of respondent no. 6 namely, M/s. TDI Infracorp (India) Ltd.	2-15
2.	Affidavit in support	16
3.	Annexure R6/1: Part completion certificate	17-18
4.	Annexure R6/2: Logbook	19-99
5.	Annexure R6/3: CTO application along with receipts	100-105
6.	Annexure R6/4: Copy of application for review	106-108
7.	Annexure R6/5: Test reports	109-119
8.	Annexure R6/6: Photographs	120-133

9. Service Proof

134

Place: New Delhi

Date: 30.7.2025

Through:

Raghav

Raghav Bimal, Lohit Kumar Bimal and Suhit Jain
Advocates, Anil Bimal & Associates

Counsels For Applicant

1818, Sector 17-A, Gurugram – 122001.

Ph: +91-9540-095-755

Email: lohit.bimal@anilbimal.com

**BEFORE THE NATIONAL GREEN TRIBUNAL
PRINCIPAL BENCH, NEW DELHI**

O. A. No. 164 of 2024

In the matter of:

Varun Gulati

... Applicant

versus

State of Haryana & Ors.

... Respondents

**OBJECTIONS TO THE REPORT OF JOINT COMMITTEE
FILED IN COMPLIANCE OF ORDER DATED 21.02.2024
BEING FILED ON BEHALF OF RESPONDENT NO. 6
NAMELY, M/S. TDI INFRACORP (INDIA) LTD.**

MOST RESPECTFULLY SHOWETH:

PRELIMINARY SUBMISSIONS

1. That the answering Respondent is a duly incorporated company. M/s. TDI has developed a licensed residential plotted colony at Sector 37 & 39, Panipat, Haryana. The present reply is being filed through the Authorized Representative Sh. Om Prakash Dhingra, the board resolution in this respect is already placed on record.

REPLY TO PARA 6 OF THE JOINT COMMITTEE REPORT

2. That while the identity and location of the project are admitted, however, the total land area is 221.446 acres. The Directorate of Town & Country Planning, Haryana has granted Part Completion Certificate (PART CC) for residential plotted colony having license no. 63-87 and 89-105 dated 11.02.2007 over an area admeasuring 221.446 in the revenue estate of village Kabri and Faridpur, Sector 39, District Panipat vide its memo no. LC-805-JE (BR)-2014/3114 dated 10/02/2014 is attached as **Annexure R6/1**.
3. That the status of the Consent to Establish (CTE), Consent to Operate (CTO), and Environmental Clearance (EC) is a matter of record. The answering respondent respectfully submits as follows:

- **Completion of Works Within Valid CTE Period:** All construction and allied activities were completed prior to 10.02.2014, which precedes the expiry of the CTE on 25.09.2015. No further construction or allied activity has been undertaken subsequent to the expiry of the said CTE.
- **Installation and Readiness of STP:** The Sewage Treatment Plant (STP) of 550 KLD capacity was installed concurrent with project completion and was technically ready for operation since 2014. The STP is equipped with flow meters, separate energy meters, and a sludge-drying press. However, there was no occupancy at the site until January 2022, barring maintenance and security personnel. It is submitted that the location of the project is far away from the city – almost at the far end border of Panipat. Most of the allottees in the project have invested in the project for future planning and only a small fraction of the allottees have come for end use. The project site largely remains vacant. There is no government sector adjoining the project except few private builders and villages.
- **Non-Occupancy Until January 2022 and Policy-Imposed Constraints on CTO Application:** Under prevailing Haryana State Pollution Control Board (HSPCB) policy, an application for CTO must precede the expiry of the CTE and include effluent samples within three months of filing. In the absence of occupancy and sewage generation, sample submission was factually impossible, and CTO could not be applied during the CTE validity period.
- **Occupancy Growth and Effluent Realities Post-2022:** Since January 2022, residential occupancy has gradually increased. As of January 2024, the resident population stood

below 500 individuals, and currently stands at approximately 800–1000 persons. Of the total plotted units in the project area, only 493 (i.e., ~22%) currently host structures, while the remainder (i.e., ~78%) remain vacant. Consequently, the average daily sewage generation rose from less than 30 KLD in January 2024 to approximately 48 KLD presently—substantially below the installed STP capacity of 550 KLD.

- **Operational Challenges Rooted in Low Input Load:** Due to insufficient effluent volume, the STP faced recurring motor failures and technical disruption. Despite these challenges, the answering respondent maintained continuous operation through appropriate interventions (such as use of outside support in the form of cow dung) and infrastructure upkeep. The project had achieved zero discharge and total treated effluent has always been used in plants and gardens.
- **Site Inspection and Logbook Disclosure:** It is submitted that personnel of the answering respondent were not involved in the Joint Committee's site inspection, due to which the STP logbook was not available to the Committee. It is submitted that the answering respondent has sold out the complete project area and the answering respondent has assigned an STP operating agency to assist the residents. No personnel of the answering respondent is deputed on the project site and their entire operations are carried out from their New Delhi office. It is further submitted that the inlet collection tank lacked sufficient effluent on 12.04.2024, which cause problems in the motors. Corrective maintenance was undertaken, and the affected components were repaired by 22.04.2024. During this period, the effluent was collected in STP tanks and not discharged anywhere. Since then, the STP has remained fully operational, with routine monitoring

and safeguards implemented to prevent recurrence. The logbook is enclosed herewith as **Annexure R6/2**, substantiating the above-stated facts on operational history.

- In view of the Joint Committee's recommendation that the answering respondent "*must obtain consent to operate*" and that the answering respondent "*will regularly operate its 550 KLD STP*," the answering respondent has applied for grand of CTO and deposited applicable fees and performance security through online banking into the Board's designated account (PNB A/c No. 4916000100007912). Copy of CTO application along with receipts evidencing payment is **Annexure R6/3**.

4. Limited Scope of Part CC, Population Growth Trajectory, and Actual Sewage Generation

- That the answering respondent has only been granted Part CC for a limited portion of the sanctioned project. It is pertinent to submit that the projected sewage generation of approximately 4720 KLD under the EC pertains to the full scope of the sanctioned master project—encompassing significantly greater built-up area, number of plotted units, and overall capital outlay than the current footprint governed by the present Part CC. It is submitted that the validity of EC and CTE expired before the project could be completed in its entirety. In compliance of the provisions of EC and CTE, the answering respondent closed all construction activities before the expiry of validity. The present capacity of STP is much more than the actual discharge. The answering respondent shall expand the STP capacity before the present capacity utilization gets exhausted after obtaining necessary approvals.

- As submitted earlier, there was no residential occupancy in the project area until January 2022, except for maintenance and security staff. Thereafter, occupancy levels increased gradually and reached fewer than 500 individuals by January 2024. As of the present, the estimated population stands at approximately 800–1000 persons. This limited occupancy materially impacts sewage quantum.
- Accordingly, actual sewage generation has remained substantially lower than projected capacities. The average daily sewage load rose from less than 30 KLD in early January 2024 to approx. 48 KLD at present. This figure remains significantly below both the 4720 KLD projected under EC and the installed STP capacity of 550 KLD.

REPLY TO PARA NO. 7 OF JOINT COMMITTEE REPORT

5. That the issuance of the closure order, as annexed with the report at Annexure R/7, is a matter of record. It is respectfully submitted that the answering respondent has already submitted a detailed application (Annexure R6/3) to HSPCB seeking revocation of the said order, which remains pending consideration. In view of the sub judice nature of the revocation proceedings, the answering respondent refrains from making any further comment on merits at this stage, consistent with procedural decorum.
6. That the impugned prosecution cases are also matters of record. It is submitted that the Board has already filed case against the Directors of the project proponent.
7. That the recommendation for imposition of Environment Compensation by the authorities is also a matter of record. It is further submitted that HSPCB has imposed Environment Compensation amounting to ₹5.47 crores upon the answering

respondent. And, the answering respondent has already filed review application before the HSPCB, which is pending consideration. Copy of application is **Annexure – R6/4**.

8. That following the issuance of the closure order, the answering respondent ceased all field operations at the project site. All administrative and operational functions have since been relocated to the answering respondent's registered-cum-corporate office in New Delhi. Furthermore, operations of the STP facility have been outsourced to a third-party specialist operator with technical competency. Despite these facts being known to the authorities, the Board continues to direct correspondence and initiate actions at the project site, where no representatives of the answering respondent are stationed. Such conduct contravenes foundational principles of natural justice by proceeding ex parte and without effective opportunity of reply.

REPLY TO PARA NO. 8 OF JOINT COMMITTEE REPORT

9. In respect of para 8(i), it is respectfully submitted that the validity of the CTE and its date of expiry are matters of record. All construction and allied activities were completed prior to 10.02.2014, which precedes the expiry of the CTE on 25.09.2015. No construction or allied work has been undertaken thereafter, thereby ensuring strict adherence to the CTE conditions. Furthermore, the answering respondent has duly submitted evidence of compliance with the conditions stipulated under both the EC and CTE to the HSPCB. In addition, the respondent has re-submitted the aforesaid compliance records in support of its pending application for revocation of closure order.

10. In respect of para 8(ii), it is respectfully submitted that under prevailing HSPCB policy, an application for CTO must precede the

expiry of the CTE and include effluent samples within three months of filing. In the absence of occupancy and sewage generation, sample submission was factually impossible, and CTO could not be applied during the CTE validity period. In view of the Joint Committee's recommendation that the answering respondent "*must obtain consent to operate*" and that the answering respondent "*will regularly operate its 550 KLD STP,*" the answering respondent has already applied for CTO and applicable fees and performance security have been duly deposited through online banking into the Board's designated account. Further, the answering respondent has already properly operated 550 KLD STP in the past as well as presently.

11. In respect of para 8(iii), the answering respondent respectfully submits the following:

- The answering respondent has only been granted Part CC for a limited portion of the sanctioned project. It is pertinent to submit that the projected sewage generation of approximately 4720 KLD under the EC pertains to the full scope of the sanctioned master project—encompassing significantly greater built-up area, number of plotted units, and overall capital outlay than the current footprint governed by the present Part CC. It is submitted that the validity of EC and CTE expired before the project could be completed in its entirety. In compliance of the provisions of EC and CTE, the answering respondent closed all construction activities before the expiry of validity. The present capacity of STP is much more than the actual discharge. The answering respondent shall expand the STP capacity before the present capacity utilization gets exhausted after obtaining necessary approvals.

- As submitted earlier, there was no residential occupancy in the project area until January 2022, except for maintenance and security staff. Thereafter, occupancy levels increased gradually and reached fewer than 500 individuals by January 2024. As of the present, the estimated population stands at approximately 800–1000 persons. This limited occupancy materially impacts sewage quantum.
- Accordingly, actual sewage generation has remained substantially lower than projected capacities. The average daily sewage load rose from less than 30 KLD in early January 2024 to approximately 48 KLD at present. This figure remains significantly below both the 4720 KLD projected under the EC and the installed STP capacity of 550 KLD.

12. In respect of para 8(iv), the answering respondent respectfully submits the following:

- The personnel of the answering respondent were not involved in the Joint Committee's site inspection. The answering respondent was not informed / aware about the inspection due to lack of authorized representatives on the project site because the answering respondent has already sold the complete project and the operations of the company are situated at New Delhi. As a result, the Joint Committee has neither been able to inspect the site properly nor access full information / disclosures.
- It is submitted that the STP of 550 KLD capacity was installed concurrent with project completion and was technically ready for operation since 2014. The STP is equipped with flow meters, separate energy meters, and a

sludge-drying press. However, there was no occupancy at the site until January 2022, barring maintenance and security personnel.

- Thereafter, occupancy increased gradually – reaching to fewer than 500 persons in January 2024 and currently standing at approximately 800-1000 persons. Of the total plotted units in the project area, only 493 (i.e., ~22%) currently host structures, while the remainder (i.e., ~78%) remain vacant.
- Consequently, the average daily sewage generation rose from less than 30 KLD in January 2024 to approximately 48 KLD presently—substantially below the installed STP capacity of 550 KLD.
- Due to insufficient effluent volume, the STP faced recurring motor failures and technical disruption. Despite these challenges, the answering respondent maintained continuous operation through appropriate interventions (such as use of outside support in the form of cow dung) and infrastructure upkeep.
- It is pertinent to reiterate that the inlet collection tank lacked sufficient effluent on 12.04.2024, which caused problems in the motors. Corrective maintenance was undertaken, and the affected components were repaired by 22.04.2024. During this period, the effluent was collected in STP tanks and there was no discharge anywhere. Since then, the STP has remained fully operational, with routine monitoring and safeguards implemented to prevent recurrence. The logbook is enclosed herewith as Annexure R6/2, substantiating the above-stated facts on operational history.

- It is respectfully submitted that the observation recorded by the Joint Committee—namely, that domestic effluent is either untreated or being disposed of in open areas such as vacant plots, green belts, and internal roads—is factually incorrect, procedurally unsubstantiated, and institutionally prejudicial. The said observation appears to be a verbatim reproduction of the allegations contained in the underlying complaint, rather than an outcome of any independent or scientifically validated inspection. Critically:
 - a) **Absence of Respondent Participation:** No representatives or personnel of the answering respondent were joined or even informed during the alleged field inspection. This unilateral exercise is in clear derogation of the principles of natural justice and deprives the respondent of any opportunity to clarify facts or produce contemporaneous records.
 - b) **Evidence collected during inspection not supplied:** The Joint Committee has not provided any evidence collected by it during site inspection to the answering respondent.
 - c) **No Sample Collection or Lab Analysis:** No samples of the alleged untreated effluent have been collected from the field. Consequently, no laboratory testing or scientific analysis has been conducted to substantiate the claim that effluent is untreated or being misdirected into open areas. The answering respondent has got the samples tested from NABL lab and as per analysis report the parameters are within prescribed limits. Copy is at **Annexure – R6/5**.

Taken together, these lapses render the Committee's observation untenable both on factual and procedural grounds. The answering respondent maintains that domestic effluent is directed to the STP facility installed on-site and that the system has remained functional and continued under technical supervision. Any deviation—if at all—should be substantiated through empirical data rather than adopted uncritically from third-party allegations.

13. In respect of para 8(v), it is respectfully submitted that the answering respondent has installed a dedicated STP with a treatment capacity of 550 KLD. The system operates consistently and under technical supervision, with treated water conforming to prescribed parameters. The treated water is put to use in horticultural and gardening activities within the project area and directed to reuse to spray water on roads for settling dust. Kindly see photographs at **Annexure R6/6**.

14. In respect of para 8(vi), it is respectfully submitted that the STP facility is equipped with sludge-drying press and the project site has adequate number of compost pits for the disposal of STP sludge. It is reiterated that the inlet collection tank lacked sufficient effluent on 12.04.2024, which caused problems in the motors. Corrective maintenance was undertaken, and the affected components were repaired by 22.04.2024. During this period, the effluent was collected in STP tanks and not discharged anywhere. Since then, the STP has remained fully operational, with routine monitoring and safeguards implemented to prevent recurrence.

15. In respect of para 8(vii), it is respectfully submitted that the answering respondent has provided latest technology DG set at the site and it is used only for sewage treatment plant.

REPLY TO PARA NO. 9 OF JOINT COMMITTEE REPORT

16. It is respectfully submitted that the contents of paragraph 9 of the Joint Committee Report are, in essence, a reiteration of allegations already articulated in earlier paragraphs. These have been duly and comprehensively addressed by the answering respondent in the preceding submissions and are not being repeated herein for the sake of brevity and to avoid redundancy. With respect to the purported issuance of a show cause notice, it is submitted that the answering respondent has not received any such notice at its registered office or correspondence address. It is presumed that, if such notice has indeed been issued, the Board may have attempted delivery to the project site where no authorized persons / officials of the company are stationed. Furthermore, the answering respondent has no knowledge or formal intimation regarding any initiation of fresh prosecution proceedings.

REPLY TO PARA NO. 10 OF JOINT COMMITTEE REPORT

17. In respect of para 10 (i) and in view of the submissions made in the preceding paragraphs, it is respectfully submitted that the answering respondent has applied for grant of CTO and applicable fees and performance security have been duly deposited through online banking into the Board's designated account (Punjab National Bank A/c No. 4916000100007912).

18. It is respectfully submitted that the contents of para no. 10 (ii) to 10 (iv) are not directed towards the answering respondent. Hence, no reply is warranted.

19. In respect of para 10 (v), it is respectfully submitted that the HSPCB has imposed Environment Compensation of Rs. 5.47 crores upon the answering respondent, and the application of the answering respondent for review is pending consideration before the HSPCB. It is submitted that the answering respondent has addressed each

observation of the Joint Committee Report with clarity and documentary evidence. Each alleged deviation has been rebutted to demonstrate factual compliance. The EC imposition, in disregard of these rebuttals, violates the principles of fair adjudication and undermines the evidentiary weight of institutional submissions. The imposition of Environment Compensation, absent any documented breach, is ultra vires and violates the principle of proportionality. No environmental degradation has been causally linked to the Respondent's operations. The EC order fails to establish any baseline deviation, pollutant spike, or ecological impact attributable to the Respondent. The Joint Committee Report does not record any collection of effluent, air, or water samples at the time of inspection. The impugned EC order is thus devoid of any scientific or evidentiary basis.

20. In respect of para 10 (vi), it is respectfully submitted that the answering respondent is duly maintaining logbooks, which duly are annexed with this reply.

21. In respect of para 10 (vii), it is respectfully submitted that the answering respondent has only been granted Part CC for a limited portion of the sanctioned project. It is pertinent to submit that the projected sewage generation of approximately 4720 KLD under the EC pertains to the full scope of the sanctioned master project—encompassing significantly greater built-up area, number of plotted units, and overall capital outlay than the current footprint governed by the present Part CC. It is submitted that the validity of EC and CTE expired before the project could be completed in its entirety. In compliance of provisions of EC and CTE, answering respondent closed all construction activities before expiry of validity. The present capacity of STP is much more than actual discharge. The respondent shall expand STP capacity before present capacity utilization gets exhausted after obtaining necessary approvals.

22. In respect of para 10 (viii), it is respectfully submitted that the need expressed therein does not arise in view of the foregoing submission.

23. In respect of para 10 (ix), it is respectfully submitted that the STP has remained fully operational, with routine monitoring and safeguards implemented to prevent recurrence.

PRAYER

In view of the above, the answering respondent most respectfully prays that this Hon'ble Tribunal may be pleased to:

- (a) Reject the Joint Committee Report filed in compliance with order dated 21.02.2024, in view of the Respondent's point-wise rebuttal and the admitted absence of sampling or scientific analysis forming its basis;
- (b) Pass such further or consequential orders as this Hon'ble Tribunal may deem fit, just, and equitable in the facts and circumstances of the case.

Place: New Delhi




Date: 30.7.25

For TDI INFRACORP (INDIA) LIMITED


Director/Authorised Signatory

Respondent no. 6

Through:


Raghav Bimal, 
Lohit Kumar Bimal and 
Suhit Jain
Advocates, Anil Bimal & Associates
Counsel for Respondent no. 6
1818, Sector 17-A, Gurugram – 122001.
Ph: +91-9540-095-755
Email: lohit.bimal@anilbimal.com

**BEFORE THE NATIONAL GREEN TRIBUNAL
PRINCIPAL BENCH, NEW DELHI**

O. A. No. 164 of 2024

In the matter of:

Varun Gulati

... Applicant

versus

State of Haryana & Ors.

... Respondents

AFFIDAVIT

I, Om Prakash Dhingra s/o Sh. Ladhu Ram r/o C-116, Ghanta Ghar, Hari Nagar, New Delhi – 110064, do hereby solemnly affirm and state on oath as under:

1. That I am the authorized representative of M/s. TDI Infracorp India Ltd. who is the respondent no. 6 in the present case and I am fully conversant with the facts and circumstances of the case and competent to sign and swear this affidavit.
2. That I have read and understood the contents of accompanying reply and state that the contents stated therein are true to my knowledge and based on my information, belief and legal advice.
3. That the contents of the accompanying reply may kindly be read as part and parcel of this affidavit and the same are not being repeated herein for the sake of brevity.

Place: New Delhi
Date: 30.7.25

For TDI INFRACORP (INDIA) LIMITED

DEPONENT
Director/Authorised Signatory

Verification

Verified at New Delhi on this ___ of _____ 2025 that the contents of the above affidavit are true to the best of my knowledge and belief and no part of it is false and nothing material has been concealed therefrom.

Place: New Delhi
Date: 30.7.25

For TDI INFRACORP (INDIA) LIMITED

DEPONENT
Director/Authorised Signatory

IDENTIFIED BY
Name of Advocate.....
Enrl. No.....



ATTESTED
NOTARY PUBLIC
GOVT. OF INDIA

30 JUL 2025

Directorate of Town and Country Planning, Haryana

SCO No. 71-75, 2nd Floor, Sector-17 C, Chandigarh, web site: tpharyana.gov.in
Phone: 0172-2549349; e-mail: tphry@gmail.com

LC-IX
(See Rule 16 (2))

To
Taneja Developers & Infrastructure Ltd.,
9-Kasturba Gandhi Marg,
New Delhi.

Memo No. LC-805-JE (BR)-2014/3114 Dated: 10/2/14

Subject: **Grant of part completion certificate of residential plotted colony having licence No. 63-87 and 89-105 dated 11.02.2007 over an area measuring 221.446 acres in the revenue estate of village Kabri and Faridpur, Sector -39, District Panipat.**

Reference: Your application dated 28.02.2012.

Your request for part completion certificate over an area measuring 221.446 acres in respect of residential plotted colony developed on the land measuring 221.446 acres in the Revenue Estate of Village Kabri and Faridpur, Sector 39, District Panipat for license no. 63-87 and 89-105 dated 11.02.2007.

It is hereby certified that the required development works on the Residential plotted colony at Panipat comprising of Licence no. 63-87 and 89-105 dated 11.02.2007 for 221.446 acres as indicated on the enclosed layout plan duly signed by me read in conjunction with the following terms and conditions have been completed to my satisfaction. The development works are Water supply, Sewerage, Storm water Drainage, Roads, Horticulture and Electrification. The completion certificate is granted on the following terms and conditions:-

- i. That you shall be fully responsible for supply of water as per norms till such time the colony is handed over after final completion
- ii. The service will be laid by the colonizer upto alignment of proposed external services of the town and connection with the HUDA system will be done by the Society at his own cost with the prior approval of the competent authority. In case pumping is required, the same will be done by the Society at his own cost. The services will be provided as per provision in the EDC of Sonapat.
- iii. Level/Extent of the services to be provided by HUDA i.e. water supply sewerage, SWD, roads etc. will be proportionate of EDC provisions.
- iv. That licensee will also maintain the internal services to the satisfaction of the Director General till the colony is handed over after granting final completion certificate.
- v. That in case some additional structures are required to be constructed and decided by HUDA at a later stage, the same will be binding upon you.
- vi. That you shall maintain a roof top rain water harvesting system properly and keep it operational all the time.

- vii. The basement and stilt shall be used as per provisions of approval zoning plan building plans.
- viii. That the outer façade of the buildings shall not be used for the purposes advertisement and placement of hoardings.
- ix. That you shall neither erect nor allow the erection of any Communication and transmission Tower on top of the building blocks.
- x. That you shall use the tube well room only for maintain the part and will demolish the same directed by the Department.
- xi. That you shall complete the community building within stipulated period prescribed on policy dated 3.04.2012.
- xiii. As per service plan estimate the arrangement for water supply, disposal of sewerage as per guidelines of HSPCB/Environment Department and drinking water shall be made by the firm themselves. Consent for smooth functioning till the external service are provided by HUDA has already been given by the colonizers.

This completion certificate shall be void ab-initio, if any of the conditions mentioned above are not complied with.

Ahuratgi
(Ahuratgi)
Director General,
Town and Country Planning
Haryana, Chandigarh

Endst. No. LC-805-JE (BR)-2014/

Dated:

A copy is forwarded to the following for information and necessary action.

- i. CA, HUDA, Panchkula.
- ii. Senior Town Planner, Rohtak.
- iii. District Town Planner, Panipat.
- iv. Chief Accounts Officer of this Directorate.

(S.K. Sehrawat)
District Town Planner, (HQ)
For Director General, Town and Country Planning,
Haryana, Chandigarh.

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 01-04-2025
SHIFT: A/B/C

SITE FOR: TDI Ratipat

STP CAPACITY

PARTICULARS	STATUS	07:00 09:00 12:00 16:00 20:00 22:00 01:00 04:00								SHIFT	TREATED WATER PARAMETERS			REMARKS BY OPTR			
		NO: 1	NO: 2	NO: 1	NO: 2	WORKING	STAND BY	WORKING	STAND BY		WORKING	STAND BY	WORKING		STAND BY	A	B
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	—	—	—	—
AIR BLOWER	NO: 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.0	—
SEWAGE TRANSFER PUMP	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	500 ML	500 ML	—	—
SLUDGE RECIRCULATION PUMP	NO: 2	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	—	—	—	—
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			—
IRRIGATION WATER PUMP	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	A	B	C	—
UV SYSTEM & LAMP STATUS	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	10 LTR	—	—	—
ULTRA FILTRATION WORKING TIME	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	10 LTR	—	—	—
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			—
FILTER PRESS FEED PUMP	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT	PERVIOUS	DIFFERENCE	—
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	ELECTRICITY CONSUMED PER DAY			—
AIR BLOWER PRESSURE (PSI)	NO: 2	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	PRESENT KWH	PREVIOUS KWH	DIFFERENCE	—
AIR DIFFUSER FUNCTIONING	AT 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	TOTAL TREATED WATER			—
ACFMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	REMARKS BY MAINTENANCE MANAGER IF ANY.			—
COLOR	OFI	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PERVIOUS	DIFFERENCE	—
MBBR TANK SLUDGE% (MLSS)		22%	22%	22%	22%	22%	22%	22%	22%	22%	22%	22%	22%	1693	145	48	—
DRY SLUDGE GENERATED (KG)		—	—	—	—	—	—	—	—	—	—	—	—	OUTLET FLOW METER READING			—

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

DATE: 20/4/25
SHIFT: A/B/C

STP CAPACITY

PARTICULARS	STATUS	07:00 - 04:00								TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B		C
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	7.5	8.0	
	NO : 2										500ml	500ml		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	10 LTR			
	STAND BY										10 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY			
	WIN/W										PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY										45 KLD			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY										17:38			
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING			
	NO : 2										PRESENT	PERVIOUS	DIFFERENCE	
AIR BLOWER PRESSURE (PSI)	NO : 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	1693	1693	45	
	NO : 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓				
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	OK				
		22%	22%	22%	22%	22%	22%	22%	22%	22%				
MIBBR TANK SLUDGE% (MLSS)		-	-	-	-	-	-	-	-	-				
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	-				

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 03/04/2025
SHIFT: A/B/C

SITE FOR: PWDFA7

SITE FOR: DD7

STP CAPACITY

PARTICULARS	STATUS	TIME								SHIFT	TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		A	B	C	
BAR SCREEN CLEANING	NO 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO 2													
AIR BLOWER	NO 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	7.5	8.0	
	NO 2										500	500		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		10 LTR			
	STAND BY										10 LTR			OK
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		INLET FLOW METER READING			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		ELECTRICITY CONSUMED PER DAY			
	W/W										PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		TOTAL TREATED WATER			
	STAND BY										49 KLD			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		REMARKS BY MAINTENANCE MANAGER IF ANY.			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
OIL LEVEL IN BLOWER	NO 1	OK	OK	OK	OK	OK	OK	OK	OK		OUTLET FLOW METER READING			
	NO 2										PRESENT	PERVIOUS	DIFFERENCE	
AIR BLOWER PRESSURE (PSI)	NO 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0		1787	1738	49	
	NO 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓					
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓					
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓					
	OFF													
COLOR	OK	OK	OK	OK	OK	OK	OK	OK	OK					
	22%	22%	22%	22%	22%	22%	22%	22%	22%					
MBBR TANK SLUDGE% (MLSS)	22%	22%	22%	22%	22%	22%	22%	22%	22%					
DRY SLUDGE GENERATED (KG)														

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maipal Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

T D J PANT PAT

DATE: 11.11.25
SHIFT: A/B/C

PARTICULARS	STATUS	STP CAPACITY								TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B		C
BAR SCREEN CLEANING	NO: 1	OK	DK	DK	DK	DK	DK	DK	DK	DK				
	NO: 2													
AIR BLOWER	NO: 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	7.5	7.5	8.0	
	NO: 2										5.0	5.0		
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	10 LTR			
	STAND BY										JEGGERY			
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	ON	CHLORINE			
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	ON	ELECTRICITY CONSUMED PER DAY			
	WIN/W										PRESENT KWH			
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PREVIOUS KWH			
	STAND BY										DIFFERENCE			
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DN	TOTAL TREATED WATER			
	STAND BY										45 K.L.D			
OIL LEVEL IN BLOWER	NO: 1	OK	DK	DK	DK	DK	DK	DK	DK	DK	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO: 2													
AIR BLOWER PRESSURE (PSI)	NO: 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0				
	NO: 2													
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING			
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	PRESENT	PERVIOUS	DIFFERENCE	
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓				
COLOR	OK	OK	DK	DK	DK	DK	DK	DK	DK	DK				
	22%	22%	22%	22%	22%	22%	22%	22%	22%	22%				
MBBR TANK SLUDGE% (MLSS)														
DRY SLUDGE GENERATED (KG)														

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

DATE: 5-4-25
SHIFT: A/B/C

PANDE SAT

SITE FOR: T.D.T

PARTICULARS	STATUS	TIME								SHIFT	TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		A	B	C	
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	-	-	-	
	NO:2	OK	OK	OK	OK	OK	OK	OK	OK	pH	7.5	7.5	8	
AIR BLOWER	NO:1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	CHLORINE	500 LTR	500 LTR	-	
	NO:2	DN	OFF	DN	OFF	DN	OFF	DN	OFF	TDS	-	-	-	
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	CHEMICAL CONSUMED				
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	A	B	C		
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	BIOCULTURE	10 LTR	-	-	OK
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	JEGGERY	10 LTR	-	-	
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	CHLORINE	-	-	-	
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	INLET FLOW METER READING				
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	PRESENT	-	-	-	
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DIFFERENCE	-	-	-	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	ELECTRICITY CONSUMED PER DAY				
	WIN/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	PRESENT KWH	-	-		-
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	PREVIOUS KWH	-	-	-	
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DIFFERENCE	-	-	-	
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	TOTAL TREATED WATER				
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	48 KLD				
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY..				
	NO:2	OK	OK	OK	OK	OK	OK	OK	OK	48 KLD				
AIR BLOWER PRESSURE (PSI)	NO:1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	OUTLET FLOW METER READING				
	NO:2	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	PRESENT	1550	1532		18
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓	PERVIOUS	-	-	-	
	AT:1	✓	✓	✓	✓	✓	✓	✓	✓	DIFFERENCE	-	-	-	
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	REMARKS BY MAINTENANCE MANAGER IF ANY..				
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	48 KLD				
COLOR	OK	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING				
	OK	OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	1550	1532		18
MBBR TANK SLUDGE% (MLSS)	22%	22%	22%	22%	22%	22%	22%	22%	22%	REMARKS BY MAINTENANCE MANAGER IF ANY..				
DRY SLUDGE GENERATED (KG)	-	-	-	-	-	-	-	-	-	48 KLD				

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

REMARKS BY OPR

DATE : 6.4.25
SHIFT : A/B/C

SITE FOR : TDI SANIPAT

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8	
	NO : 2									500ml	500ml		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR			
	STAND BY									5 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY												
UV SYSTEM & LAMP STATUS	W/N/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	W/N/W									PRESENT	PERVIOUS	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY			
	STAND BY									PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY									110 KLD			
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5				
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING			
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	PRESENT	PERVIOUS	DIFFERENCE	
ACFM/GF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
MBBR TANK SLUDGE% (MLSS)	NO : 1	23%	23%	23%	23%	23%	23%	23%	23%	1920	1880	40	
	NO : 2												
DRY SLUDGE GENERATED (K3)	NO : 1	-	-	-	-	-	-	-	-				
	NO : 2												

327

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

25

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 7.4.25
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TDI SANTAPAT

STP CAPACITY

PARTICULARS	STATUS	07:00 - 04:00								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	-	-	-
	NO: 2	OK	OK	OK	OK	OK	OK	OK	OK	pH	7.5	7.5	8
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHLORINE	-	-	-
	NO: 2	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TDS	-	-	-
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	BIOCULTURE	5 LTR	-	-
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	JEGGERY	5 LTR	-	-
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE	-	-	-
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT	PERVIOUS	DIFFERENCE	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
UV SYSTEM & LAMP STATUS	WNW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT KWH	119 KWH		
	WNW	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH	-		
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	DIFFERENCE	-		
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	TOTAL TREATED WATER			
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK	-			
	STAND BY	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	-			
OIL LEVEL IN BLOWER	NO: 1	✓	✓	✓	✓	✓	✓	✓	✓	-			
	NO: 2	✓	✓	✓	✓	✓	✓	✓	✓	-			
AIR BLOWER PRESSURE (PSI)	NO: 1	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	-			
	NO: 2	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	-			
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓	-			
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓	-			
ACFIMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	-			
	OFF	OK	OK	OK	OK	OK	OK	OK	OK	-			
COLOR	ON	23%	23%	23%	23%	23%	23%	23%	23%	-			
	OFF	23%	23%	23%	23%	23%	23%	23%	23%	-			
MBBR TANK SLUDGE% (MLSS)	ON	23%	23%	23%	23%	23%	23%	23%	23%	PERVIOUS	1920	DIFFERENCE	
	OFF	23%	23%	23%	23%	23%	23%	23%	23%	1969	1920	49	
DRY SLUDGE GENERATED (KG)	ON	-	-	-	-	-	-	-	-	-			
	OFF	-	-	-	-	-	-	-	-	-			

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 8.4.25
SHIFT: A/B/C

SITE FOR: TDI PANJ PAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	8.0
	NO : 2									5000	5000
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR	
	STAND BY									5 LTR	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/N/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	W/N/W										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2										
ACFMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR	PRESENT	DK	DK	DK	DK	DK	DK	DK	DK		
	DIFFERENCE	23%	23%	23%	23%	23%	23%	23%	23%		
MBBR TANK SLUDGE% (MLSS)	PRESENT	2019	2019	2019	2019	2019	2019	2019	2019		
	DIFFERENCE	1969	1969	1969	1969	1969	1969	1969	1969		
DRY SLUDGE GENERATED (KG)	PRESENT										
	DIFFERENCE										

329

Alu

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

26

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

DATE: 9.1.25

SHIFT: A/B/C

SITE FOR: TDI PAMFAT

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2									7.5	7.5	8.0	
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	NO: 2												
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY												Att
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	W/W									ELECTRICITY CONSUMED PER DAY			
	W/W									PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY									TOTAL TREATED WATER			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY									45 KLD			
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO: 2												
AIR BLOWER PRESSURE (PSI)	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO: 2												
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PERVIOUS	DIFFERENCE	
		23%	23%	23%	23%	23%	23%	23%	23%	2061	2019	115	
MBBR TANK SLUDGE% (MLSS)		23%	23%	23%	23%	23%	23%	23%	23%				
DRY SLUDGE GENERATED (KG)													

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Main Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 16/05/2023
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

PANI PAT

SITE FOR: TDI

STP CAPACITY: _____

REMARKS BY OPTR

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK		
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	NO : 2	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	W/NW										
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	OK	OK	OK	OK	OK	OK	OK	OK		
COLOR	PRESENT	23%	23%	23%	23%	23%	23%	23%	23%		
	DIFFERENCE										
MBBR TANK SLUDGE% (MLSS)	PRESENT	2110	2060	2060	2060	2060	2060	2060	2060		
	DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PRESENT										
	DIFFERENCE										

331

REMARKS BY MAINTENANCE MANAGER IF ANY:-
416 KLD

OUTLET FLOW METER READING

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

28

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 11.4.25
SHIFT: A/B/C

SITE FOR: TST
SANT PAT

STP CAPACITY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO: 2										
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO: 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	W/W										
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO: 2										
AIR BLOWER PRESSURE (PSI)	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO: 2										
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
		23%	23%	23%	23%	23%	23%	23%	23%		
MBBR TANK SLUDGE% (MLSS)		23%	23%	23%	23%	23%	23%	23%	23%		
DRY SLUDGE GENERATED (KG)											

SHIFT A B C
HARDNESS
PH 7.5 7.5 8.0
CHLORINE
TDS
CHEMICAL CONSUMED
A B C
BIOCULTURE
JEGGERY
CHLORINE
PRESENT PERVIOUS DIFFERENCE
INLET FLOW METER READING
PRESENT PERVIOUS DIFFERENCE
ELECTRICITY CONSUMED PER DAY
PRESENT KWH
PREVIOUS KWH
DIFFERENCE
TOTAL TREATED WATER
48 KLD
REMARKS BY MAINTENANCE MANAGER IF ANY:-
OUTLET FLOW METER READING
PRESENT PERVIOUS DIFFERENCE
2158 2110 48

ALL OK

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maintn Manager

[Signature]

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

SHIFT : A/B/C

DATE : 12-06-25

SITE FOR TDI Purified

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	on	off	on	off	on	off	on	off		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	on	off	on	off	on	off	on	off		
	STAND BY										
FILTER FEED PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	on	off	on	off	on	off	on	off		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	off	on	off	on	off	on	off	on		
	W/NW										
ULTRA FILTRATION WORKING TIME	WORKING	on	off	on	off	on	off	on	off		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
FILTER PRESS FEED PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	✓	✓	✓	✓	✓	✓	✓	✓		
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK		
	PERVIOUS	23%	23%	23%	23%	23%	23%	23%	23%		
MBBR TANK SLUDGE% (MLSS)	PRESENT	23%	23%	23%	23%	23%	23%	23%	23%		
	DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PRESENT	—	—	—	—	—	—	—	—		
	DIFFERENCE										

CHEMICAL CONSUMED

A	B	C
7.5	7.5	8.0
500 ml	500 ml	—

INLET FLOW METER READING

PRESENT	PERVIOUS	DIFFERENCE
5 LTR	5 LTR	—

ELECTRICITY CONSUMED PER DAY

PRESENT KWH	PERVIOUS KWH	DIFFERENCE
48 KLD	—	—

TOTAL TREATED WATER

48 KLD

REMARKS BY MAINTENANCE MANAGER IF ANY.

OUTLET FLOW METER READING

PRESENT	PERVIOUS	DIFFERENCE
2206	2158	48

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maintenance Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR TDI Pimpri

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 12/4/25
SHIFT: A/B/C

STP CAPACITY

PARTICULARS	STATUS	07:00 - 04:00								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	on	off	on	off	on	off	on	off		7.5	7.5	8.0
	NO : 2												
SEWAGE TRANSFER PUMP	WORKING	off	on	off	on	off	on	off	on				
	STAND BY												
SLUDGE RECIRCULATION PUMP	WORKING	on	off	on	off	on	off	on	off		5 LTR		
	STAND BY										5 LTR		ALL OK
FILTER FEED PUMP	WORKING	off	on	off	on	off	on	off	on				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	on	off	on	off	on	off	on	off				
	STAND BY												
UV SYSTEM & LAMP STATUS	W/W	off	on	off	on	off	on	off	on				
	W/W												
FLUSH WATER LIFTING PUMP	WORKING	on	off	on	off	on	off	on	off				
	STAND BY												
FILTER PRESS FEED PUMP	WORKING	off	on	off	on	off	on	off	on				
	STAND BY												
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	9.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0				
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	✓	✓	✓	✓	✓	✓	✓	✓				
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK				
	DIFFERENCE	23%	23%	23%	23%	23%	23%	23%	23%				
MBBR TANK SLUDGE% (MLSS)	PRESENT	22.5	22.5	22.5	22.5	22.5	22.5	22.5	22.5				
	DIFFERENCE												45
DRY SLUDGE GENERATED (KG)	PRESENT												
	DIFFERENCE												

REMARKS BY MAINTENANCE MANAGER IF ANY:-

45 KLD

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager



SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 14/04/25
SHIFT: A/B/C

REMARKS BY OPTR

STP CAPACITY

TREATED WATER PARAMETERS

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK		
AIR BLOWER	NO : 1	on	off	on	off	on	off	on	off	on	off	on	7.5	7.5
	NO : 2	on	off	on	off	on	off	on	off	on	off	on	5.00	5.00
SEWAGE TRANSFER PUMP	WORKING	off	on	off	on	off	on	off	on	off	on	off		
	STAND BY	on	off	on	off	on	off	on	off	on	off	on		
SLUDGE RECIRCULATION PUMP	WORKING	on	off	on	off	on	off	on	off	on	off	on		
	STAND BY	off	on	off	on	off	on	off	on	off	on	off		
FILTER FEED PUMP	WORKING	off	on	off	on	off	on	off	on	off	on	off		
	STAND BY	on	off	on	off	on	off	on	off	on	off	on		
IRRIGATION WATER PUMP	WORKING	on	off	on	off	on	off	on	off	on	off	on		
	STAND BY	off	on	off	on	off	on	off	on	off	on	off		
UV SYSTEM & LAMP STATUS	W/NW	off	on	off	on	off	on	off	on	off	on	off		
	W/NW	on	off	on	off	on	off	on	off	on	off	on		
ULTRA FILTRATION WORKING TIME	WORKING	on	off	on	off	on	off	on	off	on	off	on		
	STAND BY	off	on	off	on	off	on	off	on	off	on	off		
FLUSH WATER LIFTING PUMP	WORKING	off	on	off	on	off	on	off	on	off	on	off		
	STAND BY	on	off	on	off	on	off	on	off	on	off	on		
FILTER PRESS FEED PUMP	WORKING	off	on	off	on	off	on	off	on	off	on	off		
	STAND BY	on	off	on	off	on	off	on	off	on	off	on		
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK		
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓		
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK		
	DIFFERENCE	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%		
MBBR TANK SLUDGE% (MLSS)	PRESENT	2300	2300	2300	2300	2300	2300	2300	2300	2300	2300	2300		
	DIFFERENCE	419	419	419	419	419	419	419	419	419	419	419		
DRY SLUDGE GENERATED (KG)	PRESENT	—	—	—	—	—	—	—	—	—	—	—		
	DIFFERENCE	—	—	—	—	—	—	—	—	—	—	—		

SITE FOR: TDI Samipat

Maint. Manager
335

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR TDI Panipat

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY

SHIFT: A/B/C

DATE: 15/05/25

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO:2										
AIR BLOWER	NO:1	on	off	on	off	on	off	on	off		
	NO:2										
SEWAGE TRANSFER PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	on	off	on	off	on	off	on	off		
	STAND BY										
FILTER FEED PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	on	off	on	off	on	off	on	off		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	off	on	off	on	off	on	off	on		
	W/NW										
ULTRA FILTRATION WORKING TIME	WORKING	on	off	on	off	on	off	on	off		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	off	on	off	on	off	on	off	on		
	STAND BY										
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO:2										
AIR BLOWER PRESSURE (PSI)	NO:1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO:2										
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓		
ACFMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
		24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%		
DRY SLUDGE GENERATED (KG)											

SHIFT: A B C

PH 7.5 7.5 8.5

CHLORINE

TDS

BIOCULTURE

JEGGERY

CHLORINE

INLET FLOW METER READING

PRESENT

PERVIOUS

DIFFERENCE

ELECTRICITY CONSUMED PER DAY

PRESENT KWH

PREVIOUS KWH

DIFFERENCE

TOTAL TREATED WATER

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING

PRESENT 2347

PERVIOUS 2300

DIFFERENCE 47

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

[Signature]

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY.....

DATE: 16.11.17
SHIFT: A/B/C

SITE FOR: TDI Panipat

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OP	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/N/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	W/N/W										
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER PRESSURE (PS)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
		24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MLS/L)											
DRY SLUDGE GENERATED (KG)											

SHIFT A B C
HARDNESS 7.5 7.5 8.5
PH 5.0 5.0 5.0
CHLORINE 5.00 5.00 5.00
TDS
CHEMICAL CONSUMED
A B C
BIOCULTURE 5 LTR
JEGGERY 5 LTR
CHLORINE

INLET FLOW METER READING
PRESENT PERVIOUS DIFFERENCE
ELECTRICITY CONSUMED PER DAY
PRESENT KWH PERVIOUS KWH DIFFERENCE
TOTAL TREATED WATER
49 KLD

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING
PRESENT PERVIOUS DIFFERENCE
2396 2347 49

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maintn

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 17/4/25
SHIFT: A/B/C

STP CAPACITY.....

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR			
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00				
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	7.5	7.5	8.0
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK			
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON			
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON			
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED		
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	A	B	C
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	5 LTR		
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR		
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ALL OK		
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON			
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING		
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT	PERVIOUS	DIFFERENCE
UV SYSTEM & LAMP STATUS	W/N/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY		
	W/N/W	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT KWH	PREVIOUS KWH	DIFFERENCE
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER		
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	47 KLD		
FILTER PRESS FEED PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-		
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK			
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	OUTLET FLOW METER READING		
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	PRESENT	PERVIOUS	DIFFERENCE
AIR BLOWER PRESSURE (PSI)	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	2443		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	2396		
ACFM/G BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	24%		
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓	24%		
COLOR	OK	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%		
	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MLSS)													
DRY SLUDGE GENERATED (KG)													

Sign: Of Shift Incharge

A Shift

B Shift

C Shift

Maint Manager

[Signature]

SITE FOR TDI Panipat

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: *TDI Farmat* BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: *19/1/25*
SHIFT: A/B/C

STP CAPACITY

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B		C
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2													
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	7.5	8.0	
	NO: 2													
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ON	CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	5 LTR			
	STAND BY										5 LTR			ALL OK
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ON				
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ON	ELECTRICITY CONSUMED PER DAY			
	W/W										PRESENT KWH			
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PREVIOUS KWH			
	STAND BY										DIFFERENCE			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ON	TOTAL TREATED WATER			
	STAND BY													
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO: 2													
AIR BLOWER PRESSURE (PSI)	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	OUTLET FLOW METER READING			
	NO: 2										PRESENT	PERVIOUS	DIFFERENCE	
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	2540	2493	47	
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF													
COLOR	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2													
MBBR TANK SLUDGE% (MLSS)	NO: 1	24%	24%	24%	24%	24%	24%	24%	24%	24%				
	NO: 2													
DRY SLUDGE GENERATED (KG)	NO: 1	—	—	—	—	—	—	—	—	—				
	NO: 2													

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY.....

DATE: 20.4.20
SHIFT: A/B/C

SITE FOR: TDI Pampit

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OP
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.0	
	NO : 2									500 ml	500 ml		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR			
	STAND BY									5 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	DIFFERENCE		
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	W/W									PRESENT KWH			
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH			
	STAND BY									DIFFERENCE			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY									46 KLD			
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	DIFFERENCE		
	OFF									2-586	2-540	46	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%				
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-				

Sign. Of Shift Incharge _____ A Shift
 _____ B Shift
 _____ C Shift
 Maint. Manager _____ 38

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

SHIFT : A/B/C

DATE : 26.4.25

SITE FOR : TDI - PANDPAT

PARTICULARS	STATUS	TIME								SHIFT	TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		A	B	C		
BAR SCREEN CLEANING	NO : 1 NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	7.5 500 ml	7.5 500 ml	8.0	
AIR BLOWER	NO : 1 NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
SEWAGE TRANSFER PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	A	B	C	
FILTER FEED PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	10 LTR			ALL OK
IRRIGATION WATER PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	10 LTR			
LUV SYSTEM & LAMP STATUS	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
ULTRA FILTRATION WORKING TIME	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PERVIOUS	DIFFERENCE		
FLUSH WATER LIFTING PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY			
FILTER PRESS FEED PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT	PREVIOUS	DIFFERENCE	
OIL LEVEL IN BLOWER	NO : 1 NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	TOTAL TREATED WATER			
AIR BLOWER PRESSURE (PSI)	NO : 1 NO : 2	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
AIR DIFFUSER FUNCTIONING	AT : 1 AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING			
ACF/INGF BACKWASH	ON OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	PRESENT	PERVIOUS	DIFFERENCE	
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	2635	2586	49	
MBBR TANK SLUDGE% (MLSS)		22%	22%	22%	22%	22%	22%	22%	22%	22%	22%				
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	-	-				

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Main Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 23.02.25
SHIFT: A/B/C

STP CAPACITY

SITE FOR: TDI. Panzi Pat

PARTICULARS	STATUS	07:00 - 04:00								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	-	-	-
	NO:2	OK	OK	OK	OK	OK	OK	OK	OK	pH	7.5	7.5	8.0
AIR BLOWER	NO:1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHLORINE	500 mg/l	500 mg/l	-
	NO:2	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TDS	-	-	-
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	SHIFT	A	B	C
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	BIOCULTURE	10 LTR	-	-
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	JEGGERY	10 LTR	-	-
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE	-	-	-
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ALL OK			
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WINW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	WINW	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	115 KLD			
FILTER PRESS FEED PUMP	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO:2	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0				
AIR BLOWER PRESSURE (PSI)	NO:1	✓	✓	✓	✓	✓	✓	✓	✓				
	NO:2	✓	✓	✓	✓	✓	✓	✓	✓				
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	OK	OK	OK	OK	OK	OK	OK	OK				
COLOR	MBBR TANK SLUDGE% (MLSS)	22%	22%	22%	22%	22%	22%	22%	22%	PRESENT	PERVIOUS	DIFFERENCE	
	DRY SLUDGE GENERATED (KG)	-	-	-	-	-	-	-	-	2725	2680	115	

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 24/02/2023
SHIFT: A/B/C
REMARKS BY OPT

SITE FOR: TDI RAJFAT

STP CAPACITY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPT	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	DN	OFF	DN	OFF	DN	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	W/NW										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2										
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	DK	DK	DK	DK	DK	DK	DK	DK		
COLOR	NO : 1	22%	22%	22%	22%	22%	22%	22%	22%		
	NO : 2										
MBBR TANK SLUDGE% (MISS)	NO : 1	22%	22%	22%	22%	22%	22%	22%	22%		
	NO : 2										
DRY SLUDGE GENERATED (KG)	NO : 1										
	NO : 2										

345

42

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: T.P.I. PANIPAT

STP CAPACITY:

DATE: 25.1.22
SHIFT: A/B/C

REMARKS BY OPERATOR:

PARTICULARS	STATUS	OPERATIONAL STATUS								TREATED WATER PARAMETERS			REMARKS BY OPERATOR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	7.5	7.5	8.0	
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	500	500		
	NO : 2	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	CHEMICAL CONSUMED			
SLUDGE RECIRCULATION PUMP	STAND BY									A	B	C	
	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	5LTR			
FILTER FEED PUMP	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	5LTR			
	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	INLET FLOW METER READING			
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN	PRESENT	PREVIOUS	DIFFERENCE	
	W/NW									ELECTRICITY CONSUMED PER DAY			
ULTRA FILTRATION WORKING TIME	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	TOTAL TREATED WATER			
FLUSH WATER LIFTING PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING			
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PREVIOUS	DIFFERENCE	
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	2865	2815	50	
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO : 2									OUTLET FLOW METER READING			
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	PRESENT	PREVIOUS	DIFFERENCE	
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	2865	2815	50	
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
COLOR	OFF	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING			
		24%	24%	24%	24%	24%	24%	24%	24%	PRESENT	PREVIOUS	DIFFERENCE	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	REMARKS BY MAINTENANCE MANAGER IF ANY:-			

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

44

347

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 27/4/25
SHIFT: A/B/C

SITE FOR: T.S.T. Sauripat

STP CAPACITY

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO:2												
AIR BLOWER	NO:1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		7.5	8.0	
	NO:2												
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		5 LTR		
	STAND BY										5 LTR		
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY												
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	WIN/W												
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY												
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO:2												
AIR BLOWER PRESSURE (PSI)	NO:1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO:2												
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	OK	OK	OK	OK	OK	OK	OK	OK				
COLOR	PRESENT	24%	24%	24%	24%	24%	24%	24%	24%				
	DIFFERENCE												
MBBR TANK SLUDGE% (MLSS)	PRESENT	2912	2865	2865	2865	2865	2865	2865	2865				
	DIFFERENCE												
DRY SLUDGE GENERATED (KG)	PRESENT												
	DIFFERENCE												

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

[Signature]

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 28.11.21
SHIFT: A/B/C

REMARKS BY OP

STP CAPACITY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OP	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK		
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO : 2	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
UV SYSTEM & LAMP STATUS	WINW	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	WINW	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK		
	STAND BY	OK	OK	OK	OK	OK	OK	OK	OK		
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO : 2	✓	✓	✓	✓	✓	✓	✓	✓		
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	OK	OK	OK	OK	OK	OK	OK	OK		
COLOR	NO : 1	24%	24%	24%	24%	24%	24%	24%	24%		
	NO : 2	24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MLSS)	NO : 1	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5		
	NO : 2	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5		
DRY SLUDGE GENERATED (KG)	NO : 1	2912	2912	2912	2912	2912	2912	2912	2912		
	NO : 2	2912	2912	2912	2912	2912	2912	2912	2912		

CHEMICAL CONSUMED		
A	B	C
5 LTR	5 LTR	
5 LTR		

INLET FLOW METER READING	
PRESENT	DIFFERENCE

ELECTRICITY CONSUMED PER DAY	
PRESENT KWH	DIFFERENCE

TOTAL TREATED WATER	
PRESENT	DIFFERENCE

OUTLET FLOW METER READING	
PRESENT	DIFFERENCE
2955	2912

REMARKS BY MAINTENANCE MANAGER IF ANY:-	

REMARKS BY MAINTENANCE MANAGER IF ANY:-	

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Man

46

349

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 29.4.25
SHIFT: A/B/C

STP CAPACITY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	DK	DK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5 500 (000)	8.5
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED	
	STAND BY									A	B
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR	
	STAND BY									5 LTR	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING	
	STAND BY									PRESENT	DIFFERENCE
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY	
	WIN/W									PRESENT KWH	DIFFERENCE
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH	
	STAND BY									DIFFERENCE	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER	
	STAND BY									45 KLD	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-	
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	OUTLET FLOW METER READING	
	NO : 2									PRESENT	DIFFERENCE
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	3000	45
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	2955	
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
		24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%		
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-		

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

RANZ PAT

SITE FOR: TPI

STP CAPACITY:

DATE: 26/03
SHIFT: A/B/C

REMARKS BY: DP

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	W/NW										
ULTRA FILTRATION WORKING TIME	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	OK	OK	OK	OK	OK	OK	OK	OK		
COLOR	NO : 1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1		
	NO : 2										
MBBR TANK SLUDGE% (MLSS)	NO : 1										
	NO : 2										
DRY SLUDGE GENERATED (KG)	NO : 1										
	NO : 2										

TREATED WATER PARAMETERS		
A	B	C
SHIFT		
HARDNESS		
pH	7.5	8.0
CHLORINE		
TDS		

CHEMICAL CONSUMED		
A	B	C
SHIFT		
BIOCULTURE	5 LTR	
JEGGERY	5 LTR	
CHLORINE		

INLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

ELECTRICITY CONSUMED PER DAY		
PRESENT KWH	PREVIOUS KWH	DIFFERENCE

TOTAL TREATED WATER		
		46 KLD

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE
3046	3000	46

Sign. Of Shift Incharge A Shift B Shift C Shift

Main. Man. 48

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY

SITE FOR: T.D.2

Sund Sat

DATE: 15.05
SHIFT: A/B/C

PARTICULARS	STATUS	07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	TREATED WATER PARAMETERS			REMARKS BY OPTR
										SHIFT	A	B	
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	7.5	7.5	8.0
	NO:2									PH	5.0	5.0	5.0
AIR BLOWER	NO:1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHLORINE	500 ml	500 ml	500 ml
	NO:2									TDS			
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			ALL OK
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	BIOCULTURE	5 LTR		
	STAND BY									JEGGERY	5 LTR		
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE			
	STAND BY									INLET FLOW METER READING			
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT			
	STAND BY									PERVIOUS			
UV SYSTEM & LAMP STATUS	W/R/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	W/R/W									PRESENT KWH			
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH			
	STAND BY									DIFFERENCE			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY												
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO:2												
AIR BLOWER PRESSURE (PSI)	NO:1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	OUTLET FLOW METER READING			
	NO:2									PRESENT	PERVIOUS	DIFFERENCE	
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓	3092	3016	76	
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR	NO:1	2.4%	2.4%	2.4%	2.4%	2.4%	2.4%	2.4%	2.4%				
	NO:2												
MBBR TANK SLUDGE% (MLSS)	NO:1	2.4%	2.4%	2.4%	2.4%	2.4%	2.4%	2.4%	2.4%				
	NO:2												
DRY SLUDGE GENERATED (KG)	NO:1												
	NO:2												

Maint Manager

C Shift

B Shift

A Shift

Sign. Of Shift Inchange

49

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: J.D.I. PANIPAT BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 23.5.15 SHIFT: A/B/C REMARKS BY OPR

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	W/NW										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR BLOWER PRESSURE (FSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2										
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR	PRESENT	DK	DK	DK	DK	DK	DK	DK	DK		
	DIFFERENCE	24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MISS)	PRESENT	3140	3140	3140	3140	3140	3140	3140	3140		
	DIFFERENCE	48	48	48	48	48	48	48	48		
DRY SLUDGE GENERATED (KG)	PRESENT										
	DIFFERENCE										

353

Sign. Of Shift Incharge A Shift B Shift C Shift Maint. 50

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 2.5.25
SHIFT: A/B/C

T.D.F. PANIPAT

STP CAPACITY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO:2										
AIR BLOWER	NO:1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO:2										
SEWAGE TRANSFER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER FEED PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/W	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	W/W										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	NO:1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO:2										
OIL LEVEL IN BLOWER	NO:1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO:2										
AIR BLOWER PRESSURE (PSI)	AT:1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓		
AIR DIFFUSER FUNCTIONING	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
ACFIMGF BACKWASH	NO:1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO:2	24%	24%	24%	24%	24%	24%	24%	24%		
COLOR	PRESENT										
	DIFFERENCE										
MBBR TANK SLUDGE% (MLSS)	PRESENT	3185	3185	3185	3185	3185	3185	3185	3185		
	DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PERVIOUS	3140	3140	3140	3140	3140	3140	3140	3140		
	DIFFERENCE	45	45	45	45	45	45	45	45		

ALL OK

REMARKS BY MAINTENANCE MANAGER IF ANY:-

45 KLD

OUTLET FLOW METER READING

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

51

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: TPI SANIPAT BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 4.5.22 SHIFT: A/B/C REMARKS BY OP

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OP	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO:1 NO:2	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK		
AIR BLOWER	NO:1 NO:2	ON ON	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
SEWAGE TRANSFER PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	ON ON	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
FILTER FEED PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
IRRIGATION WATER PUMP	WORKING STAND BY	ON ON	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
UV SYSTEM & LAMP STATUS	W/W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
ULTRA FILTRATION WORKING TIME	W/W/W	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
FLUSH WATER LIFTING PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
FILTER PRESS FEED PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF		
OIL LEVEL IN BLOWER	NO:1 NO:2	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK		
AIR BLOWER PRESSURE (PSI)	NO:1 NO:2	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0		
AIR DIFFUSER FUNCTIONING	AT:1 AT:2	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓		
ACF/MGF BACKWASH	ON OFF	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓		
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%		
DRY SLUDGE GENERATED (KG)											

CHEMICAL CONSUMED		
SHIFT	A	B
BIOCULTURE	5 LTR	
JEGGERY	5 LTR	
CHLORINE		

INLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

ELECTRICITY CONSUMED PER DAY		
PRESENT KWH	PREVIOUS KWH	DIFFERENCE

TOTAL TREATED WATER		
PRESENT	PERVIOUS	DIFFERENCE

OUTLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

REMARKS BY MAINTENANCE MANAGER IF ANY:-		

REMARKS BY MAINTENANCE MANAGER IF ANY:-		

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE : 5.5.25
SHIFT : A/B/C

SITE FOR : TDI SAN: PA7

STP CAPACITY

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	8.0	8.0	8.5	
	NO : 2										500 mg/l	500 mg/l		
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	NO : 2													
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	5 LTR			All OK
	STAND BY										5 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	STAND BY										PERVIOUS	DIFFERENCE		
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY			
	WIN/W										PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			45 KLD
	STAND BY													
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY													
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING			
	OFF										PRESENT	PERVIOUS	DIFFERENCE	
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	OK				
		24%	24%	24%	24%	24%	24%	24%	24%	24%	3273	3228	45	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	24%				
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	-				

Maint Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 6/5/23
SHIFT: A/B/C
REMARKS BY: O

SITE FOR: TDI RANJ SA

STP CAPACITY: _____

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY: O
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2									
AIR BLOWER	NO : 1	DN	OFF	ON	OFF	DN	OFF	DN	OFF	
	NO : 2									
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY									
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY									
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY									
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY									
UV SYSTEM & LAMP STATUS	WIN/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	WIN/W									
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY									
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY									
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2									
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	NO : 2									
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF									
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	
		24%	24%	24%	24%	24%	24%	24%	24%	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	

CHEMICAL CONSUMED		
SHIFT	A	B
BIOCULTURE	5 LTR	
JEGGERY	5 LTR	
CHLORINE		

INLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

ELECTRICITY CONSUMED PER DAY		
PRESENT KWH	PREVIOUS KWH	DIFFERENCE

TOTAL TREATED WATER		
PRESENT	PERVIOUS	DIFFERENCE
47	625	

OUTLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE
3320	3273	47

REMARKS BY MAINTENANCE MANAGER IF ANY:-

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. 59

DATE: 7.5.25
SHIFT: AB/C

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY

SITE FOR: THE SANITARY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
AIR BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
SEWAGE TRANSFER PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
SLUDGE RECIRCULATION PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
FILTER FEED PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
IRRIGATION WATER PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
UV SYSTEM & LAMP STATUS	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
ULTRA FILTRATION WORKING TIME	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
FLUSH WATER LIFTING PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
FILTER PRESS FEED PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	
AIR DIFFUSER FUNCTIONING	ON	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF	OK	OK	OK	OK	OK	OK	OK	OK	
	ACFM/GF BACKWASH	25/25	25/25	25/25	25/25	25/25	25/25	25/25	25/25	
	COLOR	25/25	25/25	25/25	25/25	25/25	25/25	25/25	25/25	
MBBR TANK SLUDGE% (MLSS)	NO : 1	3370	3370	3370	3370	3370	3370	3370	3370	
	NO : 2	3370	3370	3370	3370	3370	3370	3370	3370	
	DIFFERENCE	50	50	50	50	50	50	50	50	
	PERVIOUS DIFFERENCE	50	50	50	50	50	50	50	50	
DRY SLUDGE GENERATED (KG)	NO : 1	50	50	50	50	50	50	50	50	
	NO : 2	50	50	50	50	50	50	50	50	
	DIFFERENCE	50	50	50	50	50	50	50	50	
	PERVIOUS DIFFERENCE	50	50	50	50	50	50	50	50	

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

DATE: 9.5.25
SHIFT: A/B/C

STP CAPACITY

SITE FOR

PARTICULARS	STATUS	TIME								SHIFT	TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	8.0	8.5	
	NO : 2										500 m ³			
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	SLTR			
	STAND BY										JEGGERY			ALL OK
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHLORINE			
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY			
	WIN/W										PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY													42 KLD
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY													
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
ACFM/GF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF													
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PERVIOUS	DIFFERENCE	
		25%	25%	25%	25%	25%	25%	25%	25%	25%	3457	3015	442	
MBBR TANK SLUDGE% (MLSS)														
DRY SLUDGE GENERATED (KG)														

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 15.5
SHIFT: ABIC
REMARKS BY 0

STP CAPACITY: _____

SITE FOR: DDI SANDPAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS							
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF
	NO : 2	OFF	ON	OFF	ON	OFF	ON	OFF	ON
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON
UV SYSTEM & LAMP STATUS	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON
	W/NW	ON	OFF	ON	OFF	ON	OFF	ON	OFF
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF
FILTER PRESS FEED PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK
OIL LEVEL IN BLOWER	NO : 1	Y-0	Y-0	Y-0	Y-0	Y-0	Y-0	Y-0	Y-0
	NO : 2	Y-0	Y-0	Y-0	Y-0	Y-0	Y-0	Y-0	Y-0
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓
	NO : 2	✓	✓	✓	✓	✓	✓	✓	✓
AIR DIFFUSER FUNCTIONING	ON	✓	✓	✓	✓	✓	✓	✓	✓
	OFF	OK	OK	OK	OK	OK	OK	OK	OK
ACF/MGF BACKWASH	NO : 1	25%	25%	25%	25%	25%	25%	25%	25%
	NO : 2	25%	25%	25%	25%	25%	25%	25%	25%
COLOR	PRESENT	3500							
	DIFFERENCE								43
MBBR TANK SLUDGE% (MLSS)	PERVIOUS								
	DIFFERENCE								
DRY SLUDGE GENERATED (KG)	PERVIOUS								
	DIFFERENCE								

SHIFT: A B C
HARDNESS: 7.5 8.0 8.5
PH: _____
CHLORINE: _____
TDS: _____

CHEMICAL CONSUMED
SHIFT: A B C
BIO CULTURE: 5 LTR
JEGGERY: 5 LTR
CHLORINE: _____

INLET FLOW METER READING
PERVIOUS: _____
DIFFERENCE: _____

ELECTRICITY CONSUMED PER DAY
PRESENT KWH: _____
PREVIOUS KWH: _____
DIFFERENCE: _____

TOTAL TREATED WATER
13 KLD

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING
PERVIOUS: 3450
DIFFERENCE: 43

PERVIOUS: 3500

PERVIOUS: 3450

PERVIOUS: 3500

PERVIOUS: 3450

PERVIOUS: 3500

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TST BANGALAT

STP CAPACITY

DATE: 17.05.25
SHIFT: A/B/C

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO:2										
AIR BLOWER	NO:1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO:2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/N/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	W/N/W										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK		
	STAND BY										
OIL LEVEL IN BLOWER	NO:1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO:2										
AIR BLOWER PRESSURE (PSI)	NO:1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO:2										
AIR DIFFUSER FUNCTIONING	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
ACF/MGF BACKWASH	ON	OK	OK	OK	OK	OK	OK	OK	OK		
	OFF										
COLOR	PRESENT	250	250	250	250	250	250	250	250		
	DIFFERENCE										
MBER TANK SLUDGE% (MLSS)	PRESENT	3547	3547	3547	3547	3547	3547	3547	3547		
	DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PRESENT										
	DIFFERENCE										

INLET FLOW METER READING

PREVIOUS DIFFERENCE

DIFFERENCE

ELECTRICITY CONSUMED PER DAY

PREVIOUS KWH

DIFFERENCE

TOTAL TREATED WATER

47 x 22

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING

PREVIOUS

DIFFERENCE

3500

47

ALL OK

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 12/5
SHIFT: A/B/C
REMARKS BY:

STP CAPACITY.....
TREATED WATER PARAMETERS

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C		
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	7.5	8.0	7.5	OK
	NO: 2	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
AIR BLOWER	NO: 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				OK
	NO: 2	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				OK
	STAND BY	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				OK
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				OK
	STAND BY	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				OK
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				OK
	W/NW	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
ULTRA FILTRATION WORKING TIME	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				OK
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
FLUSH WATER LIFTING PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF				OK
	STAND BY	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK	OK				OK
	STAND BY	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
OIL LEVEL IN BLOWER	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				OK
	NO: 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
AIR BLOWER PRESSURE (PSI)	NO: 1	✓	✓	✓	✓	✓	✓	✓	✓	✓				OK
	NO: 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓	✓				OK
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓				OK
	OFF	OK	OK	OK	OK	OK	OK	OK	OK	OK				
COLOR	NO: 1	25f.	25f.	25f.	25f.	25f.	25f.	25f.	25f.	25f.				OK
	NO: 2	25f.	25f.	25f.	25f.	25f.	25f.	25f.	25f.	25f.				
MBBR TANK SLUDGE% (M-SS)	NO: 1	35.91	35.91	35.91	35.91	35.91	35.91	35.91	35.91	35.91				OK
	NO: 2	35.91	35.91	35.91	35.91	35.91	35.91	35.91	35.91	35.91				
DRY SLUDGE GENERATED(KG)	NO: 1	50	50	50	50	50	50	50	50	50				OK
	NO: 2	50	50	50	50	50	50	50	50	50				

CHEMICAL CONSUMED

INLET FLOW METER READING

ELECTRICITY CONSUMED PER DAY

TOTAL TREATED WATER

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

PREVIOUS DIFFERENCE

PRESENT DIFFERENCE

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. M

60

363

DATE: 13.5.25

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SHIFT : A/B/C

STP CAPACITY

REMARKS BY OPTR

SITE FOR: T.P.J. PANJAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/NW	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	W/NW										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO : 2										
AIR DIFFUSER FUNCTIONING	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
ACT/IMGF BACKWASH	NO : 1	25%	25%	25%	25%	25%	25%	25%	25%		
	NO : 2										
COLOR	NO : 1	3640	3640	3640	3640	3640	3640	3640	3640		
	NO : 2										
MBBR TANK SLUDGE% (MLSS)	NO : 1	3597	3597	3597	3597	3597	3597	3597	3597		
	NO : 2										
DRY SLUDGE GENERATED (KG)	NO : 1	413	413	413	413	413	413	413	413		
	NO : 2										

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 11/15
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: T.D.P. PANIPAT

STP CAPACITY:

REMARKS B

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	
BAR SCREEN CLEANING	NO:1 NO:2	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	
AIR BLOWER	NO:1 NO:2	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
SEWAGE TRANSFER PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
FILTER FEED PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
IRRIGATION WATER PUMP	WORKING STAND BY	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
UV SYSTEM & LAMP STATUS	W/N/W W/N/W	ON ON	ON ON	ON ON	ON ON	ON ON	ON ON	ON ON	ON ON	
ULTRA FILTRATION WORKING TIME	WORKING STAND BY	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
FLUSH WATER LIFTING PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
FILTER PRESS FEED PUMP	WORKING STAND BY	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
OIL LEVEL IN BLOWER	NO:1 NO:2	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	
AIR BLOWER PRESSURE (PSI)	NO:1 NO:2	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	
AIR DIFFUSER FUNCTIONING	AT:1 AT:2	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	
ACFM/GF BACKWASH	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	

CHEMICAL CONSUMED		
A	B	C
5 LTR	7.5	8.0
5 LTR		

INLET FLOW METER READING	
PRESENT	DIFFERENCE

ELECTRICITY CONSUMED PER DAY	
PRESENT KWH	DIFFERENCE

TOTAL TREATED WATER	
PRESENT	DIFFERENCE
45 KLD	

REMARKS BY MAINTENANCE MANAGER IF ANY:-	

OUTLET FLOW METER READING	
PRESENT	DIFFERENCE
3685	45

Sign. Of Shift Incharge A Shift B Shift C Shift

Maint. 62

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 15.5.25
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TFE SANDPAT

PARTICULARS	STATUS	STP CAPACITY								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO: 1 NO: 2	OK	OK	OK	OK	OK	OK	OK	OK		
AIR BLOWER	NO: 1 NO: 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
SEWAGE TRANSFER PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
FILTER FEED PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
IRRIGATION WATER PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
UV SYSTEM & LAMP STATUS	W/WN W/WN	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
ULTRA FILTRATION WORKING TIME	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
FLUSH WATER LIFTING PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
FILTER PRESS FEED PUMP	WORKING STAND BY	OK	OK	OK	OK	OK	OK	OK	OK		
OIL LEVEL IN BLOWER	NO: 1 NO: 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
AIR BLOWER PRESSURE (PSI)	NO: 1 NO: 2	✓	✓	✓	✓	✓	✓	✓	✓		
AIR DIFFUSER FUNCTIONING	ON OFF	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/MGF BACKWASH	ON OFF	OK	OK	OK	OK	OK	OK	OK	OK		
COLOR		25%	25%	25%	25%	25%	25%	25%	25%		
MBBR TANK SLUDGE% (MLSS)											
DRY SLUDGE GENERATED (KG)											

TREATED WATER PARAMETERS		
A	B	C
7.5	7.5	8.0
500 ml	500 ml	

CHEMICAL CONSUMED		
A	B	C
5 LTR		
5 LTR		

INLET FLOW METER READING	
PERVIOUS	DIFFERENCE

ELECTRICITY CONSUMED PER DAY		
PRESENT KWH	PREVIOUS KWH	DIFFERENCE

TOTAL TREATED WATER	
PERVIOUS	DIFFERENCE
48	RSD

REMARKS BY MAINTENANCE MANAGER IF ANY:-		

OUTLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE
3733	3685	48

A Shift
B Shift
C Shift
Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: T.D.I. PANIPAT BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 16.5.25 STP CAPACITY: _____
SHIFT: A/B/C

PARTICULARS	STATUS	OPERATIONAL STATUS								TREATED WATER PARAMETERS			REMARKS BY OPTR		
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C			
BAR SCREEN CLEANING	NO : 1 NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK			
AIR BLOWER	NO : 1 NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	7.5	8.0
SEWAGE TRANSFER PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED		
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	A	B	C
FILTER FEED PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ALL OK		
IRRIGATION WATER PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING		
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PERVIOUS	DIFFERENCE	
ULTRA FILTRATION WORKING TIME	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY		
FLUSH WATER LIFTING PUMP	WORKING STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT KWH	PREVIOUS KWH	DIFFERENCE
FILTER PRESS FEED PUMP	WORKING STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	TOTAL TREATED WATER		
OIL LEVEL IN BLOWER	NO : 1 NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	45 KLD		
AIR BLOWER PRESSURE (PSI)	NO : 1 NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-		
AIR DIFFUSER FUNCTIONING	AT : 1 AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓			
ACFMGF BACKWASH	ON OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓			
COLOR		DK	DK	DK	DK	DK	DK	DK	DK	DK	DK	DK	OUTLET FLOW METER READING		
MBBR TANK SLUDGE% (MLSS)		23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	PRESENT	PERVIOUS	DIFFERENCE
DRY SLUDGE GENERATED (KG)													3778	3733	45

Sign. Of Shift Incharge A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 17.5.5
SHIFT: A/B/C

SITE FOR: TDI PAMI PAT. BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002 STP CAPACITY: REMARKS BY OPTR

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF		7.5	7.5	8.0
	NO : 2										500 mg/l	500 mg/l	
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		5 LTR		
	STAND BY												
	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		5 LTR		
FILTER FEED PUMP	STAND BY												
	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
IRRIGATION WATER PUMP	STAND BY												
	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	W/NW												
ULTRA FILTRATION WORKING TIME	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
FLUSH WATER LIFTING PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
FILTER PRESS FEED PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACFM/GF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	✓	✓	✓	✓	✓	✓	✓	✓				
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK				
	DIFFERENCE	23%	23%	23%	23%	23%	23%	23%	23%				
MBBR TANK SLUDGE% (MLSS)	PRESENT	23%	23%	23%	23%	23%	23%	23%	23%				
	DIFFERENCE												
DRY SLUDGE GENERATED (KG)	PRESENT												
	DIFFERENCE												

368

Sign. Of Shift Incharge A Shift B Shift C Shift Maint. Manager 65

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 12.02.25
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TDI SANDPAT

STP CAPACITY

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS				REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C			
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK			
	NO : 2														
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	7.5	8.0
	NO : 2														
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF			
	STAND BY														
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN			
	STAND BY														
	CHLORINE														
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF			
	STAND BY														
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON			
	STAND BY														
UV SYSTEM & LAMP STATUS	WINW	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF			
	WINW														
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON			
	STAND BY														
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF			
	STAND BY														
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK			
	NO : 2														
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0			
	NO : 2														
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓			
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓			
ACF/INGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓			
	OFF														
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK			
		23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%			
MBBR TANK SLUDGE% (MLSS)															
		23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%			
DRY SLUDGE GENERATED (KG)															

369

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint/Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 14.5.20
SHIFT: A/B/C

STP CAPACITY

SITE FOR TDI Paripat

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS				REMARKS BY OPERATOR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK					
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK					
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.0		
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	500	500			
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED				
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	A	B	C		
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR				
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	5 LTR				
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF					
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING				
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PERVIOUS	DIFFERENCE			
UV SYSTEM & LAMP STATUS	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY				
	W/NW	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT KWH	PREVIOUS KWH	DIFFERENCE		
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF					
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF					
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	TOTAL TREATED WATER				
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	48	KLD			
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY.				
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0					
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓					
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓					
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓					
	OFF	✓	✓	✓	✓	✓	✓	✓	✓					
COLOR	ON	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING				
	OFF	OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PREVIOUS	DIFFERENCE		
MBBR TANK SLUDGE% (MLSS)	ON	23%	23%	23%	23%	23%	23%	23%	23%	3700	3670	30		
	OFF	23%	23%	23%	23%	23%	23%	23%	23%					
DRY SLUDGE GENERATED (KG)	ON	-	-	-	-	-	-	-	-					
	OFF	-	-	-	-	-	-	-	-					

Sign. Of Shift Incharge _____ A Shift _____ B Shift _____ C Shift _____

Maintn Manager _____

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TDI Farmipat

DATE: 20.5.25
SHIFT: A/B/C

PARTICULARS	STATUS	STP CAPACITY								TREATED WATER PARAMETERS				REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK					
	NO : 2													
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.0		
	NO : 2													
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
STAND BY														
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR				
	STAND BY									5 LTR				ALL OK
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF					
STAND BY														
UV SYSTEM & LAMP STATUS	W/W													
ULTRA FILTRATION WORKING TIME	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF					
	STAND BY													
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
	STAND BY													
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK					
	NO : 2													
AIR BLOWER PRESSURE (PSI)	NO : 1	9.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0					
	NO : 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓					
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓					
ACFMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓					
	OFF	✓	✓	✓	✓	✓	✓	✓	✓					
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK					
	DIFFERENCE	23%	23%	23%	23%	23%	23%	23%	23%	3965	3920	45		
MBBR TANK SLUDGE% (MLSS)														
DRY SLUDGE GENERATED (KG)	PRESENT	—	—	—	—	—	—	—	—					
	DIFFERENCE													

Sign. Of Shift Incharge A Shift B Shift C Shift Main Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 21.5
SHIFT: A/B/C
REMARKS BY

SITE FOR: TDI Panipat

STP CAPACITY: A B C

PARTICULARS	STATUS	TREATED WATER PARAMETERS								SHIFT	HARDNESS	PH	CHLORINE	TDS	CHEMICAL CONSUMED			INLET FLOW METER READING		ELECTRICITY CONSUMED PER DAY		REMARKS BY MAINTENANCE MANAGER IF ANY:-							
		NO: 1	NO: 2	NO: 1	NO: 2	NO: 1	NO: 2	NO: 1	NO: 2						NO: 1	NO: 2	NO: 1	NO: 2	NO: 1	NO: 2	NO: 1		NO: 2	NO: 1	NO: 2				
BAR SCREEN CLEANING	NO: 1 NO: 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	7.5	7.5	5.00	5.00	8.0										
AIR BLOWER	NO: 1 NO: 2	on	off	on	off	on	off	on	off	on	off	on	off	on															
SEWAGE TRANSFER PUMP	WORKING STAND BY	off	on	off	on	off	on	off	on	off	on	off	on	off															
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	on	off	on	off	on	off	on	off	on	off	on	off	on															
FILTER FEED PUMP	WORKING STAND BY	off	on	off	on	off	on	off	on	off	on	off	on	off															
IRRIGATION WATER PUMP	WORKING STAND BY	on	off	on	off	on	off	on	off	on	off	on	off	on															
UV SYSTEM & LAMP STATUS	W/NW W/NW	off	on	off	on	off	on	off	on	off	on	off	on	off															
ULTRA FILTRATION WORKING TIME	WORKING STAND BY	on	off	on	off	on	off	on	off	on	off	on	off	on															
FLUSH WATER LIFTING PUMP	WORKING STAND BY	off	on	off	on	off	on	off	on	off	on	off	on	off															
FILTER PRESS FEED PUMP	WORKING STAND BY	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK															
OIL LEVEL IN BLOWER	NO: 1 NO: 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK															
AIR BLOWER PRESSURE (Pit)	NO: 1 NO: 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0															
AIR DIFFUSER FUNCTIONING	AT: 1 AT: 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓															
ACF/MGF BACKWASH	ON OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓															
COLOR	ON OFF	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK															
MBBR TANK SLUDGE% (MLSS)		23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%	23%															
DRY SLUDGE GENERATED (KG)		—	—	—	—	—	—	—	—	—	—	—	—	—															

Sign. Of Shift Incharge A Shift B Shift C Shift

Maint. 69

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE : 22-5-2025
SHIFT : A/B/C

SITE FOR: TDI Pumping

PARTICULARS	STATUS	STP CAPACITY								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO : 1 NO : 2	OK	OK	OK	OK	OK	OK	OK	OK				
AIR BLOWER	NO : 1 NO : 2	on	off	on	off	on	off	on	off	7.5	7.5	8.5	
SEWAGE TRANSFER PUMP	WORKING STAND BY	off	on	off	on	off	on	off	on	CHEMICAL CONSUMED			
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	on	off	on	off	on	off	on	off	5 LTR			
FILTER FEED PUMP	WORKING STAND BY	off	on	off	on	off	on	off	on	5 LTR			ALL OK
IRRIGATION WATER PUMP	WORKING STAND BY	on	off	on	off	on	off	on	off	INLET FLOW METER READING			
UV SYSTEM & LAMP STATUS	WIN/W	off	on	off	on	off	on	off	on	PRESENT	PERVIOUS	DIFFERENCE	
ULTRAFILTRATION WORKING TIME	WIN/W	off	on	off	on	off	on	off	on	ELECTRICITY CONSUMED PER DAY			
FLUSH WATER LIFTING PUMP	WORKING STAND BY	on	off	on	off	on	off	on	off	PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FILTER PRESS FEED PUMP	WORKING STAND BY	off	on	off	on	off	on	off	on	TOTAL TREATED WATER			
OIL LEVEL IN BLOWER	NO : 1 NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	47 KLD			
AIR BLOWER PRESSURE (PSI)	NO : 1 NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
AIR DIFFUSER FUNCTIONING	AT : 1 AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACFIMGF BACKWASH	ON OFF	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING			
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PERVIOUS	DIFFERENCE	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	4061	6014	197	
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-				

Sign. Of Shift Inchange A Shift B Shift C Shift Maint. Manager

70

373

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY.....

DATE: 23/5
SHIFT: A/B/C

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OP
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.5	
	NO : 2									500	500		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR			
	STAND BY									5 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	W/NW									ELECTRICITY CONSUMED PER DAY			
	W/NW									PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY									TOTAL TREATED WATER			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PERVIOUS	DIFFERENCE	
		24%	24%	24%	24%	24%	24%	24%	24%	400	400	40	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%				
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-				

374

Maint. No. 19

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE : 24.5.25
SHIFT : A/B/C

SITE FOR: TDI Panipat

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5 7.5 8.2
	NO : 2	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
UV SYSTEM & LAMP STATUS	WINW	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	WINW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	
ACT/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	
COLOR	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	24%	24%	24%	24%	24%	24%	24%	24%	
MBBR TANK SLUDGE% (MLSS)	NO : 1	24%	24%	24%	24%	24%	24%	24%	24%	
	NO : 2	—	—	—	—	—	—	—	—	
DRY SLUDGE GENERATED (KG)	NO : 1	—	—	—	—	—	—	—	—	
	NO : 2	—	—	—	—	—	—	—	—	

375

ALL OK

47 KLD

Maint Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

DATE: 26.5.15
SHIFT: A/B/C

SITE FOR TDI Limited

PARTICULARS	STATUS	TIME								SHIFT	TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	7.5	7.5	8.0	
	NO : 2													
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	5 LTR			
	STAND BY										5 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY													ALL OK
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING			
	STAND BY										PRESENT	DIFFERENCE		
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ELECTRICITY CONSUMED PER DAY			
	WIN/W										PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY													
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY													
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓				
COLOR	OK	24%	24%	24%	24%	24%	24%	24%	24%	24%	PRESENT	DIFFERENCE		
	MBBR TANK SLUDGE% (MLSS)										42.54	4200	177	
DRY SLUDGE GENERATED (KG)														

Maint./Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: TDJ Sanitary

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY:

DATE: 27.5
SHIFT: A/B/C

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPERATOR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	WINW	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	WINW										
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER PRESSURE (PS)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACFM/GF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK		
	DIFFERENCE										
MBBR TANK SLUDGE% (MLSI)	PRESENT	24%	24%	24%	24%	24%	24%	24%	24%		
	DIFFERENCE										
DRY SLUDGE GENERATED (K5)	PRESENT										
	DIFFERENCE										

CHEMICAL CONSUMED		
SHIFT	A	B
BIO CULTURE	5 LTR	
JEGGERY	5 LTR	
CHLORINE		

INLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

ELECTRICITY CONSUMED PER DAY		
PRESENT KWH	PREVIOUS KWH	DIFFERENCE

TOTAL TREATED WATER		
PRESENT	PERVIOUS	DIFFERENCE

OUTLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

REMARKS BY MAINTENANCE MANAGER IF ANY..		

REMARKS BY OPERATOR		

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 28.5.2015
SHIFT: A/B/C

SITE FOR: TDI - PANIPAT

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.0	
	NO : 2									500	500		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	10 LTR			
	STAND BY									10 LTR			ALL OK
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	W/W									PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	TOTAL TREATED WATER			
	STAND BY									419 KLD			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY									PRESENT	PERVIOUS	DIFFERENCE	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING			
	NO : 2									PRESENT	PERVIOUS	DIFFERENCE	
AIR BLOWER PRESSURE (PSI)	NO : 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	4349			
	NO : 2									1300			
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	22%			
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	22%			
AC/INGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	22%			
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	22%			
COLOR	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	22%			
	NO : 2									22%			
MBBR TANK SLUDGE% (MLSS)	NO : 1	22%	22%	22%	22%	22%	22%	22%	22%	22%			
	NO : 2									22%			
DRY SLUDGE GENERATED (KG)	NO : 1	-	-	-	-	-	-	-	-	-			
	NO : 2									-			

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 27.5.
SHIFT: A/B/C

SITE FOR: T.D.I. P.A.P.T. STP CAPACITY: TREATED WATER PARAMETERS

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OP
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO:2												
AIR BLOWER	NO:1	ON	OFF	DN	OFF	DN	OFF	DN	OFF	7.5	7.5	8.0	
	NO:2									500 ml	500 ml		
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	10 LTR			
	STAND BY									10 LTR			
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	DIFFERENCE		
UV SYSTEM & LAMP STATUS	W/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	ELECTRICITY CONSUMED PER DAY			
	W/W									PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	TOTAL TREATED WATER			
	STAND BY									15	15		
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY												
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING			
	NO:2									PRESENT	DIFFERENCE		
AIR BLOWER PRESSURE (PH)	NO:1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	4394	1249	15	
	NO:2												
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR	NO:1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO:2												
MBBR TANK SLUDGE% (MLSS)	NO:1	22%	22%	22%	22%	22%	22%	22%	22%				
	NO:2												
DRY SLUDGE GENERATED (KG)	NO:1	-	-	-	-	-	-	-	-				
	NO:2												

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Man 77

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 30.5.20
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TDI SANAIPAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	OK	
	NO:2										
AIR BLOWER	NO:1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	NO:2	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY										
UV SYSTEM & LAMP STATUS	W/N/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	W/N/W										
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
	STAND BY										
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	OK	
	NO:2										
AIR BLOWER PRESSURE (PSI)	NO:1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	
	NO:2										
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓	✓	
ACFMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF										
COLOR	PREVIOUS										
	DIFFERENCE										
MBBR TANK SLUDGE% (MLSS)	PREVIOUS	22%	22%	22%	22%	22%	22%	22%	22%	22%	
	DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PREVIOUS										
	DIFFERENCE										

STP CAPACITY: A B C
HARDNESS: - - -
PH: 7.5 7.5 8.0
CHLORINE: 500 500 500
TDS: - - -
CHEMICAL CONSUMED: A B C
BIOCULTURE: 10 LTR - -
JEGGERY: 10 LTR - -
CHLORINE: - - -

INLET FLOW METER READING: PREVIOUS DIFFERENCE
ELECTRICITY CONSUMED PER DAY: PRESENT KWH, PREVIOUS KWH, DIFFERENCE
TOTAL TREATED WATER: 45 x 25

REMARKS BY MAINTENANCE MANAGER IF ANY:-
OUTLET FLOW METER READING: PREVIOUS DIFFERENCE
11439 11394 115

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 21.5
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: TDI PAVIPAT

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2												
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5	8.0	
	NO: 2									500 ml	500 ml		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED			
	STAND BY									A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	10 LTR			
	STAND BY									10 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	WIN/W									PRESENT KWH	PREVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	TOTAL TREATED WATER			
	STAND BY												
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY												
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2												
AIR BLOWER PRESSURE (PSI)	NO: 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0				
	NO: 2												
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/NGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	OK	OK	OK	OK	OK	OK	OK	OK				
COLOR										OUTLET FLOW METER READING			
										PRESENT	PERVIOUS	DIFFERENCE	
MBBR TANK SLUDGE% (MLSS)			22%	22%	22%	22%	22%	22%	22%				
DRY SLUDGE GENERATED (KG)													

381

Sign. Of Shift Incharge: A Shift B Shift C Shift

Maint. No.

79

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 1.8.25
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: T.D. PANJAT

STP CAPACITY

PARTICULARS	STATUS	07:00 - 04:00								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK				
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF		7.5	7.5	8.0
	NO : 2	DN	OFF	DN	OFF	DN	OFF	DN	OFF		500 ml	500 ml	
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
UV SYSTEM & LAMP STATUS	W/INW	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	W/INW												
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0				
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR		OK	OK	OK	OK	OK	OK	OK	OK				
		22%	22%	22%	22%	22%	22%	22%	22%				
MBBR TANK SLUDGE% (MLSS)		22%	22%	22%	22%	22%	22%	22%	22%				
DRY SLUDGE GENERATED (KG)													

CHEMICAL CONSUMED

INLET FLOW METER READING

ELECTRICITY CONSUMED PER DAY

TOTAL TREATED WATER

REMARKS BY MAINTENANCE MANAGER IF ANY:-

PERVIOUS DIFFERENCE

PRESENT DIFFERENCE

PERVIOUS DIFFERENCE

PERVIOUS DIFFERENCE

PERVIOUS DIFFERENCE

10 LTR

10 LTR

11 KLD

4529

4488

ALL OK

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: J.P.T. PARIAPAT BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 2-6-20
SHIFT: A/B/C

PARTICULARS	STATUS	07:00 - 09:00							09:00 - 12:00							12:00 - 16:00							16:00 - 20:00							20:00 - 22:00							22:00 - 01:00							01:00 - 04:00							TREATED WATER PARAMETERS			REMARKS BY OPT
		NO: 1	NO: 2	NO: 1	NO: 2	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	WORKING	STAND BY	A	B	C																		
BAR SCREEN CLEANING		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK																								
AIR BLOWER		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		7.5	7.5	8.0																				
SEWAGE TRANSFER PUMP		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON																										
SLUDGE RECIRCULATION PUMP		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		SLTR																								
FILTER FEED PUMP		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		SLTR																								
IRRIGATION WATER PUMP		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF																										
UV SYSTEM & LAMP STATUS		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON																										
ULTRA FILTRATION WORKING TIME		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF																										
FLUSH WATER LIFTING PUMP		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON																										
FILTER PRESS FEED PUMP		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF																										
OIL LEVEL IN BLOWER		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK																										
AIR BLOWER PRESSURE (PSI)		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0		4.0																										
AIR DIFFUSER FUNCTIONING		✓		✓		✓		✓		✓		✓		✓		✓		✓		✓		✓		✓		✓		✓																										
ACF/MGF BACKWASH		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF		ON		OFF																										
COLOR		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK		OK																										
MBBR TANK SLUDGE% (MLSS)		24%		24%		24%		24%		24%		24%		24%		24%		24%		24%		24%		24%		24%		24%																										
DRY SLUDGE GENERATED (MG)		-		-		-		-		-		-		-		-		-		-		-		-		-		-																										
TOTAL TREATED WATER		50 KLD																																																				
ELECTRICITY CONSUMED PER DAY		PRESENT KWH: 4579, PREVIOUS KWH: 4529, DIFFERENCE: 50																																																				
REMARKS BY MAINTENANCE MANAGER IF ANY:-																																																						
OUTLET FLOW METER READING		PRESENT: 4579, PVIOUS: 4529, DIFFERENCE: 50																																																				

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: T.D.I. RAVIDIPAT BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 3-6-25 STP CAPACITY: _____
SHIFT: A/B/C

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PH	7.5	7.5	8.0
	NO : 2									CHLORINE			
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TDS			
	STAND BY									CHEMICAL CONSUMED			
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	SHIFT	A	B	C
	STAND BY									BIO CULTURE	5 LTR		
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	JEGGERY	5 LTR		
	STAND BY									CHLORINE			
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY									PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	WIN/W									PRESENT KWH			
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH			
	STAND BY									DIFFERENCE			
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER			
	STAND BY												
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	117 KLD			
	NO : 2												
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACFM/GF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR	ON	OK	OK	OK	OK	OK	OK	OK	OK	OUTLET FLOW METER READING			
	OFF									PRESENT	PERVIOUS	DIFFERENCE	
MBBR TANK SLUDGE% (MLSS)	ON	247	247	247	247	247	247	247	247	4626	4579	47	
	OFF												
DRY SLUDGE GENERATED (KG)	ON	-	-	-	-	-	-	-	-				
	OFF												

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE : 5.6.25
SHIFT : A/B/C

STP CAPACITY

SITE FOR

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	DK	DK	DK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO : 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	W/W										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2										
ACF/MGF BACKWASH	ON	OK	OK	OK	OK	OK	OK	OK	OK		
	OFF										
COLOR	PRESENT	24%	24%	24%	24%	24%	24%	24%	24%		
	DIFFERENCE										
MBBR TANK SLUDGE% (MLSS)	PRESENT	47/14	46/9	46/9	46/9	46/9	46/9	46/9	46/9		
	DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PRESENT										
	DIFFERENCE										

CHEMICAL CONSUMED
A B C
5 LTR 5 LTR
ALL OK

INLET FLOW METER READING
PERVIOUS DIFFERENCE

ELECTRICITY CONSUMED PER DAY
PRESENT KWH PREVIOUS KWH DIFFERENCE
4.5 KLD

REMARKS BY MAINTENANCE MANAGER IF ANY:-

OUTLET FLOW METER READING
PERVIOUS DIFFERENCE
46/9 4.5

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

24

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 6.6.25
SHIFT: A/B/C

SITE FOR: T.J. PANT PAT

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OP
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2												
AIR BLOWER	NO: 1	ON	OFF	DN	OFF	DN	OFF	DN	OFF		7.5	7.5	8.0
	NO: 2												
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF		5 LTR		
	STAND BY										5 LTR		
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
UV SYSTEM & LAMP STATUS	W/NW	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	W/NW												
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF				
	STAND BY												
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO: 2												
AIR BLOWER PRESSURE (PSI)	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO: 2												
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	OK	OK	OK	OK	OK	OK	OK	OK				
COLOR	MBBR TANK SLUDGE% (MLSS)	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	147.60	47.14	46	
	DRY SLUDGE GENERATED (KG)	-	-	-	-	-	-	-	-				

387

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

85

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

DATE: 7.6.25
SHIFT: A/B/C

SITE FOR: T.D.2 PAVI SAT

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	7.5	7.5	8.0
	NO : 2	DN	DN	DN	DN	DN	DN	DN	DN	PH	5.0	5.0	5.0
AIR BLOWER	NO : 1	DN	DN	DN	DN	DN	DN	DN	DN	CHLORINE	500 mg/l	500 mg/l	500 mg/l
	NO : 2	DN	DN	DN	DN	DN	DN	DN	DN	TDS			
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	CHEMICAL CONSUMED			
	STAND BY	DN	DN	DN	DN	DN	DN	DN	DN	A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	DN	OFF	DN	OFF	DN	BIOCULTURE	5 LTR		
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	JEGGERY	5 LTR		
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	CHLORINE			
	STAND BY	DN	DN	DN	DN	DN	DN	DN	DN	INLET FLOW METER READING			
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	DN	OFF	DN	OFF	DN	PRESENT			
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	PERVIOUS			
UV SYSTEM & LAMP STATUS	W/W/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DIFFERENCE			
	W/W/W	DN	DN	DN	DN	DN	DN	DN	DN	ELECTRICITY CONSUMED PER DAY			
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	DN	OFF	DN	OFF	DN	PRESENT KWH			
	STAND BY	OFF	DN	OFF	DN	OFF	DN	OFF	DN	PREVIOUS KWH			
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DIFFERENCE			
	STAND BY	DN	DN	DN	DN	DN	DN	DN	DN	TOTAL TREATED WATER			
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		116	116	
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓				
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓				
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF	DN	DN	DN	DN	DN	DN	DN	DN				
COLOR		DN	DN	DN	DN	DN	DN	DN	DN	OUTLET FLOW METER READING			
		24%	24%	24%	24%	24%	24%	24%	24%	PRESENT	PERVIOUS	DIFFERENCE	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	4826	4710	116		
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-					

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 5.6.23
SHIFT: A/B/C

SITE FOR: TDI. PANIPAT

STP CAPACITY: _____

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY O			
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00				
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	SHIFT	A	B	C
	NO: 2	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	7.5	7.5	8.0
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PH			
	NO: 2	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE			
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TDS			
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	SHIFT	A	B	C
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	BIOCULTURE	S LTR		
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	JEGGERY	S LTR		
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE			
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING			
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT			
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY			
	WIN/W	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT KWH			
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH			
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	DIFFERENCE			
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK	TOTAL TREATED WATER			
	STAND BY	OK	OK	OK	OK	OK	OK	OK	OK		48	KLD	
OIL LEVEL IN BLOWER	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	NO: 2	✓	✓	✓	✓	✓	✓	✓	✓				
AIR BLOWER PRESSURE (PSI)	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING			
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓	PRESENT	4854	4806	48
ACF/IMGF BACKWASH	ON	DK	DK	DK	DK	DK	DK	DK	DK	PREVIOUS			
	OFF	24%	24%	24%	24%	24%	24%	24%	24%	DIFFERENCE			
COLOR													
MBBR TANK SLUDGE% (MLSS)													
DRY SLUDGE GENERATED (KG)													

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

DATE: 7.6.25

SHIFT: A/B/C

T.D.F. RAJESH

SITE FOR

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO: 2										
	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	NO: 2										
SEWAGE TRANSFER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER FEED PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
UV SYSTEM & LAMP STATUS	WIN/W	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	WIN/W										
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO: 2										
AIR BLOWER PRESSURE (PSI)	NO: 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO: 2										
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACFM/GF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	✓	✓	✓	✓	✓	✓	✓	✓		
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
		24%	24%	24%	24%	24%	24%	24%	24%		
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%		
DRY SLUDGE GENERATED (KG)											

TREATED WATER PARAMETERS		
SHIFT	A	B
HARDNESS		
pH	7.5	7.5
CHLORINE	500 ml	500 ml
TDS		8.5

CHEMICAL CONSUMED		
SHIFT	A	B
BIOCULTURE	5 LTR	
JEGGERY	5 LTR	
CHLORINE		

INLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE

ELECTRICITY CONSUMED PER DAY		
PRESENT KWH	PREVIOUS KWH	DIFFERENCE

TOTAL TREATED WATER		

OUTLET FLOW METER READING		
PRESENT	PERVIOUS	DIFFERENCE
4899	4854	45

REMARKS BY MAINTENANCE MANAGER IF ANY:-

45 KLD

ALL OK

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 10/11/18
SHIFT: A/B/C
REMARKS BY: DP

SITE FOR: TTI PARI PAT

STP CAPACITY: A B C

PARTICULARS	STATUS	TREATED WATER PARAMETERS								SHIFT	HARDNESS	PH	CHLORINE	TDS
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00					
BAR SCREEN CLEANING	NO: 1 NO: 2	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	7.5	7.5	8.0		
AIR BLOWER	NO: 1 NO: 2	ON OFF	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON					
SEWAGE TRANSFER PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	CHEMICAL CONSUMED				
SLUDGE RECIRCULATION PUMP	WORKING STAND BY	ON OFF	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	A	B	C		
FILTER FEED PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	5 LTR	5 LTR			
IRRIGATION WATER PUMP	WORKING STAND BY	ON OFF	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	INLET FLOW METER READING				
UV SYSTEM & LAMP STATUS	WIN/W	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	PRESENT	PERVIOUS	DIFFERENCE		
ULTRA FILTRATION WORKING TIME	WIN/W	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ELECTRICITY CONSUMED PER DAY				
FLUSH WATER LIFTING PUMP	WORKING STAND BY	ON OFF	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	OFF ON	PRESENT KWH	PREVIOUS KWH	DIFFERENCE		
FILTER PRESS FEED PUMP	WORKING STAND BY	OFF ON	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	ON OFF	TOTAL TREATED WATER				
OIL LEVEL IN BLOWER	NO: 1 NO: 2	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	OK OK	132 KLD				
AIR BLOWER PRESSURE (PSI)	NO: 1 NO: 2	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	4.0 4.0	REMARKS BY MAINTENANCE MANAGER IF ANY.				
AIR DIFFUSER FUNCTIONING	AT: 1 AT: 2	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓					
ACF/IMG BACKWASH	ON OFF	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓					
COLOR		OK	OK	OK	OK	OK	OK	OK	OK	PRESENT	PERVIOUS	DIFFERENCE		
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	4942	16009			
DRY SLUDGE GENERATED (KG)														

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 11/11/20
SHIFT: A/B/C
REMARKS BY: DP

SITE FOR: TIP PANIPAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								SHIFT	HARDNESS	PH	CHLORINE	TDS
		07:00	09:00	12:00	15:00	20:00	22:00	01:00	04:00					
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	8.0
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	NO : 2	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY													
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY													
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY													
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY													
UV SYSTEM & LAMP STATUS	WIN/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	WIN/W													
ULTRA FILTRATION WORKING TIME	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY													
FLUSH WATER LIFTING PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY													
FILTER PRESS FEED PUMP	WORKING	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
	STAND BY													
OIL LEVEL IN BLOWER	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	NO : 2													
AIR BLOWER PRESSURE (PSI)	NO : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	NO : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	
AIR DIFFUSER FUNCTIONING	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF													
ACF/IMGF BACKWASH	ON	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
	OFF													
COLOR	MBBR TANK SLUDGE% (MLSS)	24%	27%	27%	27%	27%	27%	27%	27%	27%	27%	27%	27%	
	DRY SLUDGE GENERATED (KG)													

CHEMICAL CONSUMED

SHIFT	A	B	C
BIO CULTURE	5 LTR		
JEGGERY	5 LTR		
CHLORINE			

INLET FLOW METER READING

PRESENT		DIFFERENCE

ELECTRICITY CONSUMED PER DAY

PRESENT KWH	
PREVIOUS KWH	
DIFFERENCE	43 KLD

TOTAL TREATED WATER

43 KLD

REMARKS BY MAINTENANCE MANAGER IF ANY:

OUTLET FLOW METER READING

PRESENT	4940	DIFFERENCE
PREVIOUS	4509	

Sign Of Shift Incharge: _____ A Shift

Sign Of Shift Incharge: _____ B Shift

Sign Of Shift Incharge: _____ C Shift

Main: Manoj 89

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES

Sector 95 Greater Faridabad 121002

STP CAPACITY

SHIFT : A/B/C

DATE : 11.6.25

SITE FOR : TDI SAN: PA7

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B		C
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2													
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	8.0	8.0	8.5	
	NO : 2										500	500		
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		CHEMICAL CONSUMED			
	STAND BY										A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	5 LTR			
	STAND BY										5 LTR			
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON					
	STAND BY													
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		INLET FLOW METER READING			
	STAND BY										PRESENT	PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		ELECTRICITY CONSUMED PER DAY			
	W/W										PRESENT KWH	PERVIOUS KWH	DIFFERENCE	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		TOTAL TREATED WATER			
	STAND BY										15	0	15	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		REMARKS BY MAINTENANCE MANAGER IF ANY:-			
	STAND BY													
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK					
	NO : 2													
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0					
	NO : 2													
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓					
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓					
AC/FMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓					
	OFF													
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK		PRESENT	PERVIOUS	DIFFERENCE	
	OFF										4987	4942	45	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%					
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-					

Sign. Of Shift Inchange

A Shift

B Shift

C Shift

Maind Manager

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

STP CAPACITY.....

DATE : 19.6
SHIFT : ABC

REMARKS BY

SITE FOR : TDE PAPER PAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2									
AIR BLOWER	NO : 1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	NO : 2									
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY									
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY									
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY									
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY									
UV SYSTEM & LAMP STATUS	WINW	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	WINW									
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	
	STAND BY									
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY									
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	
	NO : 2									
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	NO : 2									
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF	OK	OK	OK	OK	OK	OK	OK	OK	
COLOR	PRESENT	25f	25f	25f	25f	25f	25f	25f	25f	
	DIFFERENCE	-	-	-	-	-	-	-	-	
MBBR TANK SLUDGE% (MISS)	PRESENT	5129	5129	5129	5129	5129	5129	5129	5129	
	DIFFERENCE	5054	5054	5054	5054	5054	5054	5054	5054	
DRY SLUDGE GENERATED (KG)	PRESENT	-	-	-	-	-	-	-	-	
	DIFFERENCE	-	-	-	-	-	-	-	-	

395

Maint. Man 92

Sign. Of Shift Incharge
A Shift
B Shift
C Shift

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 15/02/25
SHIFT: A/B/C

STP CAPACITY

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS				REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	SHIFT	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS	-	-	-	
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	pH	7.5	8.0	8.5	
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHLORINE	500 mg/l	500 mg/l	-	
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	TDS	-	-	-	
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED				
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	SHIFT	A	B	C	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	BIOCULTURE	5 LTR	-	-	ALL OK
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	JEGGERY	5 LTR	-	-	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE	-	-	-	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING				
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT	-	-	-	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PERVIOUS	-	-	-	
UV SYSTEM & LAMP STATUS	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY				
	W/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT KWH	-	-	-	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH	-	-	-	
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	DIFFERENCE	-	-	-	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	TOTAL TREATED WATER				
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	112 KLD				
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	REMARKS BY MAINTENANCE MANAGER IF ANY:-				
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK					
AIR BLOWER PRESSURE (PSI)	NO : 1	40	40	40	40	40	40	40	40	OUTLET FLOW METER READING				
	NO : 2	40	40	40	40	40	40	40	40	PRESENT	5171	5129	42	
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓					
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓					
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓					
	OFF	✓	✓	✓	✓	✓	✓	✓	✓					
COLOR	OK	OK	OK	OK	OK	OK	OK	OK	OK					
	25%	25%	25%	25%	25%	25%	25%	25%	25%					
MBBR TANK SLUDGE% (MLSS)	25%	25%	25%	25%	25%	25%	25%	25%	25%					
	-	-	-	-	-	-	-	-	-					
DRY SLUDGE GENERATED (KG)	-	-	-	-	-	-	-	-	-					
	-	-	-	-	-	-	-	-	-					

Maint. Manager

C Shift

B Shift

A Shift

Sign. Of Shift Incharge

SEWAGE TREATMENT PLANT DAILY LOG SHEET

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

DATE: 16.6.23
SHIFT: A/B/C

SITE FOR: TDI RANIPALAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPERATOR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO: 2										
AIR BLOWER	NO: 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	8.5
	NO: 2										
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHEMICAL CONSUMED	
	STAND BY									A	B
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	5 LTR	
	STAND BY									5 LTR	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	INLET FLOW METER READING	
	STAND BY									PERVIOUS	DIFFERENCE
UV SYSTEM & LAMP STATUS	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	ELECTRICITY CONSUMED PER DAY	
	W/NW										
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT KWH	
	STAND BY									PREVIOUS KWH	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	DIFFERENCE	
	STAND BY									TOTAL TREATED WATER	
OIL LEVEL IN BLOWER	NO: 1	OK	OK	OK	OK	OK	OK	OK	OK	43 KLD	
AIR BLOWER PRESSURE (PSI)	NO: 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-	
	NO: 1										
AIR DIFFUSER FUNCTIONING	AT: 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT: 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/IMGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF	OK	OK	OK	OK	OK	OK	OK	OK		
COLOR	PRESENT	25%	25%	25%	25%	25%	25%	25%	25%	OUTLET FLOW METER READING	
	PERVIOUS									5214	5171
MBBR TANK SLUDGE% (MLSS)										DIFFERENCE	
DRY SLUDGE GENERATED (KG)										43	

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR TS7 PANDHAR BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 17.6.20 SHIFT: A/B/C

STP CAPACITY

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPT	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	HARDNESS PH
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	CHLORINE TDS
	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHEMICAL CONSUMED
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	BIOCULTURE JEGGERY
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	CHLORINE
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	INLET FLOW METER READING
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
UV SYSTEM & LAMP STATUS	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PRESENT
	W/NW	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
ULTRA FILTRATION WORKING TIME	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	PRESENT KWH
	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
FLUSH WATER LIFTING PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	PREVIOUS KWH
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	DIFFERENCE
	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	TOTAL TREATED WATER
	NO : 2	OK	OK	OK	OK	OK	OK	OK	OK	OK	
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	REMARKS BY MAINTENANCE MANAGER IF ANY:-
	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	ELECTRICITY CONSUMED PER DAY
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	OUTLET FLOW METER READING
	OFF	✓	✓	✓	✓	✓	✓	✓	✓	✓	
COLOR	PRESENT	OK	OK	OK	OK	OK	OK	OK	OK	OK	DIFFERENCE
	DIFFERENCE	25%	25%	25%	25%	25%	25%	25%	25%	25%	
MBBR TANK SLUDGE% (MLSS)	PRESENT	25%	25%	25%	25%	25%	25%	25%	25%	25%	PERVIOUS
	DIFFERENCE	25%	25%	25%	25%	25%	25%	25%	25%	25%	
DRY SLUDGE GENERATED (KG)	PRESENT	-	-	-	-	-	-	-	-	-	DIFFERENCE
	DIFFERENCE	-	-	-	-	-	-	-	-	-	

ALL OK

398

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: 77J Panipat BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 13/6 SHIFT: A/B/C REMARKS BY:

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	DK	
	NO:2										
AIR BLOWER	NO:1	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	NO:2										
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DN	
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DN	
	STAND BY										
IRRIGATION WATER PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY										
UV SYSTEM & LAMP STATUS	WINW	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DN	
	WINW										
FLUSH WATER LIFTING PUMP	WORKING	DN	OFF	DN	OFF	DN	OFF	DN	OFF	DN	
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN	DN	
	STAND BY										
OIL LEVEL IN BLOWER	NO:1	OK	OK	OK	OK	OK	OK	OK	OK	OK	
	NO:2										
AIR BLOWER PRESSURE (PSI)	NO:1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	NO:2										
AIR DIFFUSER FUNCTIONING	AT:1	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	AT:2	✓	✓	✓	✓	✓	✓	✓	✓	✓	
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	OFF	OK	OK	OK	OK	OK	OK	OK	OK	OK	
COLOR	PRESENT	25f.	25f.	25f.	25f.	25f.	25f.	25f.	25f.	25f.	
	PERVIOUS DIFFERENCE										
MBBR TANK SLUDGE% (MLSS)	PRESENT	53.11	53.11	53.11	53.11	53.11	53.11	53.11	53.11	53.11	
	PERVIOUS DIFFERENCE										
DRY SLUDGE GENERATED (KG)	PRESENT										
	PERVIOUS DIFFERENCE										

SEWAGE TREATMENT PLANT DAILY LOG SHEET

DATE: 19.6.25
SHIFT: A/B/C

BIONEER TECHNOLOGIES
Sector 95 Greater Faridabad 121002

SITE FOR: T.D.J. PANJAPAT

PARTICULARS	STATUS	TREATED WATER PARAMETERS								REMARKS BY OPTR	
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00		
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF	7.5	7.5
	NO : 2									500 mg/l	500 mg/l
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	SLTR	SLTR
	STAND BY										
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	WIN/W										
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		
	STAND BY										
FILTER PRESS FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON		
	STAND BY										
OIL LEVEL IN BLOWER	NO : 1	ON	OK	OK	OK	OK	OK	OK	OK		
	NO : 2										
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0		
	NO : 2										
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		
	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓		
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓		
	OFF										
COLOR		OK	OK	OK	OK	OK	OK	OK	OK		
		25%	25%	25%	25%	25%	25%	25%	25%	5354	5311
MBBR TANK SLUDGE% (MLSS)											43
DRY SLUDGE GENERATED (KG)											

400

ALL OK

REMARKS BY MAINTENANCE MANAGER IF ANY:-

43 KGD

TOTAL TREATED WATER

OUTLET FLOW METER READING

Maint. Manager

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

67

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: T.D.T. PAVIPAT STP CAPACITY: _____ BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002
 DATE: _____ SHIFT: A/B/C REMARKS BY: _____

PARTICULARS	STATUS	TREATED WATER PARAMETERS								SHIFT	HARDNESS	PH	CHLORINE	TDS	CHEMICAL CONSUMED		SHIFT	BIODIGESTURE	JEGGERY	CHLORINE	INLET FLOW METER READING		ELECTRICITY CONSUMED PER DAY		TOTAL TREATED WATER	REMARKS BY MAINTENANCE MANAGER IF ANY:-	
		NO : 1	NO : 2	NO : 1	NO : 2	NO : 1	NO : 2	NO : 1	NO : 2						NO : 1	NO : 2					NO : 1	NO : 2	NO : 1	NO : 2			NO : 1
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
AIR BLOWER	NO : 2	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
SEWAGE TRANSFER PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
SLUDGE RECIRCULATION PUMP	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FILTER FEED PUMP	WORKING	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
IRRIGATION WATER PUMP	STAND BY	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
ULTRA FILTRATION WORKING TIME	WIN/W	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	
FILTER PRESS FEED PUMP	STAND BY	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	ON	OFF	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
AIR BLOWER PRESSURE (PSI)	NO : 2	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	
ACF/MGF BACKWASH	AT : 2	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	
COLOR	ON	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
OFF	OFF	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	OK	
MBBR TANK SLUDGE% (MLSS)		24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	24%	
DRY SLUDGE GENERATED (KG)		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	

Sign. Of Shift Incharge: _____ A Shift
 _____ B Shift
 _____ C Shift
 401
 98
 Maint. Man.

SEWAGE TREATMENT PLANT DAILY LOG SHEET

SITE FOR: TDF RAJAPAT BIONEER TECHNOLOGIES Sector 95 Greater Faridabad 121002

DATE: 21.6.25 STP CAPACITY: _____
SHIFT: A/B/C

PARTICULARS	STATUS	TIME								TREATED WATER PARAMETERS			REMARKS BY OPTR
		07:00	09:00	12:00	16:00	20:00	22:00	01:00	04:00	A	B	C	
BAR SCREEN CLEANING	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK				
	NO : 2												
AIR BLOWER	NO : 1	ON	OFF	ON	OFF	ON	OFF	ON	OFF		7.5	7.5	8.0
	NO : 2										500ml	500ml	
SEWAGE TRANSFER PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		CHEMICAL CONSUMED		
	STAND BY										A	B	C
SLUDGE RECIRCULATION PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		5 LTR		
	STAND BY										5 LTR		
FILTER FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN				
	STAND BY												ALL OK
IRRIGATION WATER PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF		INLET FLOW METER READING		
	STAND BY										PERVIOUS	DIFFERENCE	
UV SYSTEM & LAMP STATUS	WIN/W	OFF	DN	OFF	DN	OFF	DN	OFF	DN		ELECTRICITY CONSUMED PER DAY		
	WIN/W										PRESENT KWH	PREVIOUS KWH	DIFFERENCE
FLUSH WATER LIFTING PUMP	WORKING	ON	OFF	ON	OFF	ON	OFF	ON	OFF				
	STAND BY										DIFFERENCE		
FILTER PRESS FEED PUMP	WORKING	OFF	DN	OFF	DN	OFF	DN	OFF	DN		TOTAL TREATED WATER		
	STAND BY										PERVIOUS	DIFFERENCE	
OIL LEVEL IN BLOWER	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		REMARKS BY MAINTENANCE MANAGER IF ANY:-		
	NO : 2										418	215	
AIR BLOWER PRESSURE (PSI)	NO : 1	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0				
	NO : 2												
AIR DIFFUSER FUNCTIONING	AT : 1	✓	✓	✓	✓	✓	✓	✓	✓		OUTLET FLOW METER READING		
	AT : 1										PERVIOUS	DIFFERENCE	
ACF/MGF BACKWASH	ON	✓	✓	✓	✓	✓	✓	✓	✓				
	OFF												
COLOR	NO : 1	OK	OK	OK	OK	OK	OK	OK	OK		5447	5399	418
	NO : 2												
MBBR TANK SLUDGE% (MLSS)		25%	25%	25%	25%	25%	25%	25%	25%				
DRY SLUDGE GENERATED (KG)													

Sign. Of Shift Incharge

A Shift

B Shift

C Shift

Maint. Manager

To,
The R.O.,
Haryana State Pollution Control Board,
PANIPAT, Haryana.

Date: 30/07/2025 -

Subject: Request for Revocation of Closure Order & Issuance of Consent to Operate
Ref.: Your closure order vide letter no. HSPCB-080002/451/2021-COORDINATION CELL-HSPCB I/112270/2022 dated 9th May, 2022.

Respected Sir,

M/s. Taneja Developers & Infrastructure Ltd. (now, M/s. TDI Infratech Ltd.) are the project proponents for development and construction of residential plotted colony at Village Kabri, Faridpur, Sector 36, 37, 38 & 39, Panipat, Haryana. We wish to clarify our position in respect of the closure order dated 09.05.2022.

- Our Consent to Establish (CTE) expired on 25.09.2015. All construction activities and allied activities were completed before 10.02.2014. No construction and other allied activities were undertaken after its expiration.
- Environment Clearance was granted to us on 07.01.2008 and it was valid until 2015. We have applied for environment clearance for expansion on 28.10.2014.
- Our STP of 550 KLD was already installed during the construction phase side by side and it started operating since 2014 but there was no occupancy at the site. Only security and maintenance staff were available at the site till January 2022 and some people had started residing in the project area after January 2022 but their number was very less and sufficient effluent was not being generated in the colony and hence not available in the inlet collection tank of STP. The population in project area increased step by step and after January 2024, it reached about 800-1000 persons.
- Due to shortage of effluent, the STP had / has been facing difficulty in operating and burnt the motors again and again. During inspection on 12.04.2024, a sufficient effluent was not available in the inlet collection tank which created problems in the motors. The same was repaired on 22.04.2024 and the STP was fully functional after 22.04.2024.
- We have already installed flow meters and separate energy meters with the STP and also log book is being maintained (copy attached as Annexure - I). The joint committee has estimated effluent discharge on the basis of structures



TDI INFRA TECH LIMITED

Corporate Office : Mahindra Tower, 2A, Bhikaji Cama Place, Second Floor, New Delhi-110066
Tel. : +91-11-49133333 | Website : www.tdiinfratech.com
CIN : U99999DL1999PLC102277

available on the project site. However, the actual occupancy is much less and there is no sufficient effluent.

- Compliance with CTE conditions and EC conditions were duly submitted with MOEF from time to time along with six-monthly reports. Copy is attached as **Annexure II**.
- Part Completion Certificate of residential plotted colony having license no. 63-87 and 89-105 dated 11.02.2007 over an area admeasuring 221.446 in the revenue estate of village Kabri and Faridpur, Sector 39, District Panipat issued by the Directorate of Town & Country Planning, Haryana vide its Memo no. LC-805-JE (BR)-2014/3114 dated 10/02/2014 is attached as **Annexure III**.
- Observations raised by HSPCB during issuance of closure directions against the project:

Observation	Reply
CTE of the unit has been expired on 25/09/2015 and the unit has neither got the CTE extended nor submitted the compliance of conditions of CTE	Compliance of CTE conditions were time to time submitted to MOEF & HSPCB with six monthly compliance reports.
Unit has not submitted the copy of Environment Clearance (if any) obtained after 2013 and compliance thereof.	Copy of EC is attached as Annexure IV .
Unit has started the occupancy in the project but the unit has not obtained CTO prior to the start of occupancy by residents after completion / semi-completion of the project.	Due to non-availability of occupancy and discharge, we did not apply for CTO.
Unit has not installed STP as per the condition of CTE for treatment of domestic effluent generated from the period project and only civil structure has been setup for one STP while machinery part is yet to be installed.	STP of 550 KLD was installed during the construction phase and the same started operating in 2014. But due to shortage of effluent, it faced difficulty in operating and burnt the motors again and again. The STP was regularly operating and maintained and during inspection dated 12.04.2024 was not fully operational due to burnt motors and same was repaired on 22.04.2024, after that the STP is continuously maintained and

TDI INFRA TECH LIMITED

Corporate Office : Mahindra Tower, 2A, Bhikaji Cama Place, Second Floor, New Delhi-110066
 Tel. : +91-11-49133333 | Website : www.tdiinfra.tech.com
 CIN : U99999DL1999PLC102277

	operated. We have never discharged any untreated effluent from STP at any time; and when there was fault created in any component of STP – the effluent was collected in inlet collection tank of STP.
Unit has not submitted the present details of occupancy, copy of completion certificate details of actual water consumption, details of green belt development.	Presently, actual occupancy is between 800-1000 persons at the project site. Copy of completion certificate is attached. Actual water consumption is 70 KLD, green belt is developed.
Unit has not provided the name and addresses of the directors of the company.	Attached as Annexure V.


To facilitate the submission of our CTO application through the online mechanism, we have already deposited the applicable fees and performance security through online banking in Board's Punjab National Bank A/c. no. 4916000100007912 (receipts are attached as Annexure – VI).

Due to closure actions of the Board, our electric connection was disconnected by Uttar Haryana Bijli Vitran Nigam Ltd. (UHBVNL). Hence, the STP is operated with genset. It is requested that kindly necessary directions may be issued to UHBVNL to release the electric supply of STP connection immediately and further project electric supply can be released after issuance of revocation of closure order by HSPCB.

Further, it is requested that kindly reset the password so that we apply the CTO through online portal. Our authorized person name is Mrs Sunita, mobile no. is 9999508441 email ID is sunita.dhingra@tdiinfracorp.com.

It is also requested that kindly depute any officials / officers to inspect our site, collect the samples and processing our CTO application. We look forward to a favorable response and assure our continued cooperation in fulfilling all regulatory requirements.

Thanking you,
For M/s TDI Infratech Limited


Authorized Signatory
Date: 30th July 2025

TDI INFRATECH LIMITED

Corporate Office : Mahindra Tower, 2A, Bhikaji Cama Place, Second Floor, New Delhi-110066
Tel. : +91-11-49133333 | Website : www.tdiinfratech.com
CIN : U99999DL1999PLC102277

Tdi Infratech Ltd.

Head Office:-10, Shaheed Bhagat Singh Marg, New Delhi - 110001

Date: 16.06.2025

To,
The Manager,
Punjab & Sind Bank,
IFB, P-18/90,
1st Floor (Madras Hotel Building)
Connaught Place,
New Delhi- 110001

Sub: Request for transfer of funds through NEFT
Reg.: ODP Account No. 07171300010128
Purpose: SAMPLE TESTING FEES

Dear Sir,

Please find enclosed herewith a cheque no. 015502 dated 16.06.2025 for Rs.4,500/- (Rupees Four Thousand Five Hundred Only) favoring Yourself RTGS A/c for transfer of proceeds through RTGS to the following account & bank charges will deduct from our account.

HARYANA STATE POLLUTION CONTROL BOARD.
Current Account No. 4916000100007912

With
Punjab National Bank
Sector-6, Panchkula
RTGS Code No: PUNB0491600
Thanking you.

Yours faithfully,
For Tdi Infratech Ltd.

Ued Prakash




Director



पंजाब एण्ड सिंध बैंक
Punjab & Sind Bank
पंजाब एण्ड सिंध बैंक

Head Office: 10, Shaheed Bhagat Singh Marg, New Delhi - 110001
Corporate Branch, P-18/90 Connaught Place, New Delhi-110001
IFS Code: PSIB0000717



Pay Yourself NEFT A/c

या धारक को or Bearer

Pay Four Thousand Five Hundred Only
रुपये Rupees



जवा करे ₹ **4,500.00

आम अ. A/c. No. 07171300010128

For TDI INFRA TECH LIMITED

Ued Prakash

UTR-PSIBN25167187249

Authorised Signatory/ies
Please sign above

"PAYABLE AT PAR AT ALL CBS BRANCHES ONLY"

015502 1100230800 310128 30

407

104

Tdi Infratech Ltd.

Head Office:-10, Shaheed Bhagat Singh Marg, New Delhi - 110001

Date: 16.06.2025

To,
The Manager,
Punjab & Sind Bank,
IFB, P-18/90,
IInd Floor(Madras Hotel Building)
Connaught Place,
New Delhi- 110001

Sub: Request for transfer of funds through RTGS
Reg.: ODP Account No. 07171300010128
Purpose: CTO FEES

Dear Sir,

Please find enclosed herewith a cheque no. 015501 dated 16.06.2025 for Rs.1,05,000/- (Rupees One Lakh Five Thousand Only) favoring Yourself RTGS A/c for transfer of proceeds through RTGS to the following account & bank charges will deduct from our account.

HARYANA STATE POLLUTION CONTROL BOARD.

Current Account No. 4916000100007912

With
Punjab National Bank
Sector-6, Panchkula
RTGS Code No: PUNB0491600
Thanking you.

Yours faithfully,
For Tdi Infratech Ltd.


Ued Prakash

Director



पंजाब एण्ड सिंध बैंक
Punjab & Sind Bank
पंजाब एंड सिंध बैंक

कॉर्पोरेट शाखा, पी - 18/90, कानॉन प्लेस, न्यू दिल्ली - 110001
Corporate Branch, P-18/90 Connaught Place, NEW DELHI-110001
IFS Code : PSIB0000717



Pay Yourself RTGS A/c

One Lakh Five Thousand Only
रुपये Rupees

या धारक को or Bearer



अदा करे ₹ 1,05,000.00

आका. नं. / A/c. No. 07171300010128

For TDI INFRA TECH LIMITED

UTR-PSIBN25167177382

Ued Prakash

"PAYABLE AT PAR AT ALL CBS BRANCHES ONLY"

Authorised Signatory/ies
Please sign above

⑈015501⑈ 110023080⑈ 310128⑈ 30

Tdi Infratech Ltd.

Head Office:-10, Shaheed Bhagat Singh Marg, New Delhi - 110001

Date: 16.06.2025

To,
The Manager,
Punjab & Sind Bank,
IFB, P-18/90,
Hnd Floor(Mndras Hotel Building)
Connaught Place,
New Delhi- 110001

Sub: Request for transfer of funds through RTGS
Reg.: ODP Account No. 07171300010128
Purpose: PEFORMANCE SECURITY

Dear Sir,

Please find enclosed herewith a cheque no. 015503 dated 16.06.2025 for Rs.5,00,000/- (Rupees Five Lac Only) favoring Yourself RTGS A/c for transfer of proceeds through RTGS to the following account & bank charges will deduct from our account.

HARYANA STATE POLLUTION CONTROL BOARD.
Current Account No. 4916000100007912

With
Punjab National Bank
Sector-6, Panchkula
RTGS Code No: PUNB0491600
Thanking you,

Yours faithfully,
For Tdi Infratech Ltd.


Ued Prakash

Director



पंजाब एण्ड सिंध बैंक
Punjab & Sind Bank
पंजाब और सिंध बैंक
(एक सचिव के तहत) (A Bank of India Subsidiary)

कॉर्पोरेट शाखा, पी-18/90, कानूत प्लास, नई दिल्ली-110001
Corporate Branch, P-18/90 Connaught Place, NEW DELHI-110001
IFS Code : PSIB000717



Pay Yourself RTGS A/c

रुपये Rupees Five Lakh Only

या धारक को or Bearer



अदा करें ₹ 5,00,000.00

आका सं. A/c. No. 07171300010128

For TDI INFRATECH LIMITED

UTRN: PSIBR.25167186889

Ued Prakash

"केवल सभी सी.बी.एस. शाखाओं में उपयोग पर वैध"
"PAYABLE AT PAR AT ALL CBS BRANCHES ONLY"

Authorised Signatory/ies
Please sign above

015503 1100230801 310128 30

To.

The Member Secretary,
Haryana State Pollution Control Board,
Panchkula.

Sub:- Personal hearing regarding orders of imposing Environmental Compensation and closure orders.

Respected Sir,

Kindly refer to orders issued on 05/09/2024 on the subject noted above.

The brief facts regarding our plotted colony project located at Sector- 37 & 39, Panipat are given as under:-

1. Obtained Environmental Clearance on 7th January 2008 valid up to 2015 (Annexure-1).
2. The Director, Urban Local Bodies Department, Haryana vide letter endst no. 2173 dated 18.08.2011 (Annexure-2) had approved the building plans.
3. Obtained CTE from HSPCB and the same was valid up to 2015 (Annexure-3).
4. We had stopped all activities before 2015. RO, MOEF&CC inspected the site on 07/07/2017 (Annexure-4) and verified that there was no construction activity on the site.
5. Due to no activity on the site, the consent to operate was not applied to HSPCB.
6. The details regarding construction is given in table 1.

Table-1

S.No.	Details	Remarks
i.	Total Land	291.7765 acres
ii.	<ul style="list-style-type: none"> • Plotting done for plots • Occupancy in plots 	
iii.	<ul style="list-style-type: none"> • Sites earmarked for commercial purpose • Shops • School 	
iv.	STP installed (Capacity)	550 KLD
v.	Waste water generation (domestic)	487.62 KLD
	Waste water generation from commercial activities	29.88 KLD



Total waste water generation 517.50

7. HSPCB had issued orders regarding imposing Environmental Clearance amounting to Rs. 5,47,50,000/- (Rupees Five Crore Forty Seven Lakh Fifty Thousand only) on 05/09/2024.
8. The show cause notices issued were delivered to our project site and we had not received any notice due to closure of our site and without giving an opportunity of hearing in the interest of natural justice, Environmental Compensation was imposed on us amounting to Rs. 5,47,50,000/- (Rupees Five Crore Forty Seven Lakh Fifty Thousand only) on 05/09/2024.
9. Presently, only 10% occupancy is at the site and the remaining plots/flats/floors/EWS units are vacant, accordingly, the project proponent is facing problem to fill up the collection tank of Sewage Treatment Plant (STP) which is the main cause of non operation of STP and due to 10% occupancy, the STP of higher capacity could not be installed.
10. The project proponent had obtained CTE from the board and the same was valid up to 2015 and after that not submitted application for consent to operate to HSPCB. We had stopped all the activities before 2015.
11. Obtained part completion certificate of residential plotted colony having license no. 63-87 and 89-105 dated 11.02.2007 (**Annexure-4**) over an area measuring 221.446 acres in the revenue estate of village Kabri and Faridpur, Sector-39, District Panipat.
12. Project Proponent had developed the plotted colony before 2014 and also constructed __NIL__ number of flats/floors, 1791 number of plots and 448 number of EWS plots before 2014/15.
13. Installed Sewage Treatment Plant side by side during development of the project and the same was completed before 2014.
14. Submitted application for extension on 28/10/2014 well within the validity period of environment clearance and the SIAA had granted EC valid upto 15/09/2019 (**Annexure-5**).

In view of submissions made above, it is requested to afford an opportunity of personal hearing regarding imposing environmental compensation, so that we may

explain our submissions to your goodself and thereafter, closure orders issued may be suspended as we are facing lots of financial and mental harassment due to closure of our project please.

Thanking you,



Copy to Regional Officer, Haryana State Pollution Control Board, Panipat Region with reference to letter no. HSPCB/PR/2024/1787 dated 12/11/2024 and with a request to forward the above submissions to head office for affording an opportunity to us at the earliest please.



S AND R ENVIROLAB LLP

NABL Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TC-11483

TEST REPORT

Page : 1 of 2

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

ULR No. : TC11483250000813F
Test Report No. : SREL/E/16062025002
Sample I.D. : SREL/WW/16062025002
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

(1) SAMPLE PARTICULARS

- (a) Name of the Sample : Waste Water
(b) Sample Description : Sewage water After treatment
(c) Sample Quantity : 1 + 2 Litre
(d) Sample Pkg. Condition : Plastic Can+ Glass Bottle

(2) Details of sampling

- (a) Date of sampling : 14/06/2025
(b) Time of sampling : 11:10 Hrs.
(c) Sampling Protocol : IS 17614 P-3
(d) Equipment Used : Not Applicable
(e) Sample Collected By : SREL
(f) Sampling Location : STP Outlet

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S.No.	Parameters	Units	Results	Specification/Requirement (As per HSPCB)	Test Method
1	pH at 25°C	---	6.91	5.5-9.0	APHA 4500H+-B, 24 th Ed 2023
2	Total Suspended Solid	mg/l	8.1	20	APHA 2540-D, 24 th Ed 2023
3	Biochemical Oxygen Demand for 3 days at 27°C (BOD)	mg/l	6.0	10	IS : 3025 P-44, 2023
4	Chemical Oxygen Demand (COD)	mg/l	25	50	APHA 5220-B, 24 th Ed 2023
5	Oil & Grease	mg/l	BDL(DL-3.0)	Not Specified	APHA 5520-B, 24 th Ed 2023
6	Total Nitrogen (as TKN)	mg/l	2.4	10	APHA 4500 Norg -B, 24 th Ed 2023
7	Phosphate (as P)	mg/l	0.35	1.0	APHA 4500 D, 24 th Ed 2023

*BDL= Below detection limit, DL= Detection limit


Remark : NA

Opinion/Interpretation:

End of Report

Note:

- The results listed refer only to the tested sample and applicable parameter.
- This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- This report can not be reproduced, except when in full, without the written permission of the Director.
- The sample will be destroyed after three weeks from the date of issue of the test report.
(In case of non-perishable products only)


Checked By
Deepika Singh
Sr. Analyst




Authorized Signatory
Anjali Gupta
Technical Manager





S AND R ENVIROLAB LLP

Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TEST REPORT

Page : 2 of 2

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

Test Report No. : SREL/E/16062025002
Sample I.D. : SREL/WWW/16062025002
Sample Received : 16/06/2025
Date of issue : 21/06/2025
Reference No. : TRF

(1) SAMPLE PARTICULARS

- (a) Name of the Sample :Waste Water
(b) Sample Description : Sewage water After treatment
(c) Sample Quantity : 1 + 2 Litre
(d) Sample Pkg. Condition : Plastic Cane+ Glass Bottle

(2) Details of sampling

- (a) Date of sampling : 14/06/2025
(b) Time of sampling : 11:10 Hrs.
(c) Sampling Protocol : IS 17614 P-3
(d) Equipment Used : Not Applicable
(e) Sample Collected By: SREL
(f) Sampling Location: STP Outlet

TEST RESULTS

Test Started on: 16/06/2025

Test Completed on : 21/06/2025


S.No.	Parameters	Units	Results	Specification/Requirement (As per HSPCB)	Test Method
1	Faecal coliform	MPN/100ml	22	<100	APHA 9221 E&C 24 th Ed. 2023

Remark : NA
Opinion/Interpretation

End of Report

Note:-

- * The results listed refer only to the tested sample and applicable parameter.
- * This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- * This report can not be reproduced, except when in full, without the written permission of the Director.
- * The sample will be destroyed after three weeks from the date of issue of the test report.
(In case of non-perishable products only)


Checked By
Deepika Singh
Sr. Analyst




Authorized Signatory
Dr. Ramesh Chandra Tripathy
Quality Manager



S AND R ENVIROLAB LLP

NABL Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TC-11493

TEST REPORT

Page : 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat
Haryana 132103.

ULR No. : TC114932500000817F
Test Report No. : SREL/E/16062025008
Sample I.D. : SREL/AN/16062025008
Sample Received : 16/06/2025
Date of issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Noise Level Testing

Details of Sampling

1. Date & Time of Sampling : 14.06.2025 AT 10:10 Hrs. To 15.06.2025 10:10 Hrs.
2. Sampling Protocol : IS: 9989, 1981
3. Equipment Used : Sound Level Meter
4. Sampling Done By : SREL
5. Duration of Sampling : 24 Hrs.
6. Sampling Location : Block A

TEST RESULTS

Test Started on: 16/06/2025

Test Completed on: 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements (As Per CPCB) Residential Area	Test Method
1.	Leq Value (Day Time)	dBA	52.4	55	IS: 9989, 1981
2.	Leq Value (Night Time)	dBA	42.8	45	IS: 9989, 1981


Day Time shall mean from 6:00AM TO 10:00PM
Night Time shall mean from 10:00PM TO 06:00AM

Remark: NA
Opinion/Interpretation

End of Report

Note:-

- * The results listed refer only to the tested sample and applicable parameter.
- * This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- * This report cannot be reproduced, except when in full, without the written permission of the Director.
- * The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)


Checked By
Deepika Singh
Sr. Analyst




Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager



S AND R ENVIROLAB LLP

NABL Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TEST REPORT

Page : 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat
,Haryana 132103.

ULR No. : TC114932500000818F
Test Report No. : SREL/E/16062025007
Sample I.D. : SREL/AN/16062025007
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Noise Level Testing

Details of Sampling

1. Date & Time of Sampling : 14.06.2025 AT 10:10 Hrs. To 15.06.2025 10:10 Hrs.
2. Sampling Protocol : IS: 9989, 1981
3. Equipment Used : Sound Level Meter
4. Sampling Done By : SREL
5. Duration of Sampling : 24 Hrs.
6. Sampling Location : Block B

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements (As Per CPCB) Residential Area	Test Method
1.	Leq Value (Day Time)	dB(A)	51.2	55	IS: 9989, 1981
2.	Leq Value (Night Time)	dB(A)	42.4	45	IS: 9989, 1981

Day Time shall mean from 6:00AM TO 10:00PM

Night Time shall mean from 10:00PM TO 06:00AM

Remark: NA
Opinion/Interpretation

End of Report

Note:-

- * The results listed refer only to the tested sample and applicable parameter.
- * This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- * This report cannot be reproduced, except when in full, without the written permission of the Director.
- * The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)

Deepika
Checked By
Deepika Singh
Sr. Analyst



Ramesh Chandra Tripathi
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager





S AND R ENVIROLAB LLP

NABL Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TC-11493

TEST REPORT

Page : 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat
,Haryana 132103.

ULR No. : TC11493250000819F
Test Report No. : SREL/E/18062025008
Sample I.D. : SREL/AN/18062025003
Sample Received : 16/06/2025
Date of issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Noise Level Testing

Details of Sampling

1. Date & Time of Sampling : 14.06.2025 AT 10:10 Hrs. To 15.06.2025 10:10 Hrs.
2. Sampling Protocol : IS: 9989, 1981
3. Equipment Used : Sound Level Meter
4. Sampling Done By : SREL
5. Duration of Sampling : 24 Hrs.
6. Sampling Location : Block C

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements (As Per CPCB) Residential Area	Test Method
1.	Leq Value (Day Time)	dBA	50.8	55	IS: 9989, 1981
2.	Leq Value (Night Time)	dBA	40.5	45	IS: 9989, 1981

Day Time shall mean from 6:00AM TO 10:00PM
Night Time shall mean from 10:00PM TO 06:00AM

Remark: NA
Opinion/Interpretation

End of Report

Note:-

- The results listed refer only to the tested sample and applicable parameter.
- This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- This report cannot be reproduced, except when in full, without the written permission of the Director.
- The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)

Deepika
Checked By
Deepika Singh
Sr. Analyst



Ramesh Chandra Tripathi
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager



Add : Plot No-96, Sector - 7, IMT Manesar, Gurugram, Haryana - 122052 (India)

Tel.: 0124-4240147 || Mob.: +91-8882311456, +91-7503957000, +91-7015479139 || Email - srenvirolab@gmail.com
info.srenvirolab@gmail.com || www.srenvirolab.in



S AND R ENVIROLAB LLP

NABI Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TC-11493

TEST REPORT

Page: 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

ULR No. : TC11493250000814F
Test Report No. : SREL/E/16082025003
Sample I.D. : SREL/AA/16062025003
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Air Quality Monitoring

Details of Sampling

- Date of Sampling : 14/06/2025 to 15/06/2025
- Sampling Protocol : IS:5182 (P-14)
- Equipment Used : RDS, PM 2.5 Sampler & Benzene Sampler
- Sampling Done By : SREL
- Duration of Sampling : 24 Hrs.
- Sampling Location : Block A

Physical Observation

- Ambient temp. (Min/Max) : 26°C/39°C
- Weather Cond. : Clear
- Wind Direction : East to West
- Sampling Flow Rate for Gases : 0.5 LPM
- Sampling Flow Rate For RSPM/ PM-10 (Ave.) : 1.20m³/min.

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements As Per CPCB (NAAQS)	Test Method
1.	Particulate Matter (PM ₁₀)	µg/m ³	81.6	100.0	IS: 5182 P-23, 2006
2.	Particulate Matter (PM _{2.5})	µg/m ³	48.2	60.0	IS: 5182 P-24, 2019
3.	Nitrogen Dioxide (NO ₂)	µg/m ³	28.4	80.0	IS: 5182 P-6, 2006
4.	Sulphur Dioxide (SO ₂)	µg/m ³	11.2	80.0	IS: 5182 P-2 Sec-3, 2023
5.	Ammonia (NH ₃)	µg/m ³	23.5	400.0	IS: 5182 P-25, 2018
6.	Ozone (O ₃)	µg/m ³	35.1	180.0	IS: 5182 P-9, 1974
7.	Arsenic (As)	ng/m ³	BLQ (LOQ-1.0)	6.0	Method of Air Sampling & Analysis 3 rd Ed. By James P. Logie - 2012
8.	Nickel (Ni)	ng/m ³	BLQ (LOQ-1.0)	20.0	IS: 5182 P-26, 2020
9.	Lead (Pb)	µg/m ³	BLQ (LOQ-0.01)	1.0	IS: 5182 P-22, 2004

*BLQ= Below limit of Quantification, LOQ= Limit of Quantification.

Remark: NA

Opinion/Interpretation

End of Report

Note:-

- The results listed refer only to the tested sample and applicable parameter.
- This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- This report cannot be reproduced, except when in full, without the written permission of the Director.
- The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)

Deepika
Checked By
Deepika Singh
Sr. Analyst



Ramesh Chandra Tripathi
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager



Add : Plot No-96, Sector - 7, IMT Manesar, Gurugram, Haryana - 122052 (India)

Tel.: 0124-4240147 || Mob: +91-8882311456, +91-7503957000, +91-7015479139 || Email - srenvirolab@gmail.com
info.srenvirolab@gmail.com || www.srenvirolab.in



S AND R ENVIROLAB LLP

Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TEST REPORT

Page: 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38, 39 Panipat, Haryana
132103.

Test Report No. : SREL/E/18062025003
Sample I.D. : SREL/AA/18062025003
Sample Received : 18/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Air Quality Monitoring		Physical Observation	
Details of Sampling			
1. Date of Sampling	: 14/06/2025 to 15/06/2025	(a) Ambient temp. (Min/Max)	: 26°C/39°C
2. Sampling Protocol	: IS:5182 (P-14)	(b) Weather Cond.	: Clear
3. Equipment Used	: RDS, PM 2.5 Sampler & Benzene Sampler	(c) Wind Direction	: East to West
4. Sampling Done By	: SREL	(d) Sampling Flow Rate for Gases	: 0.5 LPM
5. Duration of Sampling	: 24 Hrs.	(e) Sampling Flow Rate For RSPM/ PM-10 (Ave.)	: 1.20m ³ /min.
6. Sampling Location	: Block A		

TEST RESULTS

Test Started on : 18/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements As Per CPCB (NAAQS)	Test Method
1.	Carbon Monoxide (CO)	mg/m ³	0.90	2.0	IS: 5182 P-10, 1999
2.	Benzene (C ₆ H ₆)	µg/m ³	BLQ (LOQ-1.0)	5.0	IS: 5182 P-11, 2006
3.	Benzo (a) Pyrene (BaP)	ng/m ³	BLQ (LOQ-0.1)	1.0	IS: 5182 P-12, 2004

*BLQ= Below limit of Quantification, LOQ= Limit of Quantification.

Remark: NA
Opinion/Interpretation

End of Report

Note:-

- * The results listed refer only to the tested sample and applicable parameter.
- * This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- * This report cannot be reproduced, except when in full, without the written permission of the Director.
- * The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)

Deepika
Checked By
Deepika Singh
Sr. Analyst



Ramesh Chandra
Authorized Signatory
Dr. Ramesh Chandra
Quality Manager





S AND R ENVIROLAB LLP

NABL Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TEST REPORT

Page: 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

ULR No. : TC11493250000816F
Test Report No. : SREL/E/16062025004
Sample I.D. : SREL/AA/16062025004
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Air Quality Monitoring

Details of Sampling

- Date of Sampling : 14/06/2025 to 15/06/2025
- Sampling Protocol : IS:5182 (P-14)
- Equipment Used : RDS, PM 2.5 Sampler & Benzene Sampler
- Sampling Done By : SREL
- Duration of Sampling : 24 Hrs.
- Sampling Location : Block B

Physical Observation

- Ambient temp. (Min/Max) : 26°C/39°C
- Weather Cond. : Clear
- Wind Direction : East to West
- Sampling Flow Rate for Gases : 0.5 LPM
- Sampling Flow Rate For RSPM/PM-10 (Ave.) : 1.20m³/min.

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements As Per CPCB (NAAQS)	Test Method
1.	Particulate Matter (PM ₁₀)	µg/m ³	85.4	100.0	IS: 5182 P-23, 2006
2.	Particulate Matter (PM _{2.5})	µg/m ³	51.2	60.0	IS: 5182 P-24, 2019
3.	Nitrogen Dioxide (NO ₂)	µg/m ³	30.5	80.0	IS: 5182 P-6, 2006
4.	Sulphur Dioxide (SO ₂)	µg/m ³	12.8	80.0	IS: 5182 P-2 Sec-1, 2023
5.	Ammonia (NH ₃)	µg/m ³	22.6	400.0	IS: 5182 P-25, 2018
6.	Ozone (O ₃)	µg/m ³	33.8	180.0	IS: 5182 P-9, 1974
7.	Arsenic (As)	ng/m ³	BLQ (LOQ-1.0)	6.0	Method of Air Sampling & Analysis 3 rd Ed. By James P. Lodge - 2012
8.	Nickel (Ni)	ng/m ³	BLQ (LOQ-1.0)	20.0	IS: 5182 P-26, 2020
9.	Lead (Pb)	µg/m ³	BLQ (LOQ-0.01)	1.0	IS: 5182 P-22, 2004

*BLO= Below limit of Quantification, LOQ= Limit of Quantification.
Remark: NA
Opinion/Interpretation

End of Report

Note:-

- The results listed refer only to the tested sample and applicable parameter.
- This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- This report cannot be reproduced, except when in full, without the written permission of the Director.
- The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)

Deepika Singh
Checked By
Deepika Singh
Sr. Analyst



Dr. Ramesh Chandra Tripathi
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager



Add : Plot No-96, Sector - 7, IMT Manesar, Gurugram, Haryana - 122052 (India)

Tel.: 0124-4240147 || Mob.: +91-8882311456, +91-7503957000, +91-7015479139 || Email - srenvirolab@gmail.com
info.srenvirolab@gmail.com || www.srenvirolab.in



S AND R ENVIROLAB LLP

Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TEST REPORT

Page: 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

Test Report No. : SREL/E/16062025004
Sample I.D. : SREL/AA/16062025004
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Air Quality Monitoring		Physical Observation	
<u>Details of Sampling</u>		(a) Ambient temp. (Min/Max) : 26°C/39°C	(b) Weather Cond. : Clear
1. Date of Sampling : 14/06/2025 to 15/06/2025		(c) Wind Direction : East to West	
2. Sampling Protocol : IS:5182 (P-14)			
3. Equipment Used : RDS, PM 2.5 Sampler & Benzene Sampler		(d) Sampling Flow Rate for Gases : 0.5 LPM	(e) Sampling Flow Rate For RSPM/ PM-10 (Ave.) : 1.20m ³ /min.
4. Sampling Done By : SREL			
5. Duration of Sampling : 24 Hrs.			
6. Sampling Location : Block B			

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements As Per CPCB (NAAQS)	Test Method
1.	Carbon Monoxide (CO)	mg/m ³	1.10	2.0	IS: 5182 P-10, 1999
2.	Benzene (C ₆ H ₆)	µg/m ³	BLQ (LOQ-1.0)	5.0	IS: 5182 P-11, 2006
3.	Benzo (a) Pyrene (BaP)	ng/m ³	BLQ (LOQ-0.1)	1.0	IS: 5182 P-12, 2004

*BLQ= Below limit of Quantification, LOQ= Limit of Quantification.

Remark: NA

Opinion/Interpretation

End of Report

Note: -

- The results listed refer only to the tested sample and applicable parameter.
- This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- This report cannot be reproduced, except when in full, without the written permission of the Director.
- The sample will be destroyed after three weeks from the date of issue of the test report.
(In case of non-perishable products only)

Deepika
Checked By
Deepika Singh
Sr. Analyst



Ramesh Chandra
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager





S AND R ENVIROLAB LLP

NABL Accredited Testing Laboratory
(ISO 9001 | ISO 14001 | OHSAS 45001 Certified Laboratory)



TEST REPORT

Page: 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

ULR No. : TC11493250000816F
Test Report No. : SREL/E/16062025005
Sample I.D. : SREL/AA/16062025005
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Air Quality Monitoring

Details of Sampling

- Date of Sampling : 14/06/2025 to 15/06/2025
- Sampling Protocol : IS:5182 (P-14)
- Equipment Used : RDS, PM 2.5 Sampler & Benzene Sampler
- Sampling Done By : SREL
- Duration of Sampling : 24 Hrs.
- Sampling Location : Block C

Physical Observation

- Ambient temp. (Min/Max) : 26°C/39°C
- Weather Cond. : Clear
- Wind Direction : East to West
- Sampling Flow Rate for Gases : 0.5 LPM
- Sampling Flow Rate For RSPM/ PM-10 (Ave.) : 1.20m³/min.

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements As Per CPCB (NAAQS)	Test Method
1.	Particulate Matter (PM ₁₀)	µg/m ³	79.4	100.0	IS: 5182 P-23, 2006
2.	Particulate Matter (PM _{2.5})	µg/m ³	45.2	60.0	IS: 5182 P-24, 2019
3.	Nitrogen Dioxide (NO ₂)	µg/m ³	25.5	80.0	IS: 5182 P-6, 2006
4.	Sulphur Dioxide (SO ₂)	µg/m ³	9.6	80.0	IS: 5182 P-2 Sec-1, 2023
5.	Ammonia (NH ₃)	µg/m ³	21.8	400.0	IS: 5182 P-25, 2018
6.	Ozone (O ₃)	µg/m ³	31.6	180.0	IS: 5182 P-9, 1974
7.	Arsenic (As)	ng/m ³	BLQ (LOQ-1.0)	6.0	Method of Air Sampling & Analysis 2 nd Ed. By James P. Lodge - 2012
8.	Nickel (Ni)	ng/m ³	BLQ (LOQ-1.0)	20.0	IS: 5182 P-26, 2020
9.	Lead (Pb)	µg/m ³	BLQ (LOQ-0.01)	1.0	IS: 5182 P-22, 2004

*BLQ= Below limit of Quantification, LOQ= Limit of Quantification.

Remark: NA

Opinion/Interpretation

End of Report

Note:-

- The results listed refer only to the tested sample and applicable parameter.
- This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- This report cannot be reproduced, except when in full, without the written permission of the Director.
- The sample will be destroyed after three weeks from the date of issue of the test report. (in case of non-perishable products only)

Deepika Singh
Checked By
Deepika Singh
Sr. Analyst



Dr. Ramesh Chandra Tripathi
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager



S AND R ENVIROLAB LLP

Testing Laboratory
(ISO 9001 | ISO 14001 | ORSAS 45001 Certified Laboratory)



TEST REPORT

Page: 1 of 1

Issued to: M/S TDI Infracorp Limited
TDI City Sector 38,39 Panipat, Haryana
132103.

Test Report No. : SREL/E/16062025005
Sample I.D. : SREL/AA/16062025005
Sample Received : 16/06/2025
Date of Issue : 21/06/2025
Reference No. : TRF

SAMPLE PARTICULARS

Name of the Sample : Ambient Air Quality Monitoring		Physical Observation	
<u>Details of Sampling</u>		(a) Ambient temp. (Min/Max) : 26°C/39°C	(b) Weather Cond. : Clear
1. Date of Sampling : 14/06/2025 to 15/06/2025		(c) Wind Direction : East to West	
2. Sampling Protocol : IS: 5182 (P-14)			
3. Equipment Used : RDS, PM 2.5 Sampler & Benzene Sampler		(d) Sampling Flow Rate for Gases : 0.5 LPM	(e) Sampling Flow Rate For RSPM/ PM-10 (Ave.) : 1.20m ³ /min.
4. Sampling Done By : SREL			
5. Duration of Sampling : 24 Hrs.			
6. Sampling Location : Block C			

TEST RESULTS

Test Started on : 16/06/2025

Test Completed on : 21/06/2025

S. No.	Parameters	Units	Results	Specification/Requirements As Per CPCB (NAAQS)	Test Method
1.	Carbon Monoxide (CO)	mg/m ³	0.90	2.0	IS: 5182 P-10, 1999
2.	Benzene (C ₆ H ₆)	µg/m ³	BLQ (LOQ-1.0)	5.0	IS: 5182 P-11, 2006
3.	Benzo (a) Pyrene (BaP)	ng/m ³	BLQ (LOQ-0.1)	1.0	IS: 5182 P-12, 2004

BLQ Below limit of Quantification. LOQ* Limit of Quantification.

Remark: NA

Opinion/Interpretation

End of Report

Note:-

- * The results listed refer only to the tested sample and applicable parameter.
- * This report, in full or in part, shall not be used for advertising or as evidence in any court of law.
- * This report cannot be reproduced, except when in full, without the written permission of the Director.
- * The sample will be destroyed after three weeks from the date of issue of the test report.
(in case of non-perishable products only)

Deepika
Checked By
Deepika Singh
Sr. Analyst



Ramesh Chandra Tripathi
Authorized Signatory
Dr. Ramesh Chandra Tripathi
Quality Manager
Authorized Signatory
Plot No. -96, Sector-07

Add : Plot No-96, Sector - 7, IMT Manesar, Gurugram, Haryana - 122052 (India)

Tel.: 0124-4240147 || Mob.: +91-8882311456, +91-7503957000, +91-7015479139 || Email - srenvirolab@gmail.com
info.srenvirolab@gmail.com || www.srenvirolab.in


8

423

Annexure R6/6 120





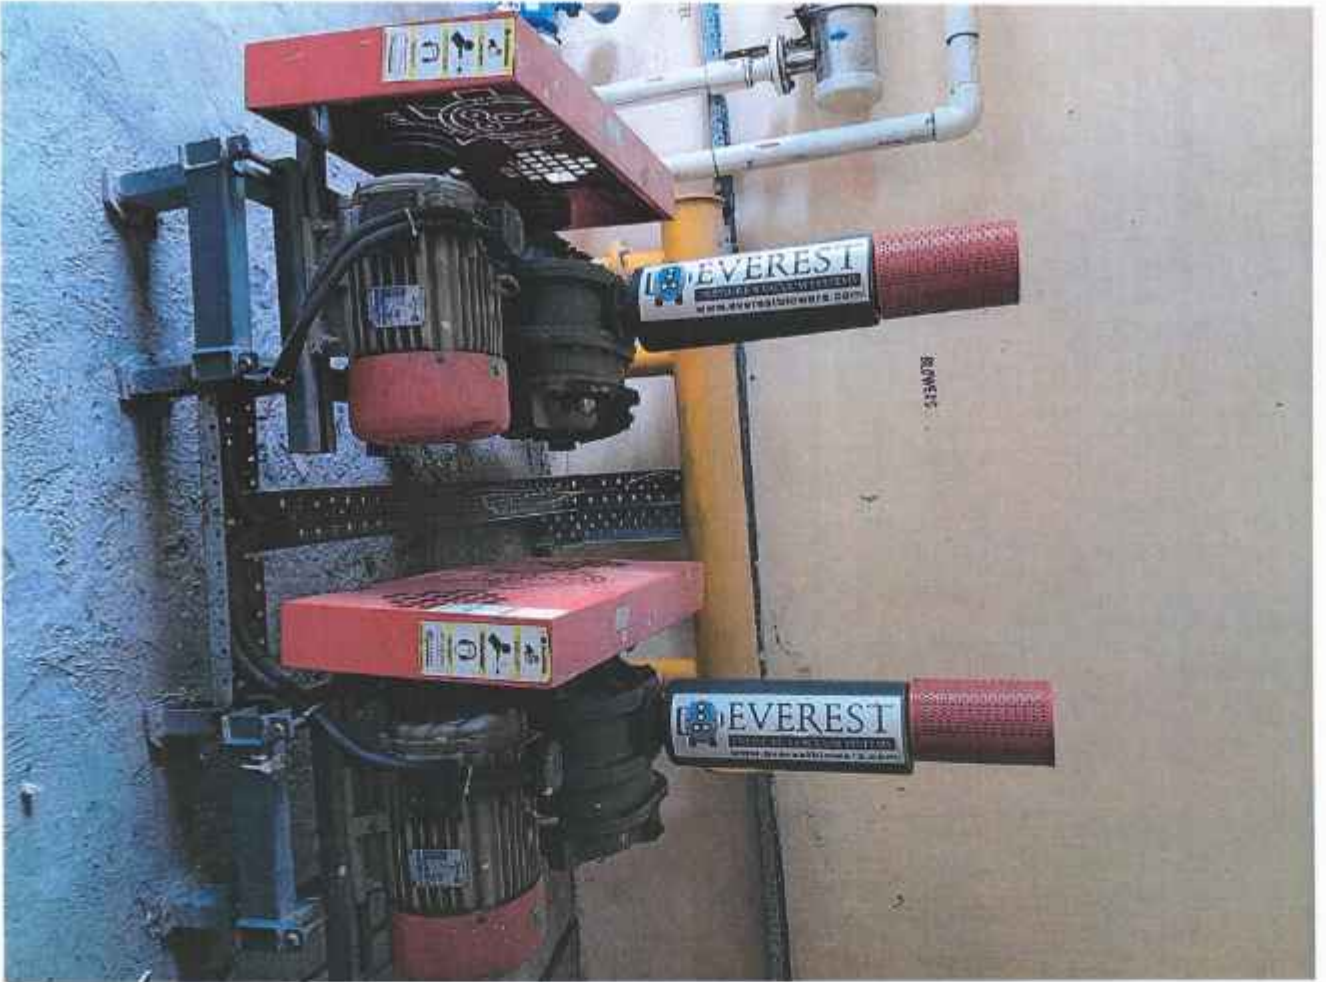








LATEST TECHNOLOGY GENERATOR DEPLOYED ON SITE



QUALITY OF WATER BEING DISCHARGED AFTER TREATMENT



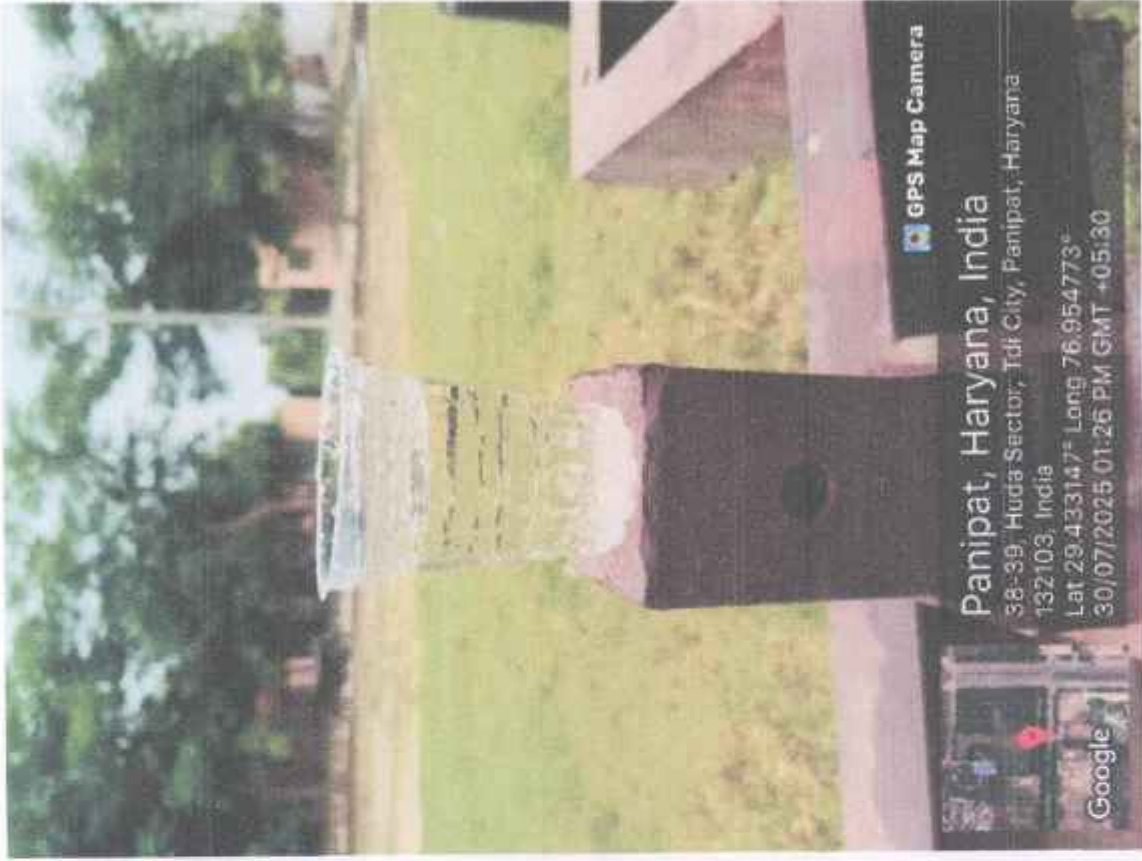


QUALITY OF WATER BEING DISCHARGED AFTER TREATMENT


TREATED WATER BEING USED FOR GARDENING AND SPRINKLING ON ROAD FOR SETTLEMENT OF DUST



TREATED WATER BEING USED FOR GARDENING AND SPRINKLING ON ROAD FOR SETTLEMENT OF DUST

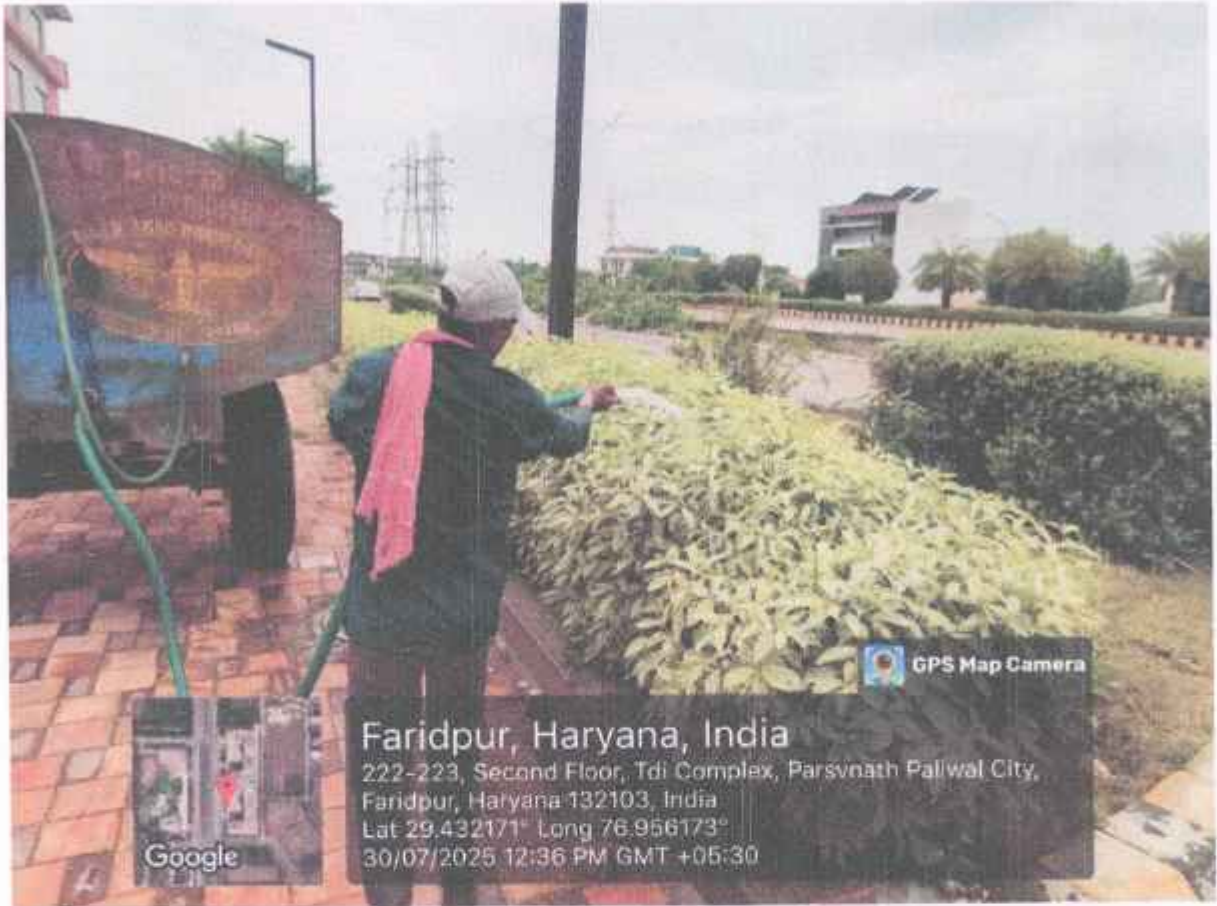

TREATED WATER BEING USED FOR GARDENING AND SPRINKLING ON ROAD FOR SETTLING OF DUST

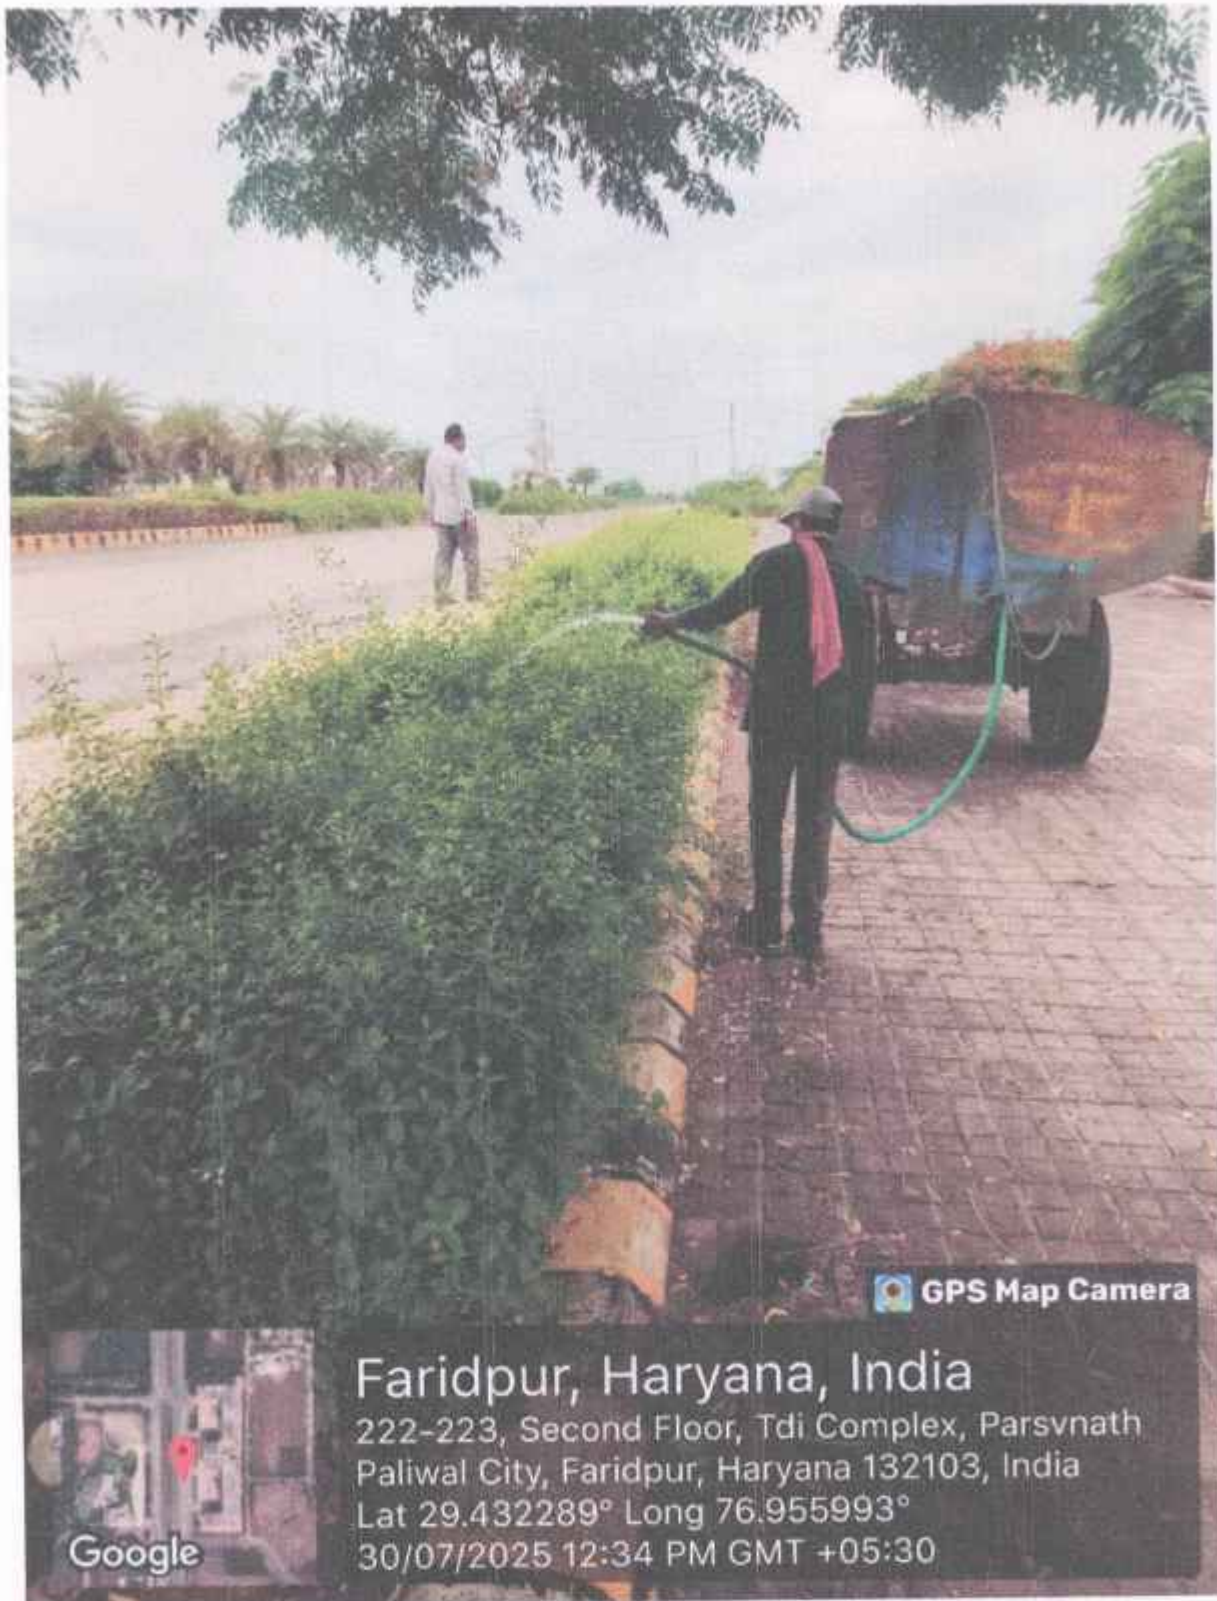


GPS Map Camera



Faridpur, Haryana, India
222-223, Second Floor, Tdi Complex, Parsvnath
Paliwal City, Faridpur, Haryana 132103, India
Lat 29.432289° Long 76.955993°
30/07/2025 12:34 PM GMT +05:30

TREATED WATER BEING USED FOR GARDENING AND SPRINKLING ON ROAD FOR SETTLING OF DUST

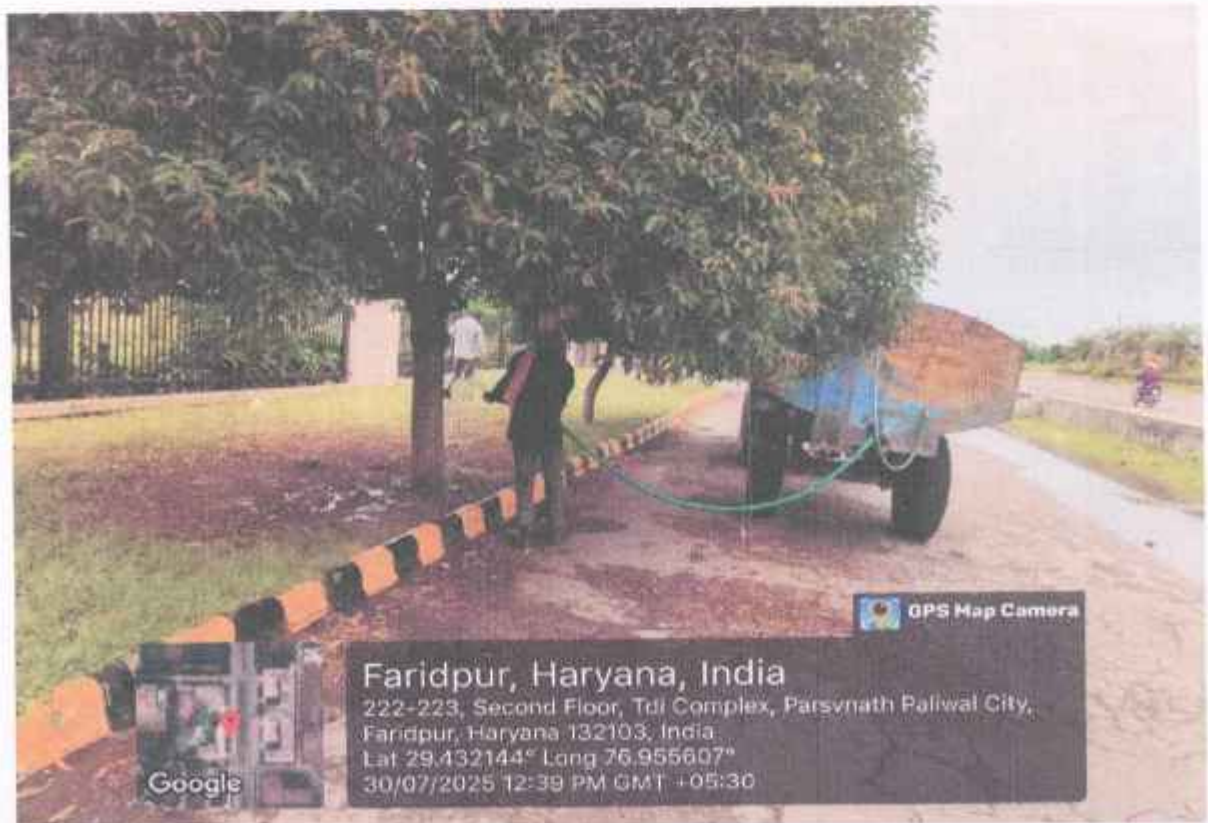

TREATED WATER BEING USED FOR GARDENING AND SPRINKLING ON ROAD FOR SETTLING OF DUST



Suhit Jain <suhit.jain@anilbimal.com>

7/30/2025 4:30 PM

OA/164/2024 - "Varun Gulati vs. State of Haryana & Ors." - Advance Copy, reg.

To jansewajanhit@gmail.com • csharyana@gov.in • hspcbho@gmail.com • elcphed@phedharyana.gov.in • selaa-21.eny@hry.gov.in Copy lohit.bimal@anilbimal.com • raghav.bimal@anilbimal.com

Sirs,

Please find enclosed, by way of advance service, the following documents being filed on behalf of the Respondent No. 6:

1. Reply to Original Application ([Access here](#))
2. Objections to Joint Committee Report ([Access here](#))

Kindly acknowledge receipt.

Sincerely,
Suhit Jain, Adv.
Anil Bimal & Associates
(Advocates & Solicitors)
Counsels for Respondent no. 6

Suhit Jain

Anil Bimal & Associates, Head - Legal & Corporate Finance



+91-9818-009-577
1818, Sector 17-A
Gurugram, Haryana 122001
<http://www.anilbimal.com>