

BEFORE THE NATIONAL GREEN TRIBUNAL
PRINCIPAL BENCH, NEW DELHI
ORIGINAL APPLICATION NO. 1202 of 2024

In the matter of : -

News Item appearing in Indian Express
Dt. 13.9.2024, titled : "E coli, traces of
bleaching powder found in Gr. Noida
Housing Society water samples"

INDEX

<u>Sl. No.</u>	<u>Particulars</u>	<u>Page Nos.</u>
1.	Reply on behalf of Resp. No. 1 with Affidavit	1 - 7
2.	<u>Annexure R-1/1</u> (colly) Photographs taken during inspection dated 03.09.2024	8 - 13
3.	<u>Annexure R-1/2</u> Test Reports by Shree Ram Testing Laboratories dated 07.09.2024	14 - 19
4.	<u>Annexure R-1/3</u> Letter Number- Water/ 2024/ 1023 dated 07.09.2024	20

Place: Noida
Dated : 27.1.2025

Drafted and Filed By:
Shivam Sakseena
(SHIVAM SAKSENA)
Advocate for Resp. No. 1, GNIDA
Chamber No. 210, C.K. Daphtary Block
Supreme Court, New Delhi-01
Mob. No.9971885963

BEFORE THE NATIONAL GREEN TRIBUNAL

PRINCIPAL BENCH, NEW DELHI

ORIGINAL APPLICATION NO. 1202 of 2024

In the matter of : -

News Item appearing in Indian Express
Dt. 13.9.2024, titled : "E coli, traces of
bleaching powder found in Gr. Noida
Housing Society water samples"

REPLY ON BEHALF OF RESPONDENT NO.1
(GREATER NOIDA INDUSTRIAL
DEVELOPMENT AUTHORITY)

MOST RESPECTFULLY SHOWETH:

1. The present Original Application has been admitted under the Suo Moto jurisdiction of the Hon'ble NGT on 01.10.24, pursuant to the news item titled "E.Coli traces of bleaching powder found in Greater Noida housing society water samples", appearing in the Indian Express dated 13.09.24. In the news item it has been alleged that the presence of E. Coli bacteria and bleaching powder has been discovered in the water supply of Supertech Eco Village 2, a Group Housing Society in Greater Noida West, which has led to over 300 residents falling ill due to contaminated water.

2. It is submitted that prior to the admission of the present OA i.e. on 03.09.24, the answering respondent learnt through social media, that some residents of M/ s Supertech Eco Village-2, Sector 16B, Greater Noida had fallen ill after consumption of water which was alleged to be polluted. On the very same day, an on-site inspection was conducted by a team of officers of Respondent No. 1 comprising of the General Manager (Project), Senior Manager (Jal /Sewer), Manager (Jal /Sewer) and Asst. Manager (Jal /Sewer), and other related staff in the presence of residents. During the inspection, inter alia, water samples were collected from the underground and over ground reservoirs of the Society, as well as water samples from the affected flats, for the purpose of testing the quality of water therein. Water samples were also taken from the Pump House of Sector 16B, Greater Noida wherefrom water is supplied by Greater Noida Authority to the society in question. The water samples were collected in sealed and marked plastic bottles, which were then sent for testing. At the time of taking water samples, from the UGR, besides the residents, representatives of M/s RITES were also present. It is further submitted that during the on-site inspection, the management staff of the Builder and some residents informed the answering respondent that a few days prior, the underground reservoir of the Society had been cleaned, subsequent to which complaints regarding bad water supply were made

by the residents, whereafter some residents fell ill. Photographs taken during inspection dt. 03.09.2024 are annexed hereto as **Annexure R1/1**.

3. It is imperative to state that as per the Policy of the answering respondent, the answering respondent provides the supply of water/ water connection upto the Group Housing Society, wherefrom connection into the Society, and its internal storage and distribution is the responsibility of the concerned Builder / the concerned Apartment Owners Association. The Order dated 1.10.2024 passed in the present O.A., it is recorded that 'it is claimed that the Greater Noida Authority supplies water up to the reservoir of group housing societies, but the internal distribution is managed by the builder or the Apartment Owners Association (AOA)'.

4. The water samples collected from the Society and the Pump House were sent for testing to Shree Ram Testing Laboratories, where the samples were tested against the Drinking Water- Essentials Tests as per IS 10500:2012. The test reports of the water samples collected at source from Sector 16B Pump House of Greater Noida Authority and C-3 Pump Room, confirms that the same meets and complies with the requisite parameters of IS:10500-2012 and there is no presence of Coliform or E. Coli. The test report further confirms that the samples collected from locations T-B-12A, T-C-4, T-C-5 and T-C-6 within the society had the

presence of Coliform beyond the prescribed limit, while all other parameters complied with the requirements of IS:10500-2012. It may, however, be noticed that there was no presence of E. Coli in any of the water samples taken from locations T-B-12A, T-C-4, T-C-5 and T-C-6. Photocopy of the Test Reports by Shree Ram Testing Laboratories dated 07.09.2024 are annexed hereto as **Annexure R1/2**.

5. From the test reports is apparent that fault lies in the internal storage and distribution of water within the Society, which responsibility lies with the concerned Builder / the AOA. Consequently, a warning was issued to M/s Supertech Eco Village-2, Sector 16B, Greater Noida West, on 07.09.24, vide letter No. - Water/ 2024/ 1023, to ensure supply of good quality water to the residents of the Society, failing which action would be taken by the answering respondent against it in accordance with law. Photocopy of Letter No. - Water/ 2024/ 1023 dated 07.09.2024 is annexed hereto as **Annexure R1/3**.

6. During the on-site inspection on 03.09.24, upon the complaints made by the residents of the Society, officials of the answering respondent also inspected the STP of the Society, where it was found that the STP is only partially functional, and the pumps installed there are also only partially functional, due to which the basement fills with sewer

water and stench. It was also found that the motors of the STP were not fully functional and sewer was overflowing from the Collective Chamber onto the floor of the basement. It is a matter of record that earlier, vide letter dated 13.5.2023, the Uttar Pradesh Pollution Control Board had imposed a fine of Rs. 5,24,62,500 on the Builder for causing pollution.

7. It may be pertinent to submit that against M/S Supertech Ltd. a petition has been admitted before the NCLT, New Delhi. This order was partly stayed by the NCLAT. As of now the matter is pending before the NCLAT by way of Company Appeal (AT)(Insolvency) No.406 of 2022 which has passed order on 12.12.2024 appointing NBCC for completion all the projects of M/S Supertech Ltd., though appeal against the said order have been very recently filed before the Hon'ble Supreme Court.

The answering respondent respectfully submits that the present reply by Respondent no. 1 be taken on record and this Hon'ble Tribunal may be pleased to pass such further direction in the matter as it may deem necessary.

NEW DELHI
DATED: 27.01.2025

RESPONDENT No. 1
through
(SHIVAM SAKSENA)
Advocate

BEFORE THE NATIONAL GREEN TRIBUNAL

PRINCIPAL BENCH, NEW DELHI

ORIGINAL APPLICATION NO. 1202 of 2024


In the matter of : -

News Item appearing in Indian Express
Dt. 13.9.2024, titled : "E coli, traces of
bleaching powder found in Gr. Noida
Housing Society water samples"

AFFIDAVIT

I, Brijendra Kumar Kushwaha, S/o R. L. Kushwaha, aged about 49 years, resident of S – 30 Staff Colony, A- block, Sector Beta-I, Greater Noida, do hereby solemnly affirm and state as under:

1. I am presently posted as Manager (Civil), W.C.-Jal with the Greater Noida Industrial Development Authority and as such well conversant with the facts deposed herein below:

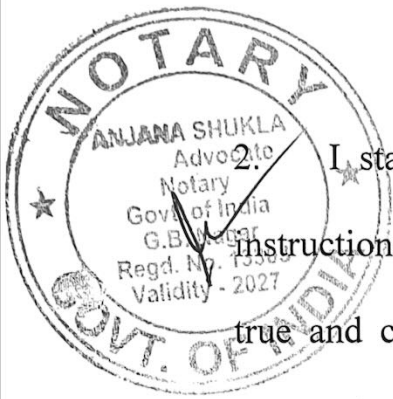

I state that the accompanying reply has been drafted under my instructions. I have read the same and state that the contents thereof are true and correct to my knowledge as derived from the records of the Respondent no. 1, Authority.

DEPONENT

VERIFICATION:

Verified at New Delhi on _____ day of January, 2024 that the factual contents of this Affidavit are true and correct to my knowledge as derived from the records of the case and nothing stated therein is false and nothing material has been concealed there from. The last para is prayer to this Hon'ble Court.

DEPONENT



ATTESTED

ANJANA SHUKLA
Advocate Notary
Distt. Gautam Budh Nagar (U.P.)

12.7. JAN. 2025




Greater Noida, UP, India
Sector 10, Greater Noida, 201318, UP, India
Lat 28.670805° Long 77.441608°
09/03/2024 11:13 AM GMT +05:30
Note: Captured by GPS Map Camera






Ghaziabad, Uttar Pradesh, India
TOWER-D3, SUPERTECH ECO VILLAGE-2, Eco Village 2, Bhargat,
Ghaziabad, Uttar Pradesh 201008, India
Lat 28.608889°
Long 77.4432°
09/09/24 11:20 AM GMT +06:30



Ghaziabad, Uttar Pradesh, India
C4, Eco Village 2, Bhargat, Ghaziabad, Uttar Pradesh 201000, India
Lat 28.611119°
Long 77.441856°
09/09/24 11:27 AM GMT +05:30

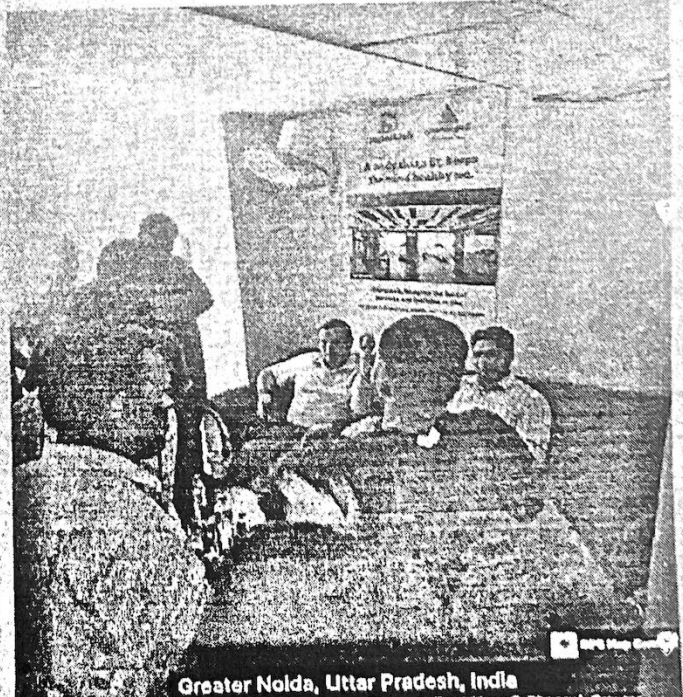

Greater Noida, Uttar Pradesh, India
Tower B 14 Supertech eco village - II, Eco Village 2, Bhargat, Greater
Noida, Ghaziabad, Uttar Pradesh 201310, India
Lat 28.611331°
Long 77.444128°
03/10/24 12:16 PM GMT +05:30

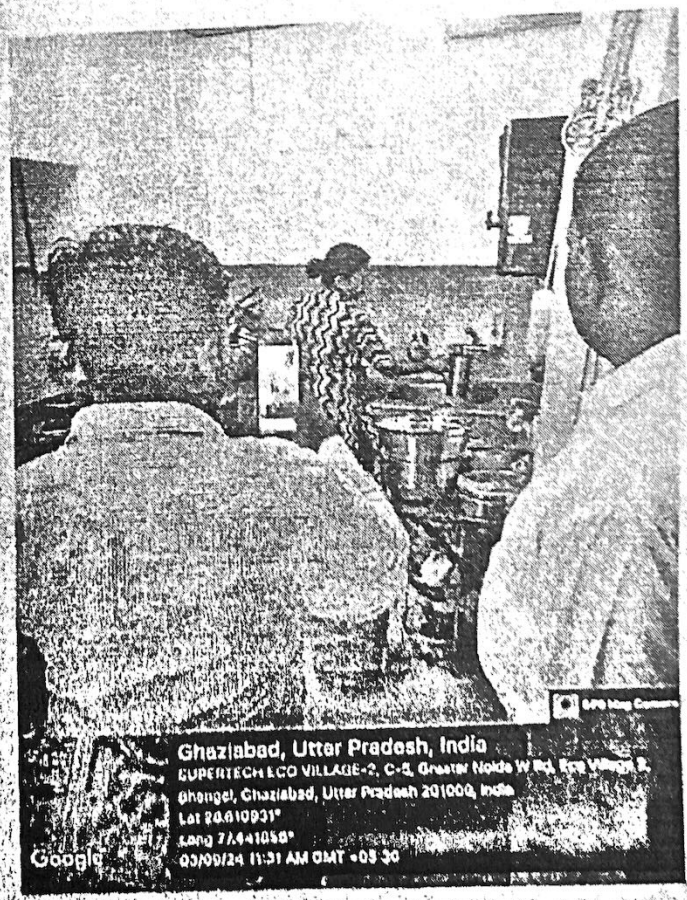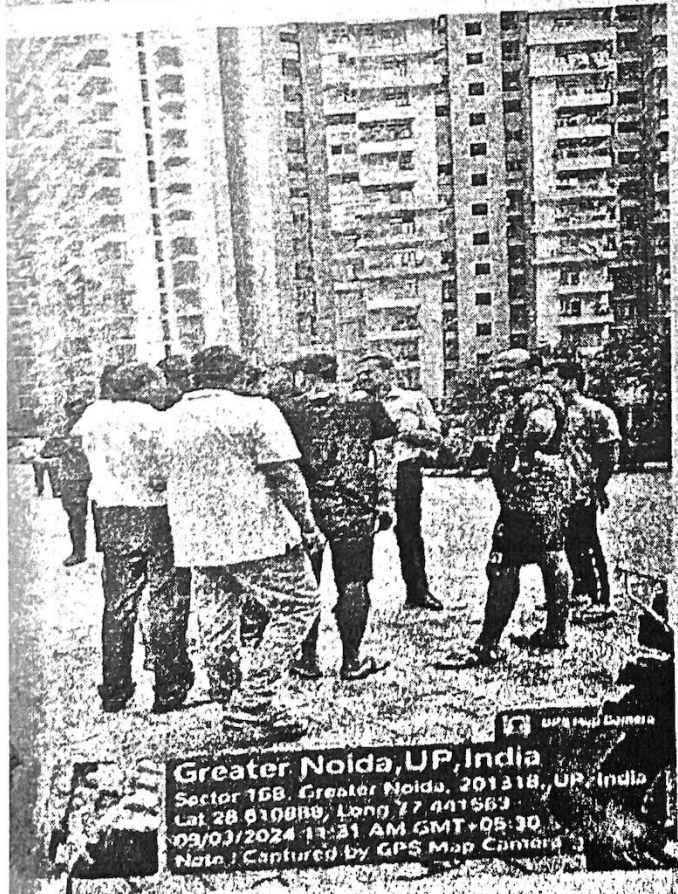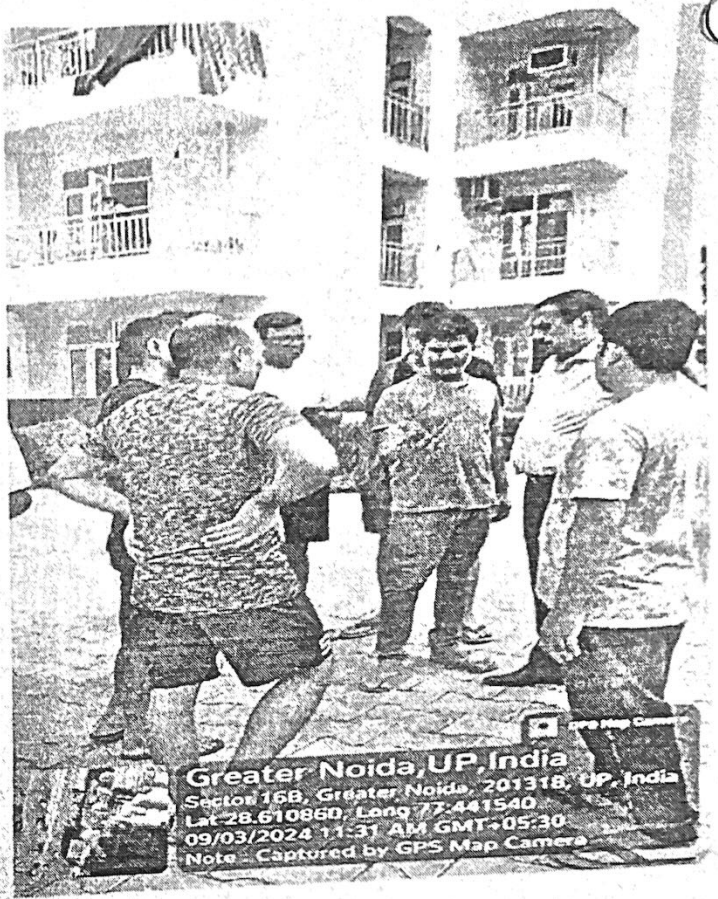

Be fit, keep healthy too.
...tech, bringing the best of prices and facilities in your...
...mentary... ..




Be fit, keep healthy too.
...tech, bringing the best of prices and facilities in your...
...mentary... ..



GPS Map Camera

Ghaziabad, Uttar Pradesh, India
JC6V+P4P, Eco Village-2, Bhangel, Ghaziabad, Uttar Pradesh 201009, India
Lat 28.61178°
Long 77.442848°
03/09/24 12:56 PM GMT +05:30



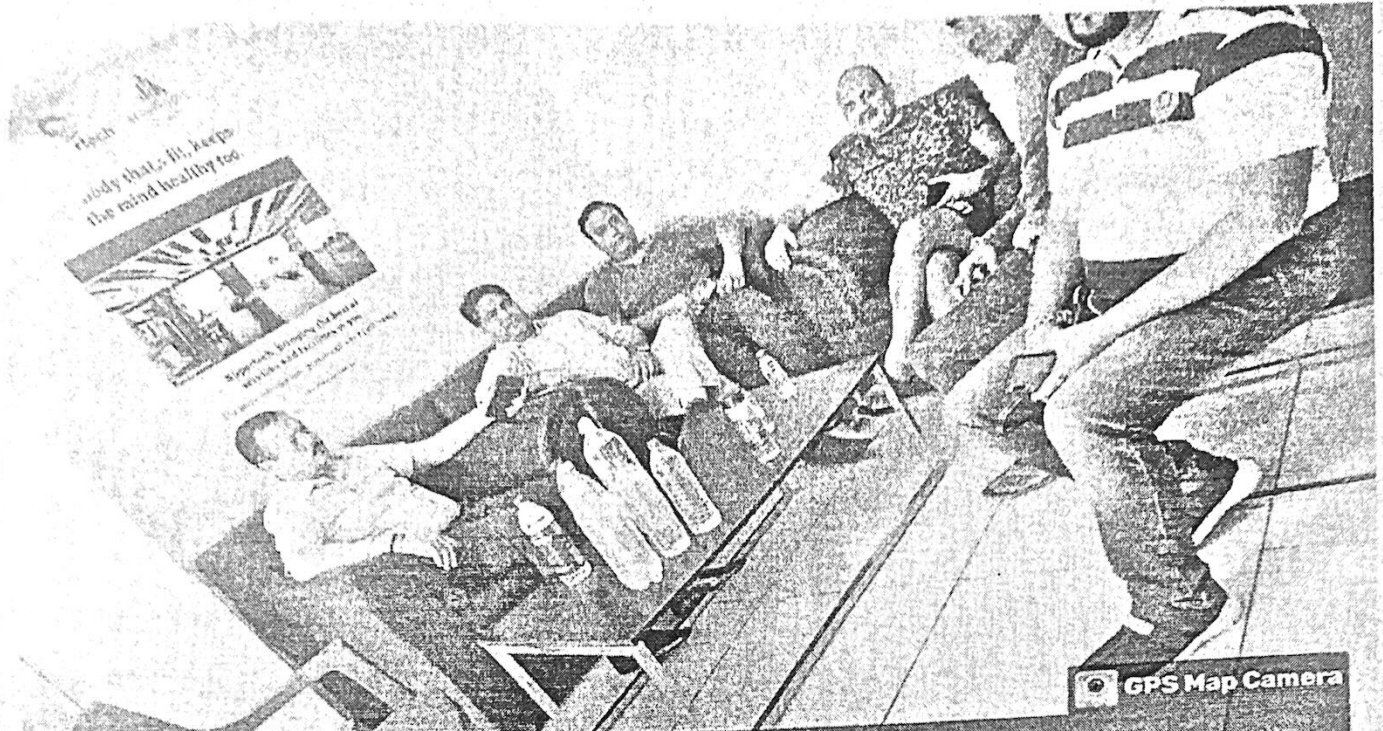

High
study that: fit, keeps
the mind healthy too.

Supporting University of Medical
Sciences and Technology of the
Government of Uttar Pradesh


GPS Map Camera

Ghaziabad, Uttar Pradesh, India
 JC6V+P4P, Eco Village 2, Bhangel, Ghaziabad, Uttar Pradesh 201009, India
 Lat 28.611752°
 Long 77.44283°
 03/09/24 12:56 PM GMT +05:30


Google



(12)

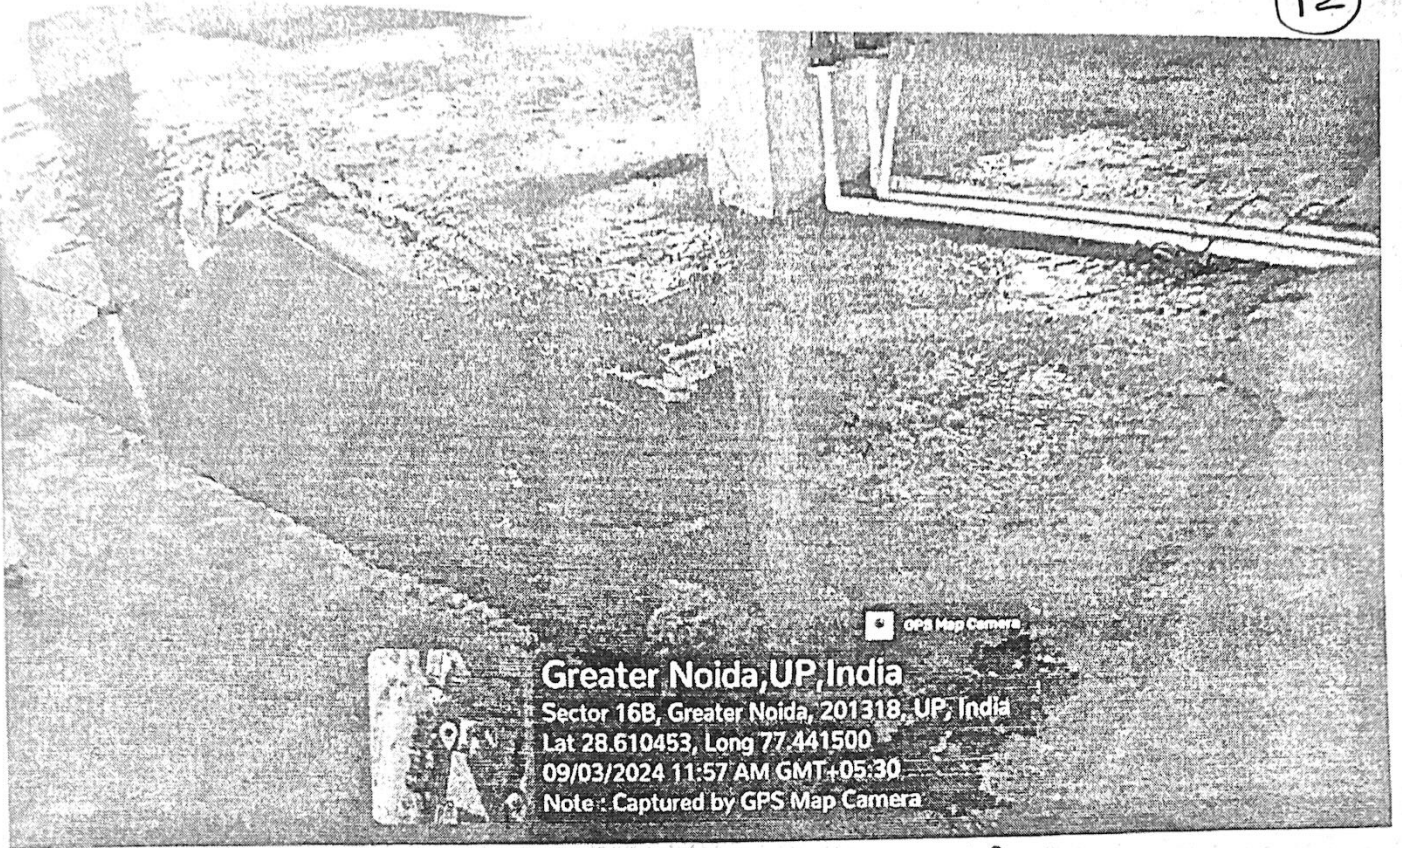


(Basement)

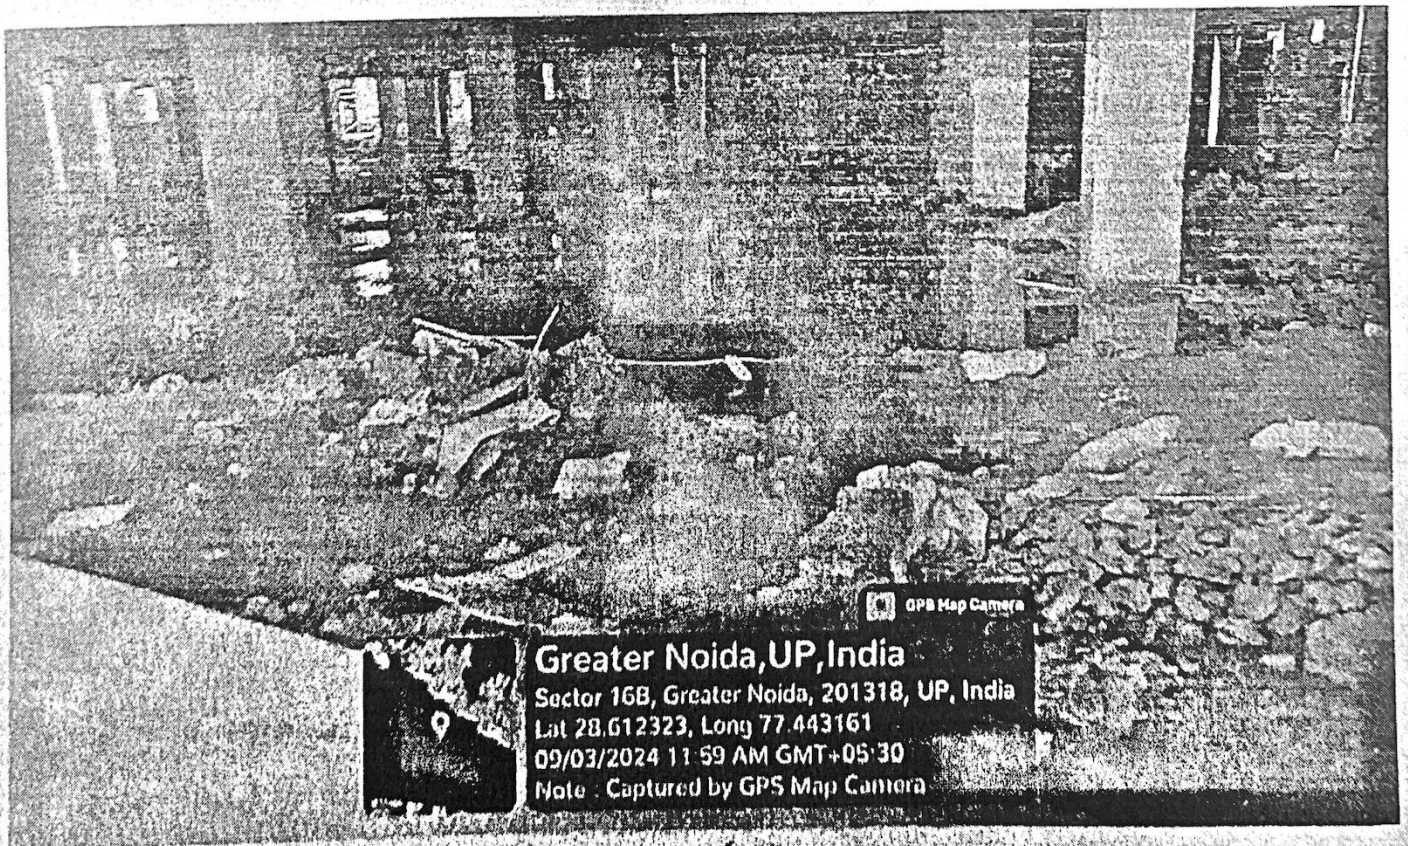

(Basement)



(Basement)

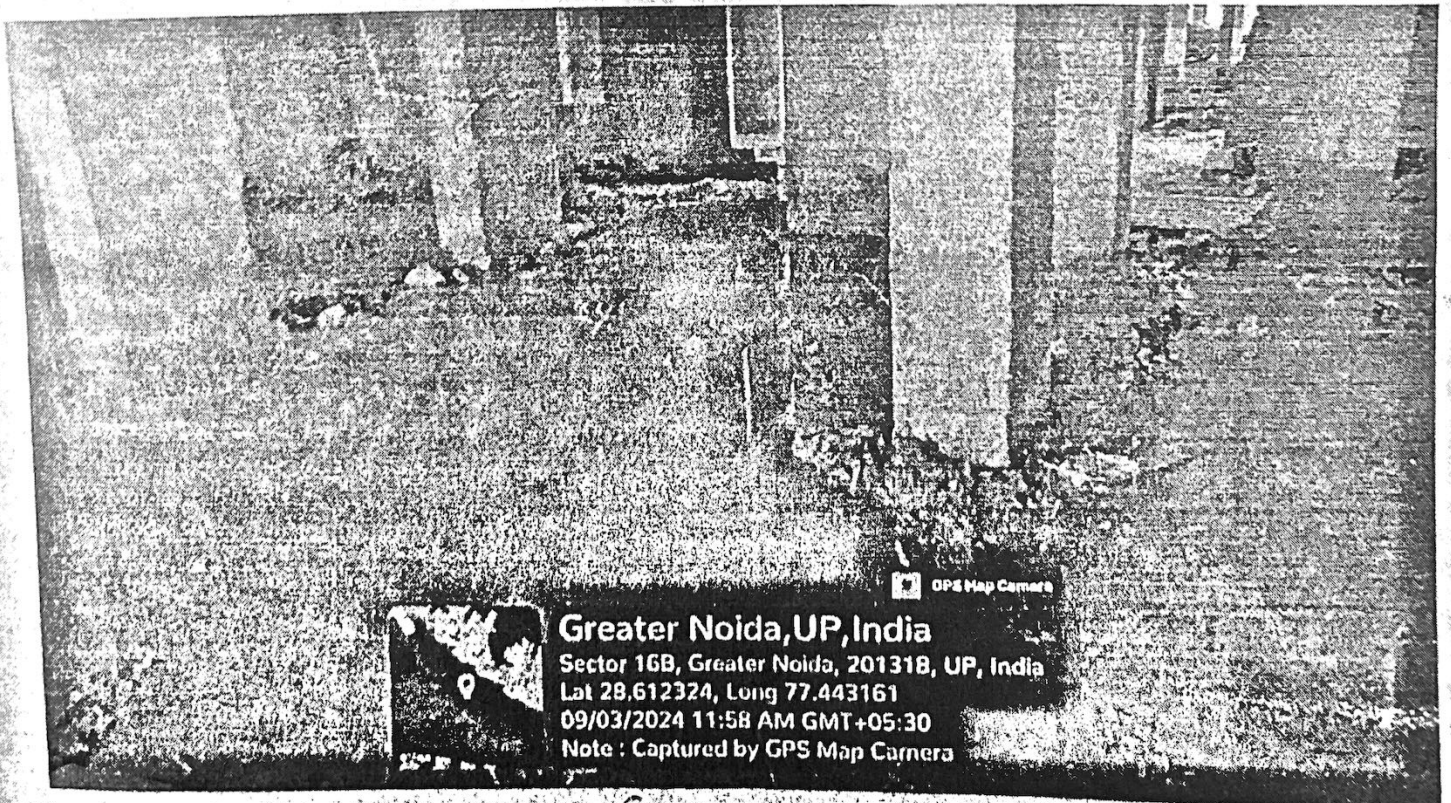

(Basement)



Computer Analytical Software
ISO 9001:2015 & ISO 14001:2015 Certified

SHREE RAM TESTING LABORATORIES

ISO 14001 : 2015 & ISO 9001 : 2015 Approved Laboratory

Lab: A-2/103, Site-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306

H.O. 223, 2nd Floor, Living Style Mall, Jazola, New Delhi-110025

Mob: 9953984801, 9717160780, 9999024801, E-mail: shree.noida@gmail.com

E-mail: info@shreeramlab.com, shreeramlab@yahoo.com, Website: www.shreeramlab.in

TEST REPORT

Issued to M/S Greater Noida Industrial Development Authority
Plot No-1, Sector-K P-4, Greater Noida City,
District-Gautam Buddha Nagar (Uttar Pradesh)
Site M/S. Super Tech Enclave-2 & Borewell sector 16 B
Greater Noida West

Report No.	W-060924-01
Report date	07/09/2024
Sample Received	06/09/2024
Analysis date	06/09/2024 to 06/09/2024
Sampled By	customer

Ref. No. Letter - JAI/2024/1004 dt. 05/09/24

Sample Description: Bore well Water

Location:- C-3 Pump Room

Received Sample in Sealed and marked Plastic Bottle

RESULT

Drinking Water-Essential Tests as per IS 10500:2012

S.N.	Parameters (Units)	Test Method	Results	Requirement as per IS: 10500-2012
01.	Odour	IS:3025(P-5) 2018	Unobjectionable	Unobjectionable
02.	Taste	IS:3025(P-8) 1984 (RA- 2017)	Agreeable	Agreeable
03.	Colour (Hazen)	IS:3025(P-4) 2021	<1.0	5 max
04.	Turbidity (NTU)	IS:3025(P-10) 1984 (RA- 2017)	Nil	1 max
05.	pH value (at 25 °C)	IS:3025(P-11) 1984 (RA- 2017)	7.42	6.5 to 8.5
06.	Total Dissolved solids (mg/l)	IS:3025(P-16) 1984 (RA- 2017)	410	500 max
07.	Total Hardness (as CaCO ₃) (mg/l)	IS 3025 P-21:2009 (RA- 2019)	80.2	200 max
08.	Chloride (as Cl ⁻) (mg/l)	IS:3025(P-32) 1988 (RA- 2019)	110.6	250 max
09.	Iron (as Fe) (mg/l)	IS:3025(P-53) 2003 (RA- 2019)	0.05	0.3 max
10.	Residual Free Chlorine(mg/l)	IS:3025(P-26) 2021	Nil	0.20 max
11.	Fluoride (as F ⁻) (mg/l)	APHA 4500 (D)	0.10	1.0 max
12.	Total Alkalinity (as CaCO ₃) (mg/l)	IS:3025(P-23)-1986 (RA- 2019)	112	200 max
13.	Magnesium (as Mg), (mg/l)	IS:3025(P-46)-1994 (RA- 2019)	12.6	30 max
14.	Aluminum (as Al) (mg/l)	IS:3025(P-55)-2003 (RA- 2019)	Not Detected	0.05 max
15.	Zinc (as Zn), (mg/l)	IS:3025(P-49)-1994 (RA- 2019)	0.05	5 max
16.	Lead (as Pb), (mg/l)	IS:3025(P-47)-1994 (RA- 2019)	Not Detected	0.01 max
17.	Mercury (as Hg), (mg/l)	IS:3025(P-48)-1994 (RA- 2019)	Not Detected	0.01 max
18.	Total Arsenic (as As) mg/l)	IS:3025(P-37)-1988 (RA- 2019)	Not Detected	0.05 max
19.	MICROBIOLOGICAL PARAMETERS			
J	Coliform (cfu/100ml)	IS 1622:1981 (RA- 2019)	Absent	0 max
L	E Coli (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max

Remark: The Tested Parameters meet as per BIS specification.

END OF REPORT

TESTED BY

AUTHORIZED BY





Complete Analytical Solution
ISO 14001 : 2015 & ISO 9001 : 2015 Certified

SHREE RAM TESTING LABORATORIES

ISO 14001 : 2015 & ISO 9001 : 2015 Approved Laboratory

Lab: A-2/103, Sita-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306

H.O. 223, 2nd Floor, Living Style Mall, Jasola, New Delhi-110025

Mob: 9953984801, 9717160700, 9999024801, E-mail: sil.noida@gmail.com

E-mail: info@shrooramlab.com, shrooramlab@yahoo.com, Website: www.shrooramlab.in

TEST REPORT

Issued to: M/S Greater Noida Industrial Development Authority
Plot No-1, Sector-K P-4, Greater Noida City,
District-Gautam Buddha Nagar (Uttar Pradesh)
Site-M/S, Supetech Ecovillage-2 & Borewell sector 16 B
Greater Noida West.

Report No. W-060924-06
Report date: 07/09/2024
Sample Received: 06/09/2024
Analysis date: 06/09/2024 to 07/09/2024
Sampled By: customer

Ref.No. Letter -JAL/2024/1004 dt. 05/09/24

Sample Description: Bore well Water

Location: S-12

Received Sample in Sealed and marked Plastic Bottle

RESULT

Drinking Water - Essential Tests as per IS 10500:2012


S.N.	Parameters (Units)	Test Method	Results	Requirement as per IS:10500-2012
01.	Odour	IS:3025(P-5) 2018	Unobjectionable	Unobjectionable
02.	Taste	IS:3025(P-8) 1984 (RA- 2017)	Agreeable	Agreeable
03.	Colour (Hazen)	IS:3025(P-9) 2021	<1.0	5 max
04.	Turbidity (NTU)	IS:3025(P-10) 1984 (RA- 2017)	Nil	1 max
05.	pH value (at 25 °C)	IS:3025(P-11) 1984 (RA- 2017)	7.55	6.5 to 8.5
06.	Total Dissolved solids (mg/l)	IS:3025(P-16) 1984 (RA- 2017)	440	500 max
07.	Total Hardness (as CaCO ₃) (mg/l)	IS 3025-P-21:2009 (RA- 2019)	110	200 max
08.	Chloride (as Cl ⁻) (mg/l)	IS:3025(P-32) 1988 (RA- 2019)	142.2	250 max
09.	Iron (as Fe) (mg/l)	IS:3025(P-53) 2003 (RA- 2019)	0.05	0.3 max
10.	Residual Free Chlorine (mg/l)	IS:3025(P-26) 2021	Nil	0.20 max
11.	Fluoride (as F) (mg/l)	APHA 4500 (D)	0.11	1.0 max
12.	Total Alkalinity (as CaCO ₃) (mg/l)	IS:3025(P-23)- 1986 (RA- 2019)	140.2	200 max
13.	Magnesium (as Mg) (mg/l)	IS:3025(P-46)-1994 (RA- 2019)	4.58	30 max
14.	Aluminium (as Al) (mg/l)	IS:3025(P-55) 2003 (RA- 2019)	Not Detected	0.03 max
15.	Zinc (as Zn) (mg/l)	IS:3025(P-49)- 1994 (RA- 2019)	0.05	5 max
16.	Lead (as Pb) (mg/l)	IS:3025(P-47)- 1994 (RA- 2019)	Not Detected	0.01 max
17.	Mercury (as Hg) (mg/l)	IS:3025(P-48)- 1994 (RA- 2019)	Not Detected	0.001 max
18.	Total Arsenic (as As) (mg/l)	IS:3025(P-37)- 1988 (RA- 2019)	Not Detected	0.01 max
MICROBIOLOGICAL PARAMETERS				
i	Coliform (cfu/100ml)	IS 1622:1981 (RA- 2019)	20	0 max
ii	E. Coli (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max

Remark: The Tested Parameters meet as per BIS specification except coliform.


END OF REPORT

TESTED BY

AUTHORIZED SIGN

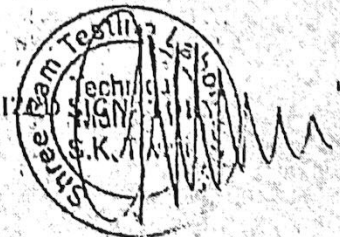

P-1/1



SHREE RAM TESTING LABORATORIES

ISO 14001 : 2015 & ISO 9001 : 2015 Approved Laboratory

Lab: A-2/103, Site-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306

H.O. 223, 2nd Floor, Living Style Mall, Jasola, New Delhi-110025

Mob: 9953984801, 9717160780, 9999024801, E-mail: sl.noida@gmail.com

E-mail: info@shreeramlab.com, shreeramlab@yahoo.com, Website: www.shreeramlab.in

Complete Analytical Solution
ISO 14001 : 2015 & ISO 9001 : 2015 Certified

TEST REPORT

Issued to: M/S Greater Noida Industrial Development Authority
Plot No-1, Sector-K P-4, Greater Noida City,
District-Gautam Buddha Nagar (Uttar Pradesh)
Site M/S. Superch Ecovillage-2 & Borewell sector 16 B
Greater Noida West.

Report No. W-060924-02
Report date: 07/09/2024
Sample Received: 06/09/2024
Analysis date: 06/09/2024 to 07/09/2024
Sampled By: customer

Ref.No. Letter -JAL/2024/1004 dt. 05/09/24
Sample Description: Bore well Water
Location: T-C-5
Received Sample in Sealed and marked Plastic Bottle

RESULT

Drinking Water-Essential Tests as per IS 10500:2012

S.N.	Parameters (Units)	Test Method	Results	Requirement as per IS: 10500-2012
01.	Odour	IS:3025(P-5) 2018	Unobjectionable	Unobjectionable
02.	Taste	IS:3025(P-8) 1984 (RA-2017)	Agreeable	Agreeable
03.	Colour (Hazen)	IS:3025(P-4) 2021	<1.0	5 max
04.	Turbidity (NTU)	IS:3025(P-10) 1984 (RA-2017)	Nil	1 max
05.	pH value (at 25 °C)	IS:3025(P-11) 1983 (RA-2017)	7.56	6.5 to 8.5
06.	Total Dissolved solids (mg/l)	IS:3025(P-16) 1984 (RA-2017)	436	500 max
07.	Total Hardness (as CaCO ₃) (mg/l)	IS:3025 P-21:2009 (RA-2019)	85.30	200 max
08.	Chloride (as Cl) (mg/l)	IS:3025(P-32) 1988 (RA-2019)	141.4	250 max
09.	Iron (as Fe) (mg/l)	IS:3025(P-53) 2003 (RA-2019)	0.05	0.3 max
10.	Residual-Free Chlorine(mg/l)	IS:3025(P-26) 2021	Nil	0.20 max
11.	Fluoride (as F) (mg/l)	APHA 4500(D)	0.10	1.0 max
12.	Total Alkalinity (as CaCO ₃) (mg/l)	IS:3025(P-23)- 1986 (RA-2019)	132	200 max
13.	Magnesium (as Mg) (mg/l)	IS:3025(P-46)- 1994 (RA-2019)	12.4	30 max
14.	Aluminum (as Al) (mg/l)	IS:3025(P-55)- 2003 (RA-2019)	Not Detected	0.03 max
15.	Zinc (as Zn) (mg/l)	IS:3025(P-49)- 1994 (RA-2019)	0.05	5-max
16.	Lead (as Pb) (mg/l)	IS:3025(P-47)- 1994 (RA-2019)	Not Detected	0.01 max
17.	Mercury (as Hg) (mg/l)	IS:3025(P-48)- 1994 (RA-2019)	Not Detected	0.001 max
18.	Total Arsenic (as As) mg/l)	IS:3025(P-37)- 1988 (RA-2019)	Not Detected	0.01 max
19. MICROBIOLOGICAL PARAMETERS				
1.	Coliform (cfu/100ml)	IS 1622:1981 (RA-2019)	10	0 max
1.	L. Co. (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max


Remark: The Tested Parameters meet as per BIS specification except coliform

END OF REPORT

TESTED BY
P. J. J

AUTHORIZED
S. K. S. K.

1) The above results are related only to the test performed on the sample. Endorsement to product is neither inferred. 2) This report is to be reproduced wholly or in part & can not be used as an evidence in the court of law & should not be used in any advertising media without special permission in writing. 3) Sample will be destroyed after 30 days from the date of reporting unless otherwise specified. 4) Total liability of our lab is limited to the invoice amount. 5) Report refers to the sample drawn by Shree Ram Testing Laboratories unless mentioned otherwise.



SHREE RAM TESTING LABORATORIES

33

17

ISO 14001:2015 & ISO 9001:2015 Approved Laboratory

Lab: A-27103, Site-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306
H.O 223, 2nd Floor, Living Style Mall, Jasala, New Delhi-110025

Mob. 9953984801, 9717160780, 9999024801, E-mail: sh.noida@gmail.com

E-mail: info@shreeramlab.com, shreeramlab@yahoo.com, Website: www.shreeramlab.in

TEST REPORT

Issued to: M/S Greater Noida Industrial Development Authority
Plot No-1, Sector-K, P-4, Greater Noida City,
District-Gautam Buddha Nagar (Uttar Pradesh)
Site-A/S. Sapatnagar, Village-2 & Borewell sector 16 B
Greater Noida West.

Report No. W-060924-01
Report date: 07/09/2024
Sample Received: 06/09/2024
Analysis date: 06/09/2024 to 07/09/2024
Sampled By: customer

Ref. No. Letter - JAL/2024/1004 dt. 05/09/24

Sample Description: Borewell Water

Location: T.C-6

Received Sample in Sealed and marked Plastic Bottle

RESULT

Drinking Water - Essential Tests as per IS 10500:2012


S.N.	Parameters (Units)	Test Method	Results	Requirement as per IS: 10500-2012
01.	Odour	IS:3025(P-5) 2018	Unobjectionable	Unobjectionable
02.	Taste	IS:3025(P-8) 1984 (RA- 2017)	Agreeable	Agreeable
03.	Colour (Hazen)	IS:3025(P-4) 2021	<1.0	5 max
04.	Turbidity (NTU)	IS:3025(P-10) 1988 (RA- 2017)	Nil	1 max
05.	pH value (at 25 °C)	IS:3025(P-11) 1988 (RA- 2017)	7.64	6.5 to 8.5
06.	Total Dissolved solids (mg/l)	IS:3025(P-16) 1984 (RA- 2017)	448	500 max
07.	Total Hardness (as-CaCO ₃) (mg/l)	IS 3025 P-21:2009 (RA- 2019)	88.2	200 max
08.	Chloride (as Cl ⁻) (mg/l)	IS:3025(P-32) 1988 (RA- 2019)	150.8	250 max
09.	Iron (as Fe ²⁺) (mg/l)	IS:3025(P-53) 2003 (RA- 2019)	0.06	0.3 max
10.	Residual Free Chlorine (mg/l)	IS:3025(P-26) 2021	Nil	0.20 max
11.	Fluoride (as F ⁻) (mg/l)	APHA 4500 (D)	0.12	1.0 max
12.	Total Alkalinity (as CaCO ₃) (mg/l)	IS:3025(P-23)- 1986 (RA- 2019)	180	200 max
13.	Magnesium (as Mg), (mg/l)	IS:3025(P-46)- 1994 (RA- 2019)	14.2	30 max
14.	Aluminum (as Al) (mg/l)	IS:3025(P-55)- 2003 (RA- 2019)	Not Detected	0.03 max
15.	Zinc (as Zn), (mg/l)	IS:3025(P-49)- 1994 (RA- 2019)	1.22	5 max
16.	Lead (as Pb), (mg/l)	IS:3025(P-47)- 1994 (RA- 2019)	Not Detected	0.01 max
17.	Mercury (as Hg), (mg/l)	IS:3025(P-48)- 1994 (RA- 2019)	Not Detected	0.001 max
18.	Total Arsenic (as As) (mg/l)	IS:3025(P-37)- 1988 (RA- 2019)	Not Detected	0.01 max
19.	MICROBIOLOGICAL PARAMETERS			
i	Coliform (cfu/100ml)	IS 1622:1981 (RA- 2019)	20	0 max
ii	E. Coli (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max

Remark: The Tested Parameters meet as per BIS specification except coliform.

END OF REPORT

TESTED BY

AUTHORIZED SIGNATURE



P. 1/1

Note: (1) The above results are related only to the test performed on the sample, Endorsement to product is neither inferred. (2) This is not to be reproduced wholly or in part & can not be used as an evidence in the court of law & should not be used in any advertising without special permission in writing (3) Sample will be destroyed after 30 days from the date of reporting unless otherwise specified (4) Total liability of our lab is limited to the invoice amount (5) report refers to the sample drawn by Shree Ram Testing Laboratories unless mentioned otherwise



Complete Analytical Solution
14001:2015 & ISO 9001:2015 Certified

34

18

SHREE RAM TESTING LABORATORIES

ISO 14001 : 2015 & ISO 9001 : 2015 Approved Laboratory

Lab: A-2/103, Site-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306

H.O. 223, 2nd Floor, Living Stylo Mall, Jasola, New Delhi-110025

Mob: 9953984801, 9717160780, 9999024801, E-mail: sil.noida@gmail.com

E-mail: info@shreeramlab.com, shreeramlab@yahoo.com, Website: www.shreeramlab.in

TEST REPORT

Issued To: M/S Greater Noida Industrial Development Authority
Plot No-1, Sector-K P-I, Greater Noida City,
District-Gautam Buddha Nagar (Uttar Pradesh)
Site-M, S, Supertech Ecoovillage-2 & Borewell sector 16 B
Greater Noida West

Report No. W-060924-03
Report date: 07/09/2024
Sample Received: 06/09/2024
Analysis date: 06/09/2024 to 07/09/2024
Sampled By: customer

Ref. No. Letter -IAL/2024/1004 dt. 05/09/24

Sample Description: Bore well Water

Location: T.C-4

Received Sample in Sealed and marked Plastic Bottle

RESULT

Drinking Water-Essential Tests as per IS 10500:2012

S.N.	Parameters (Units)	Test Method	Results	Requirement as per IS: 10500-2012
01.	Odour	IS:3025(P-5)-2018	Unobjectionable	Unobjectionable
02.	Taste	IS:3025(P-8)-1984 (RA-2017)	Agreeable	Agreeable
03.	Colour (Hazen)	IS:3025(P-4)-2021	<1.0	5 max
04.	Turbidity (NTU)	IS:3025(P-10)-1984 (RA-2017)	Nil	5 max
05.	pH value (at 25°C)	IS:3025(P-11)-1983 (RA-2017)	7.48	6.5 to 8.5
06.	Total Dissolved solids (mg/l)	IS:3025(P-16)-1984 (RA-2017)	446	500 max
07.	Total Hardness (as CaCO ₃) (mg/l)	IS 3025-P-21:2009 (RA-2019)	90.40	200 max
08.	Chloride (as Cl ⁻) (mg/l)	IS:3025(P-32)-1988 (RA-2019)	150.6	250 max
09.	Iron (as Fe) (mg/l)	IS:3025(P-53)-2003 (RA-2019)	0.05	0.3 max
10.	Residual Free Chlorine (mg/l)	IS:3025(P-26)-2021	Nil	0.20 max
11.	Fluoride (as F ⁻) (mg/l)	APHA 4500 (D)	0.12	1.0 max
12.	Total Alkalinity (as CaCO ₃) (mg/l)	IS:3025(P-23)-1986 (RA-2019)	138	200 max
13.	Magnesium (as Mg) (mg/l)	IS:3025(P-46)-1994 (RA-2019)	16.2	80 max
14.	Aluminum (as Al) (mg/l)	IS:3025(P-55)-2003 (RA-2019)	Not Detected	0.03 max
15.	Zinc (as Zn) (mg/l)	IS:3025(P-49)-1994 (RA-2019)	0.05	5 max
16.	Lead (as Pb) (mg/l)	IS:3025(P-47)-1994 (RA-2019)	Not Detected	0.01 max
17.	Mercury (as Hg) (mg/l)	IS:3025(P-48)-1994 (RA-2019)	Not Detected	0.001 max
18.	Total Arsenic (as As) (mg/l)	IS:3025(P-37)-1988 (RA-2019)	Not Detected	0.01 max
19.	MICROBIOLOGICAL PARAMETERS			
	Coliform (cfu/100ml)	IS 1622:1981 (RA-2019)	10	0 max
	E. Coli (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max

Remark: The Tested Parameters meet as per BIS specification except coliform.

END OF REPORT

TESTED BY

P 1/1

AUTHORIZED



(1) The above results are related only to the test performed on the sample, Endorsement to product is neither inferred. (2) This report is to be reproduced wholly or in part & can not be used as an evidence in the court of law & should not be used in any advertising media without special permission in writing (3) Sample will be destroyed after 30 days from the date of reporting unless otherwise specified (4) Total liability of our lab is limited to the invoice amount (5) report refers to the sample drawn by Shree Ram Testing Laboratories unless mentioned otherwise



SHREE RAM TESTING LABORATORIES

ISO 14001 : 2015 & ISO 9001 : 2015 Approved Laboratory

Lab: A-2/103, Site-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306

H.O. 223, 2nd Floor, Living Style Mall, Jasola, New Delhi-110025

Mob: 9953984801, 9717160780, 9999024801, E-mail: sil.noida@gmail.com

E-mail: info@shreeramlab.com, shreeramlab@yahoo.com, Website: www.shreeramlab.in

TEST REPORT

Issued to: M/S Greater Noida Industrial Development Authority
Plot No-1, Sector-K P-4, Greater Noida City,
District-Gautam Buddha Nagar (Uttar Pradesh)
Site-B, S, Supertech Ecovillage-2 & Borewell sector 16 B
Greater Noida West.

Report No. W-060924-05
Report date: 05/09/2024
Sample Received: 06/09/2024
Analysis date: 06/09/2024 to 09/09/2024
Sampled by: [Signature]

Ref. No. Letter - JAL/2024/1004 dt 05/09/24

Sample Description: Bore well Water

Location:- Sector -16 B Pump House

Received Sample in Sealed and marked Plastic Bottle

RESULT

Drinking Water-Essential Tests as per IS 10500:2012

S.N.	Parameters (Units)	Test Method	Results	Requirement as per IS: 10500-2012
01	Odour	IS:3025(P-5) 2018	Unobjectionable	Unobjectionable
02	Taste	IS:3025(P-8) 1984 (RA- 2017)	Agreeable	Agreeable
03	Colour (Hazen)	IS:3025(P-4) 2021	<1.0	5 max
04	Turbidity (NTU)	IS:3025(P-10) 1984 (RA- 2017)	Nil	1 max
05	pH value (at 25 °C)	IS:3025(P-11) 1988 (RA- 2017)	7.62	6.5 to 8.5
06	Total Dissolved solids (mg/l)	IS:3025(P-16) 1984 (RA- 2017)	453	500 max
07	Total Hardness (as CaCO ₃) (mg/l)	IS:3025 P-21:2009 (RA- 2019)	114.0	200 max
08	Chloride (as Cl ⁻) (mg/l)	IS:3025(P-32) 1988 (RA- 2019)	152.6	250 max
09	Iron (as Fe) (mg/l)	IS:3025(P-53) 2003 (RA- 2019)	0.05	0.3 max
10	Residual-Free Chlorine (mg/l)	IS:3025(P-26) 2021	Nil	0.20 max
11	Fluoride (as F ⁻) (mg/l)	APHA 4500 (D)	0.12	1.0 max
12	Total Alkalinity (as CaCO ₃) (mg/l)	IS:3025(P-23)- 1986 (RA- 2019)	145.5	200 max
13	Magnesium (as Mg) (mg/l)	IS:3025(P-46)- 1994 (RA- 2019)	16.6	30 max
14	Aluminum (as Al) (mg/l)	IS:3025(P-55)- 2003 (RA- 2019)	Not Detected	0.03 max
15	Zinc (as Zn) (mg/l)	IS:3025(P-49)- 1994 (RA- 2019)	0.05	5 max
16	Lead (as Pb) (mg/l)	IS:3025(P-47)- 1994 (RA- 2019)	Not Detected	0.01 max
17	Mercury (as Hg) (mg/l)	IS:3025(P-48)- 1994 (RA- 2019)	Not Detected	0.001 max
18	Total Arsenic (as As) (mg/l)	IS:3025(P-37)- 1988 (RA- 2019)	Not Detected	0.01 max
19	MICROBIOLOGICAL PARAMETERS			
I	Coliform (cfu/100ml)	IS 1622:1981 (RA- 2019)	Absent	0 max
II	E. Coli (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max

Remark: The Tested Parameters meet as per BIS specification.

END OF REPORT

TESTED BY

P-1/1

AUTHOR



note: (1) The above results are related only to the test performed on the sample, Endorsement to product is neither inferred. (2) This report is to be reproduced wholly or in part & can not be used as an evidence in the court of law & should not be used in any advertising material without special permission in writing (3) Sample will be destroyed after 30 days from the date of reporting unless otherwise specified (4) Total liability of our lab is limited to the invoice amount (5) report relate to the sample drawn by Shree Ram Testing Laboratories unless mentioned otherwise



ग्रेटर नौएडा औद्योगिक विकास प्राधिकरण

प्लॉट न0-1, सैक्टर-के0 पी0-4, ग्रेटर नौएडा सिटी, जिला-गौतमबुद्ध नगर (उ0प्र0)।

website: www.greaternoidaauthority.in email id: authority@gnida.in, sm.workcircle.jal@gnida.in

पत्रांक- जल/2024/1023

दिनांक- 07/9/2024


M/s Supertech Ecovillage-2,
Sector-16B,
Greater Noida West,
G.B. Nagar.

विषय :- M/s Supertech Ecovillage-2, सैक्टर-16बी में दूषित जलापूर्ति की शिकायत के सम्बन्ध में।

कृपया उपरोक्त विषयक अवगत कराना है कि दिनांक-03.09.2024 को सोशल मीडिया के माध्यम से सूचना प्राप्त हुयी थी कि M/s Supertech Ecovillage-2, सैक्टर-16बी में निवास करने वाले काफी लोग दूषित पानी पीने के कारण बीमार हो गये हैं, जिसकी जानकारी प्राप्त होते ही जल विभाग द्वारा सोसाइटी के अन्दर स्थित भूमिगत जलाशय, अपर जलाशय एवं प्रभावित फ्लैटों के पानी की गुणवत्ता की जाँच करने के उद्देश्य से आवंटियों की उपस्थिति में पानी के नमूने लिए गए थे, जिनकी टैस्टिंग आख्या संलग्न की गयी है, जिसमें बैक्टीरिया इत्यादि पाए गए हैं एवं गुणवत्ता ठीक नहीं पायी गयी है।

अतः उक्त के सम्बन्ध में निर्देशित किया जाता है कि गुणवत्तापूर्ण जलापूर्ति सुनिश्चित करें, अन्यथा कि स्थिति में यदि इस प्रकार की कोई अन्य शिकायतें प्राप्त होती है, तो उसका समस्त उत्तरदायित्व आपका होगा तथा नियमानुसार प्रशासनिक/विधिक कार्यवाही प्रस्तावित कर दी जाएगी।

संलग्नक :- टेस्ट रिपोर्ट की प्रति।




(राजेश कुमार)

वरिष्ठ प्रबन्धक-जल

प्रतिलिपि:-

- स्टॉफ आफीसर को, मुख्य कार्यपालक अधिकारी महोदय के सादर अवलोकनार्थ।
- स्टॉफ आफीसर को, अपर मुख्य कार्यपालक अधिकारी (पी0) महोदय/ (डी0) महोदय के सादर अवलोकनार्थ।
- महाप्रबन्धक (बिल्डर्स) महोदय को सादर सूचनार्थ।
- महाप्रबन्धक (परियोजना) महोदय को सादर सूचनार्थ।
- नोडल अधिकारी, भूगर्भ जल विभाग, ए0ई0-18, अंसल गोल्फ लिंक-2, निकट तिलपता गोल चक्कर, जिला-गौतमबुद्ध नगर को आवश्यक कार्यवाही हेतु।
- सम्बन्धित प्रबन्धक/सहायक प्रबन्धक-जल को आवश्यक कार्यवाही हेतु।
- सम्बन्धित पत्रावली।



वरिष्ठ प्रबन्धक-जल

९८