

STATUS REPORT IN COMPLIANCE

TO ORDER DATED 02.12.2021

IN OA 77/2020 (CZ)

Aarya Shrivastava

Vs

Union Of India

Status Report

Subject: Status report in compliance of the order of Hon'ble NGT Central Zone Bench, Bhopal on dated 02.12.2021 in case no. OA 77/2020 Ms. Aarya Shrivastava V/s Union of India & Ors.

With reference to the above case Hon'ble NGT Central Zone Bench, Bhopal by order dated 02.12.2021 has given orders which are cited as below:-

4. *Two issues are involved in these applications –*

i. Discharge of untreated water into the water bodies Motia Talab/ Hasan Talab for which, it is submitted that more than 95 percent of work of channelizing drains has been completed and the STPs are going to be functional from last week of December, 2021. It has further been submitted that the Nalla / drains which are discharging untreated water into the water body/lake are tapped and regularly monitored, so that the untreated water should be diverted towards the STP and to ensure that no untreated water should be discharged into the river/lake. The learned counsel appearing for the State Pollution Control Board has submitted that notices have been issued to the violators of law for realisation of environmental compensation in accordance with law.

7. The action taken report by the municipal corporation and the respondents may be submitted before the next date of hearing.

In view of above directions, the status report mentioned in point no. 4 (i) related to this office is as follows:

1. In the matter of NGT OA 49/2021(Ujjwal Sharma v/s State of M.P. & Ors.), inspection of Motia talab & Hasan Siddiqui Talab area was done by officials of Regional Office, MPPCB Bhopal on 22.10.2021, 17.11.2021 and in ref. to NGT 606/2018 on 27.01.2022. During the inspection it was found that 02 nallahs (Eidgah hills nallah and SBI nallah) have been intercepted and diverted to STP Maholi Damkheda with the help of sewer line laid under AMRUT project for the treatment of wastewater and no discharge of wastewater into Motia talab was found.
2. Work of laying of sewer line in the residential area nearby to Nawab Siddiqui Hasan talab has been done under AMRUT project and connected to Maholi Damkheda STP.
3. Under the AMRUT project in Bhopal city, 35 drains have been fully intercepted and diverted for treatment to STPs, 15 no. of drains have been connected to sewage network system which will be treated in STPs to be commissioned by March 2022. No discharge was observed in 07 drains and they were found dry. About 18 drains will be connected to the sewerage system under the AMRUT (Sewage) 2.0 Scheme of the Central Government at the earliest by the Bhopal Municipal Corporation.
4. In Bhopal city, total 13 no. of STPs are operational including 05 STPs setup under AMRUT project and 05 additional STPs are under-construction under AMRUT project.

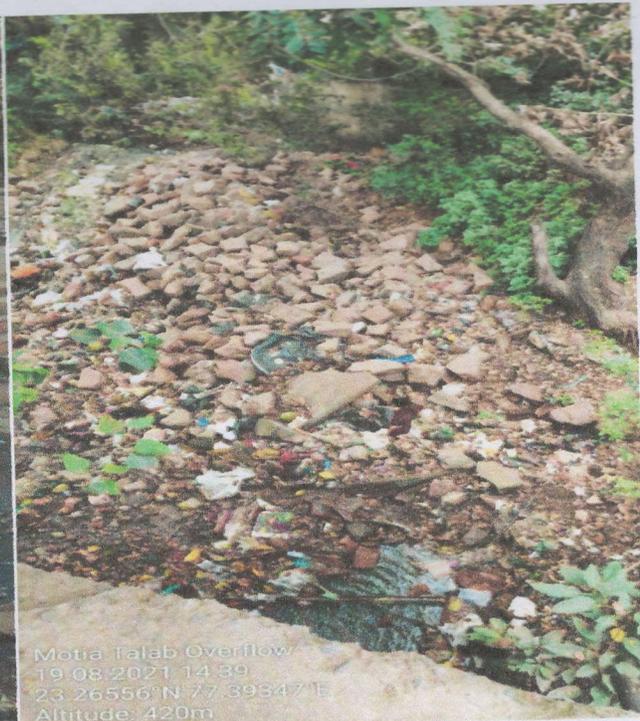

(Adarsh Malviya)
Assistant Engineer (C)
RO, MPPCB Bhopal


(A. K. Bisen)
Executive Engineer
RO, MPPCB Bhopal

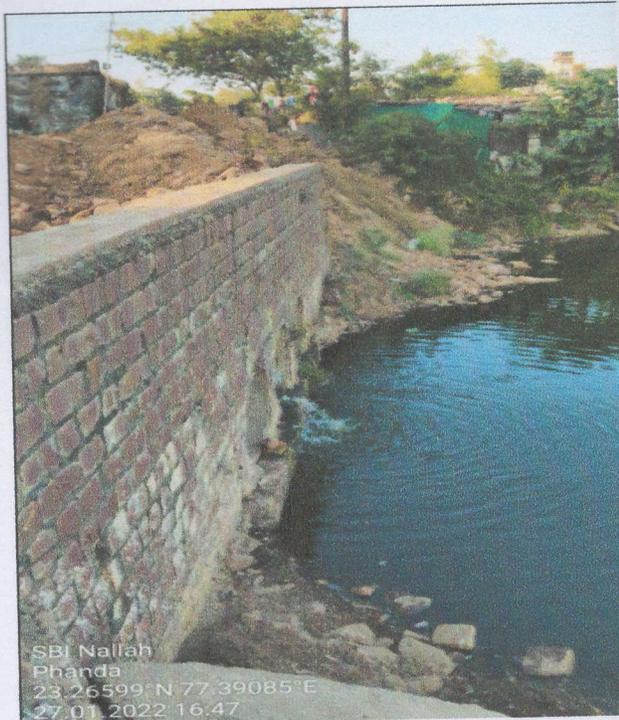
Photographs of Inspection



Eidgah Hills Nallah



No overflow from Motia Talab



SBI Nallah



Laying of sewage network under AMRUT