

कार्यालय नगरपालिका पोकरण, जिला जैसलमेर (राज0)

क्रमांक :- न0पा0पो/23/653

दिनांक :- 21/03/2023

श्रीमान् निदेशक महोदय,
स्वायत्त शासन विभाग,
राजस्थान, जयपुर।

विषय :- एनजीटी प्रकरण संख्या 81/2022 भोमाराम माली बनाम् राजस्थान सरकार एवं अन्य के सम्बन्ध में।
प्रसंग :- इस कार्यालय का पूर्व में प्रेषित पत्र संख्या/नपापो/2022/2539 दिनांक 18.11.2022 के संदर्भ में।
महोदयजी,

उपरोक्त प्रासंगिक पत्र के संदर्भ में निवेदन हैं कि दिनांक 15 नवम्बर 2022 को माननीय राष्ट्रीय हरित अधिकरण, भोपाल बैन्च में मूल परिवाद संख्या 81/2022 (6) द्वारा भोमाराम माली बनाम् राजस्थान सरकार एवं अन्य में माननीय राष्ट्रीय हरित अधिकरण के आदेश दिनांक 20.10.2022 के अनुपालना में श्री प्रभजोतसिंह उपखण्ड अधिकारी पोकरण, श्रीमती शिल्पी शर्मा क्षेत्रीय अधिकारी राजस्थान राज्य प्रदूषण नियंत्रण मण्डल, जैसलमेर एवं श्री राजकुमार महतो कनिष्ठ अभियंता नगरपरिषद जैसलमेर की संयुक्त टीम द्वारा परिवाद स्थल खसरा नम्बर 1739/943 व 1746/943 तहसील पोकरण जिला जैसलमेर का निरीक्षण परिवादी श्री भोमाराम माली की उपस्थिति में किया गया था।

परिवादी स्थल पर परिवादी की उपस्थिति में संयुक्त दल द्वारा उक्त नगरीय/घरेलू उचिष्ट के बहाव को परिवादी की भूमि खसरा नम्बर 1739/942 व 1746/943 पर जाने से रोकने हेतु नदी के पास ही नगरपालिका पोकरण की राजस्व भूमि पर अस्थाई लेगून्स बनाकर निस्तारण किये जाने की प्रस्तावना बनाई गई थी। जिससे परिवादी को प्रारम्भिक राहत दी जा सके। उक्त क्रम में श्रीमान् जी से निवेदन हैं कि खसरा नम्बर 1739/942 व 1746/943 एवं तोलाबेरी बरसाती नदी के बीच नगरपालिका के पास ऐसी रिक्त जमीन उपलब्ध नहीं है जहाँ पर अस्थाई लेगून्स बनाई जा सके। एवं उक्त खसरा के बाद स्थित रण क्षेत्र में अस्थाई लेगून्स बनाये जा सकते हैं। परन्तु रण क्षेत्र व तोलाबारी बरसाती नदी के बीच निजी खातेदारी की जमीन है। बिना जमीन अवाप्ति के उक्त कार्य संभव नहीं है। अतः वर्तमान में नगरपालिका स्तर से परिवादी को अस्थाई राहत दिया जाना संभव नहीं है।

उक्त समस्या का पूर्णतः निस्तारण सीवरेज ट्रीटमेण्ट प्लाण्ट लगवाये जाने पर ही संभव है। अतः शहर व परिवादी की समस्या के मध्यनजर पोकरण में सीवरेज ट्रीटमेण्ट प्लाण्ट व सीवरेज की वित्तीय स्वीकृति प्रदान करने का श्रम करावें। ताकि राष्ट्रीय हरित अधिकरण भोपाल के आदेशों की पालना की जा सके।

संलग्न :- उपरोक्तानुसार।

- 51 -

अधिशायी अधिकारी
नगरपालिका पोकरण

क्रमांक :- न0पा0पो/23/654-658

दिनांक :- 21/03/2023

प्रतिलिपि :-

1. श्रीमान् वरिष्ठ संयुक्त विधि परामर्शी, स्वायत्त शासन विभाग, जयपुर।
2. श्रीमान् जिला कलक्टर महोदय, जैसलमेर।
3. श्रीमान् क्षेत्रीय अधिकारी, स्टेट पॉल्यूशन बोर्ड, जैसलमेर।
4. श्री शोएब हसन खान, स्थाई अधिवक्ता नेशनल ग्रीन ट्रिब्यूनल भोपाल को भेजकर लेख हैं कि उपरोक्त NGT प्रकरण में पैरवी कर बिल कार्यालय में भिजवावें।
5. श्री रामस्वरूप गुचिया, प्रभारी विधि शाखा को आदेशित किया जाता हैं कि उक्त प्रकरण से संबंधित अधिवक्ता से समन्वय स्थापित कर प्रकरण में पैरवी करवाना सुनिश्चित करें।

अधिशायी अधिकारी
नगरपालिका पोकरण




श्रीमान निदेशक एवं सयुक्त शासन सचिव महोदय
स्वायत शासन विभाग, जयपुर।

विषय :- Regarding NGT Case No. 81/2022 ' Bhooma Ram Mali & Ors. Vs State of Rajasthan & Ors'

प्रसंग :- Notice on Admission No. NGT-CZB/Jod/2022/112 Date 22.10.2022 Of Ragistar Central Zonal Bench Bhopal NGT and order Date 20.10.2022

महोदयजी,

उपरोक्त विषया एवं प्रासंगिक पत्र के क्रम में निवेदन हैं कि Regarding NGT Case No. 81/2022 ' Bhooma Ram Mali & Ors. Vs State of Rajasthan & Ors' के प्रकरण में Notice on Admission No. NGT-CZB/Jod/2022/112 Date 22.10.2022 Of Ragistar Central Zonal Bench Bhopal NGT and order Date 20.10.2022 की पालना में तथ्यात्मक रिपोर्ट तैयार कर श्रीमानजी की सेवा में सादर प्रस्तुत है।


अधिशायी अधिकारी
नगरपालिका पोकरण (जैसलमेर)

दिनांक :- 18/11/2022

क्रमांक / नपापो / 2022 / 2540 to 2543
प्रतिलिपि :-

1. श्रीमान वरिष्ठ सयुक्त विधि परामर्शी, स्वायत शासन विभाग, जयपुर।
2. श्रीमान जिला कलक्टर महोदय, जैसलमेर।
3. श्रीमान क्षेत्रीय अधिकारी, स्टेट पोल्युशन कन्ट्रोल बोर्ड, जैसलमेर।
4. श्री शोएब हसन खान, स्थाई अधिवक्ता नेशनल ग्रीन ट्रिब्यूनल भोपाल को भेजकर लेख है कि उपरोक्त NGT प्रकरण में सलग्न तथ्यात्मक रिपोर्ट अनुसार पैरवी करवाने का श्रम करावे।


अधिशायी अधिकारी
नगरपालिका पोकरण (जैसलमेर)

Joint Inspection Report

Submitted in Reference to

**Hon'ble National Green Tribunal (NGT)
Central Zone Bench, Bhopal order dated
20/10/2022**

In the Matter of

Original Application. No. 81/2022

Bhoma Ram Mali & Ors. Applicant(s)

Versus

State of Rajasthan & Ors Respondent(s)

Members of the Team

Sh. Prabhjot Singh Gill, SDO, Pokaran, Jaisalmer

Smt. Shilpi Sharma, Regional Officer, RSPCB, Jaisalmer

**Sh. Rajkumar Mahoto, Junior Engineer, Municipal Council,
Jaisalmer**

INSPECTION REPORT OF JOINT COMMITTEE IN COMPLIANCE OF HON'BLE NATIONAL GREEN TRIBUNAL (NGT) CENTRAL ZONE BENCH, BHOPAL ORDER DATED 20/10/2022 IN THE MATTER OF ORIGINAL APPLICATION No. 81/2022 BHOMA RAM MALI & ORS. APPLICANT(S) VERSUS STATE OF RAJASTHAN & ORS RESPONDENT(S)

INTRODUCTION

Hon'ble NGT Central Bench Bhopal, vide its order dated 20/10/2022, in the matter of Original Application No. 81/2022 constituted a Joint Committee comprising of representative of District Magistrate, Jaisalmer, One representative of State Pollution Control Board, Rajasthan and Municipal Council or its representative, Jaisalmer, Rajasthan and directed the committee to undertake site visits, and submit factual and action taken report within four weeks of the issuance of this order. The State PCB has been designated as the Nodal agency for coordination and compliance. (Copy of the order is enclosed at **Annexure-I and copy of nomination from respective departments is enclosed as Annexure-I-A**).

In compliance to the aforesaid order dated 20/10/2022, following officers were nominated from their respective departments to conduct the joint inspection:-

- i. Sh. Prabhjot Singh Gill, SDO, Pokaran, Jaisalmer (Raj)
- ii. Smt. Shilpi Sharma, Regional Officer, RSPCB, Jaisalmer (Raj)
- iii. Sh. Rajkumar Mahoto, Junior Engineer, Nagar Parishad, Jaisalmer.

The committee of above officers carried out joint inspection in the presence of Executive Officer, Municipal Board, Pokaran- Sh. Suresh Kumar Jeengar, Asst Revenue Inspector- Sh. Ram Swaroop Guchiya and

Patwari, Pokaran- Sh. Ajeet of alleged site, located at Khasra No. 1739/943 and 1746/943, Tehsil Pokaran, Dist, Jaisalmer, Rajasthan on 15/11/2022.

OBSERVATIONS DURING THE VISIT

- Pokaran City is a tehsil in the Jaisalmer District of Rajasthan State, India. Pokaran town has a total of approx. 30000 populations and source of water for Pokaran town is PHED supply.
- It was reported that Municipal Board, Pokaran has provided 30-35 % sewerage connectivity in the year 2011-2012 to the household of Pokaran town and terminal sewage treatment plant has not been provided for treatment of domestic sewage generated from the town.
- Alleged Khasra No. 1739/943 and 1746/943, Tehsil Pokaran, Dist, Jaisalmer, and Rajasthan was visited in presence of Sh. Bhom ram Mali; the applicant in the matter.
- The latitude and longitude of the alleged site are:- 26.9186567N and 71.9342485E.
- The above referred alleged site is near the Non-perennial river- Tolaberi River which passes through khasra number 942 as per the revenue record of Municipal Board, Pokaran and khatedhari land Khasra No. 1739/943 and 1746 /943 of Sh. Bhomaram Mali.
- As per the population density and record of water supplied to each household, the quantum of domestic waste water generated from Pokaran is 3.0- 3.5 MLD.



- During the inspection, it was reported by Representative of Municipal Board, Pokaran that domestic waste water generated from the Pokaran city is disposed through open Nalla & sewerage system which ultimately meet to natural catchment area of Tolaberi river which finally gets accumulated near the khatedari land of Sh. Bhomaram Mali. In the Monsoon season domestic waste water & storm water travels upto Rann area (Salty land) area of Pokaran.
- During inspection, domestic sewage was found in the surface runoff storm water accumulated in the natural catchment area of river Tolaberi which turns towards the downstream side to Rann area adjoining the land of petitioner.
- At the time of inspection it was reported by the Patwari, Pokaran about ownership of land on which domestic waste water was found accumulated. The details of lease holders & Naksha trace as provided by Patwari, Pokaran is enclosed as **Annexure-II.**
- During the inspection, it was reported by Representative of Municipal Board, Pokaran that the efforts to store the surface runoff storm water in to the 'Salam Sagar Talab' has been taken by the State. The amount of Rs 8.5 Cr. has been sanctioned for work of rejuvenation, beautification and development of 'Salam Sagar Talab' under Amrut. 2.0 in compliance of Amrut Sarovar Yojana. The Salam Sagar Talab is located at approximately 2.5 km away from alleged site and the proposed project would reduce significant amount of storm water accumulated in the petitioner land. Sanctioned order for the same is enclosed as **Annexure-III.**

- As per the available records, consent to establish for installation/lying of sewerage network in compliance of State Board's categorization dated 26/05/2016 has not been obtained by Municipal Board Pokaran. However the sewer network was laid by Municipal Board Pokaran in year 2011-12.
- The google earth imagery showing hatched area of the river Tolaberi, petitioner land etc are enclosed as **Annexure-IV**.
- The photographs taken during the visit are enclosed as **Annexure-V**.
- The mauka fard of the joint committee is enclosed as **Annexure-VI**.



Figure1:- Google earth imagery of sewage logged area of the petitioner.

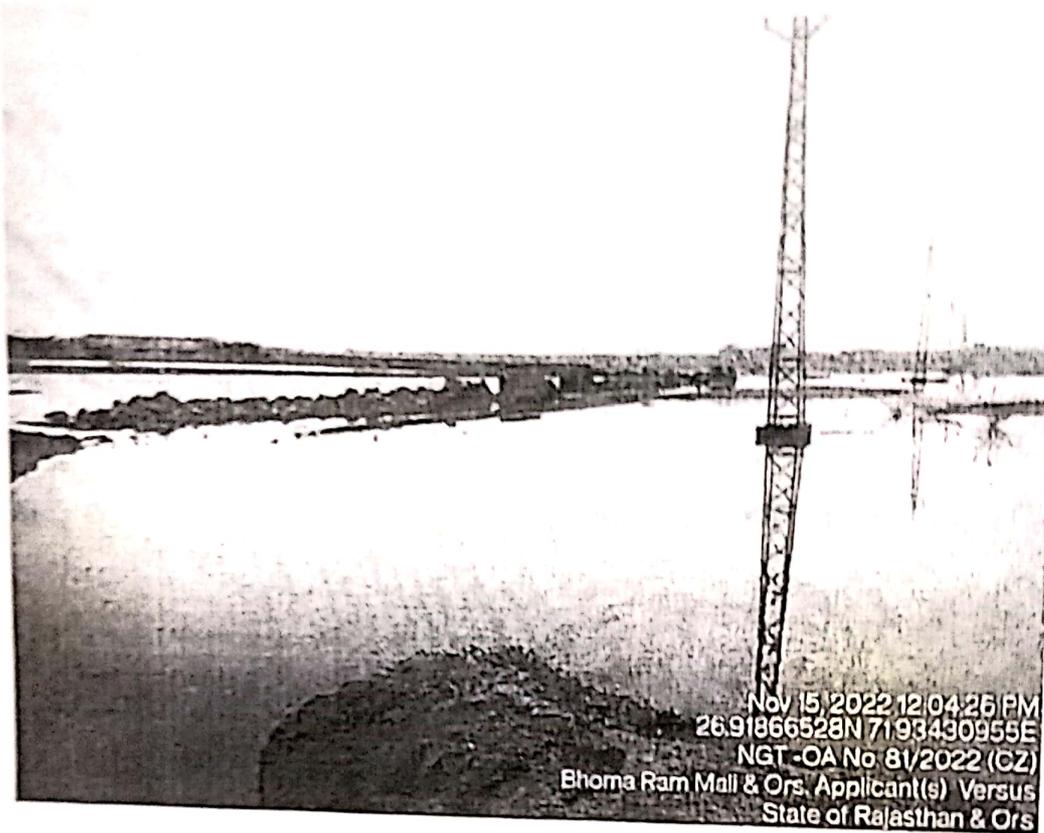


Figure:-2- Factual position of the alleged site.

- It was reported by Representative of Municipal Board, Pokaran that currently they do not have any provision for construction of "Sewage Treatment Plant" and sewage generated from the city area is disposed through partial sewerage line through 09 old open drains existing in town which meets the seasonal Tolaberi river catchment area without any treatment. The "untreated sewage" after accumulation at petitioner land travels downstream to near natural "Rann area in Pokaran town.
- Representative of Municipal Board, Pokaran has deliberated to the committee that as per the CPHEEO Manual, water supply level of 135 LPCD is required to design sewerage system. Due to inadequate water supply level at Pokaran, the work for the


establishment of FSTP has been taken under CM Budget Announcement 2022-23. As per the work order issued for FSTP. 20 KLD capacity FSTP shall be established at the cost of Rs 9.37 Cr (including Operation & Maintenance of FSTP for 10 years including supply, testing of vehicle mounted suction machine for faecal sludge desludging). The FSTP has been designed to cater the requirement for entire population of Municipal Board, Pokaran.


- As per the report dated 24/09/2021 of Tehsildaar Pokaran, the site was inspected by the Patwari on 24/09/2021 and it was reported that domestic sewage of Pokran reaches alleged Khasra No. 1739/943 and 1746/943, Tehsil Pokaran, Dist, Jaisalmer after flowing through river Tolaberi and waste water gets accumulated. Copy of the report of Tehsildaar is enclosed as **Annexure-VII**. But no relief could be provided to the petitioner.
- During the inspection, discussions were made on diversion of sewage and storage in temporary lagoons near the main trunk near Rann area so that untreated domestic does not flow in downstream side towards the land of petitioner for temporary relief to applicant.
- It was reported by the representative of Pokaran Municipal Board that civil work of maintenance/ re-construction of old open drain (existing) of approx. 8-9 Km in length in Pokaran town and construction of new closed channel for conveyance of domestic sewage toward the downstream side of Rann is proposed.
- During the inspection it was directed by Regional Officer, Pollution Control Board that Pokaran Municipal Council should immediately work for sewerage conveyance system and installation of Sewage Treatment Plant in Pokaran town.


RECOMMENDATIONS

After carrying out the inspection, the committee recommends the following:-

1. That a Sewage Treatment Plant (STP) of adequate capacity should be provided for treatment of domestic waste water generated from Pokaran which shall be a long term project.
2. The Construction work of proposed FSTP should be expedited and the provision of necessary infrastructure for efficient Septage management including de-sludging of septic tanks, transportation should be developed for the entire city as per CPHEEO norms.
3. That for immediate relief to the petitioner, it is proposed that the domestic sewage from the main trunk should be disposed on temporary lagoons (proposed)/ wetlands near Rann area of Pokaran.
4. That the proposed proposals of Municipal Council, Pokaran regarding civil work of maintenance/ re-construction of old open drain (existing) of approx. 8-9 Km in length in Pokaran town and construction of new closed channel for conveyance of domestic sewage toward the downstream side of Rann should be implemented / considered on immediate basis.


(Rajkumar Mahoto)
JEE, Municipal Council
Jaisalmer


(Shilpi Sharma)
RO RPCB Jaisalmer


(Prabhjot Singh Gill)
SDO, Pokaran

क्रमांक/न.पा.पो./2022/2474

दिनांक :- 15/11/2022

श्रीमान् वरिष्ठ संयुक्त विधि परामर्शी
स्वायत्त शासन विभाग राजस्थान
जयपुर

विषय :- एनजीटी प्रकरण संख्या 81/2022 भोमाराम नाली बनान् राजस्थान सरकार एवं अन्य के सम्बन्ध में।
प्रसंग :- आपका पत्रांक प8(क)(NGT)(/डीएलबी/2022/19959 दिनांक 14.11.2022

महोदय,

उपरोक्त प्रासांगिक विषयान्तर्गत निवेदन है कि आज दिनांक 15.नवम्बर 2022 को माननीय राष्ट्रीय हरित अधिकरण, भोपाल बैन्च में मूल परिवार संख्या 81/2022 (C7) द्वारा भोनाराम नाली बनान् राजस्थान सरकार एवं अन्य में माननीय राष्ट्रीय हरित अधिकरण के आदेश दिनांक 20 अक्टूबर 2022 के अनुपालना में श्री प्रमजोतसिंह उपखण्ड अधिकारी पोकरण, श्रीमती शिल्पी शर्मा क्षेत्रीय अधिकारी राजस्थान राज्य प्रदूषण नियंत्रण मण्डल, जैसलमेर एवं श्री राजकुमार महतो कनिष्ठ अभियन्ता नगरपरिषद जैसलमेर की संयुक्त टीम द्वारा परिवार स्थल खसरा नम्बर 1739/943 व 1746/943 तहसील पोकरण जिला जैसलमेर का निरीक्षण परिवादी श्री भोनाराम नाली की उपस्थिति में किया गया।

महोदय उपरोक्त दल द्वारा नगर पालिका क्षेत्र में सीवरेज सिस्टम व घरेलू/नगरीय उच्चिष्ठ के निस्तारण हेतु सीवरेज ट्रीटमेण्ट प्लाट लगाने हेतु निर्देशित किया गया उपरोक्त कार्यवाही के सम्बन्ध मार्गदर्शन दिलवाने का कष्ट करावें।

संलग्न- मौका रिपोर्ट

अधिसाधी अधिकारी

नगरपालिका पोकरण (जैसलमेर)

दिनांक :- 15/11/2022

क्रमांक/न.पा.पो./2022/2480 to 2484

प्रतिलिपि :-

- 01 श्रीमान् निदेशक एवं संयुक्त सचिव महोदय स्वायत्त शासन विभाग राजस्थान जयपुर
02. श्रीमान् जिला कलक्टर महोदय जिला जैसलमेर
03. श्रीमान् उपनिदेशक(क्षै) महोदय स्थानीय निकाय विभाग जोधपुर
04. श्रीमान् क्षेत्रीय अधिकारी, राजस्थान राज्य प्रदूषण नियंत्रण मण्डल जैसलमेर।
05. सुरक्षित पत्रावली

अधिसाधी अधिकारी

नगरपालिका पोकरण (जैसलमेर)


मौका रिपोर्ट

आज दिनांक 15 नवम्बर 2022 को माननीय राष्ट्रीय हरित अधिकरण, भोपाल बैच में मूल परिवार संख्या 01/2022 (CZ) द्वारा भोगाराम माली बनाम राजस्थान सरकार एवं अन्य में माननीय राष्ट्रीय हरित अधिकरण के आदेश दिनांक 20 अक्टूबर 2022 के अनुपालना में श्री प्रभोजोत्सिंह उपखण्ड अधिकारी पोकरण, श्रीमती शिल्पी शर्मा क्षेत्रीय अधिकारी राजस्थान राज्य प्रदूषण नियंत्रण मण्डल, जैसलमेर एवं श्री राजकुमार महतो कनिष्ठ अभियन्ता नगरपरिषद जैसलमेर का परिवार स्थल खसरा नम्बर 1739/943 व 1746/943 तासील पोकरण जिला जैसलमेर का निरीक्षण परिवारी श्री भोगाराम माली की उपस्थिति में किया गया।


निरीक्षण के दौरान पाये गये तथ्य निम्नानुसार हैं -

1. मौके पर परिवारी श्री भोगाराम द्वारा अपनी निजी कृषि जमीन खसरा नम्बर 1739/942 व 1746/943 का निरीक्षण करवाया गया तथा यह बताया गया कि नगर पालिका पोकरण क्षेत्र के घरेलू/नगरीय उचिष्ठ का जमाव काफी सालों से घरेलू जमीन पर हो रहा है।
2. निरीक्षण के दौरान परिवार स्थल पर घरेलू/नगरीय उचिष्ठ का जमाव पाया गया तथा कोई पक्का निर्माण नहीं पाया गया। नगर पालिका प्रतिनिधी द्वारा यह बताया गया कि नगर पालिका पोकरण क्षेत्र का घरेलू/नगरीय उचिष्ठ व तोलावेरी बरसाती नदी का पानी उक्त प्राकृतिक जलग्रहण क्षेत्र (नैचुरल कैचमेण्ट एरिया) में आने से इस जगह पर पानी का जमाव प्रायः होता है।
3. कनिष्ठ अभियन्ता नगर पालिका पोकरण द्वारा यह बताया गया कि वर्तमान में नगरीय क्षेत्र में सीवरेज ड्रेन का विद्यमान लगभग 30-35 प्रतिशत क्षेत्र में ही किया गया है एवं उचिष्ठ का निस्तारण पालिका क्षेत्र में 9 मौजूदा ड्रेन (खुला नालों) जो कि शहर के अलग अलग क्षेत्रों में किया जाता है। उक्त उचिष्ठ अंतिम रूप से तोलावेरी नदी बहाव क्षेत्र में आकर गिरता है।
4. नगर पालिका पोकरण क्षेत्राधिकार में उक्त उचिष्ठ के उपचार हेतु वर्तमान में कोई सीवरेज ट्रीटमेण्ट प्लाट का निर्माण नहीं किया गया है व भविष्य में भी एसटीपी निर्माण का प्रावधान नहीं किया गया है तथा मौके पर यह अवगत करवाया गया कि राज्य सरकार बजट घोषणा 2022-23 में माननीय मुख्यमंत्री महोदय द्वारा स्वायत्त शासन विभाग के अन्तर्गत नगरीय निकाय क्षेत्र पोकरण में (Faecal Sludge Treatment Plants (FSTP) के निर्माण हेतु आदेश दिनांक 11.04.2022 को जारी किया गया।
5. परिवार स्थल पर परिवारी की उपस्थिति में संयुक्त दल द्वारा उक्त नगरीय/घरेलू उचिष्ठ के बहाव को परिवारी की भूमि खसरा नम्बर 1739/942 व 1746/943 पर जाने से रोकने हेतु नदी के पास ही नगर पालिका पोकरण की राजस्व भूमि पर अस्थाई लेगून्स बनाकर निस्तारण किये जाने की प्रस्तावना की गई है जिससे प्रतिवादी को प्रारम्भिक राहत दी जा सके।
6. नगर पालिका प्रतिनिधी द्वारा यह बताया गया कि शहर में मौजूदा खुले नालों से आने वाले उचिष्ठ को प्रस्तावित सीवरेज ट्रीटमेण्ट प्लाट तक पहुँचाने हेतु बन्द पाईप लाईन/नाला लगभग 3 से 4 कि.मी लम्बाई में बनाया जाना प्रस्तावित है तथा शहरी क्षेत्र में विभिन्न पुराने क्षतिग्रस्त/जर्जर नालों की जगह नये नालों का निर्माण भी प्रस्तावित है जो लगभग 8 से 9 कि.मी लम्बाई होगी।
7. मौके पर परिवार स्थल के जीपीएस फोटो ग्राफ व परिवार स्थल पर बनाया गया राजस्व नक्शा संलग्न है।

मौके पर क्षेत्रीय अधिकारी द्वारा नगर पालिका पोकरण को जल्द नगर पालिका क्षेत्र में सीवरेज सिस्टम व घरेलू/नगरीय उचिष्ठ के निस्तारण हेतु सीवरेज ट्रीटमेण्ट प्लाट लगाने हेतु निर्देशित किया गया।


(राजकुमार महतो)
कनिष्ठ अभियन्ता


(शिल्पी शर्मा)
क्षेत्रीय अधिकारी


(प्रभजोत्सिंह गिल) 15/11
उपखण्ड अधिकारी